

AD-A108 386

NEW MEXICO STATE UNIV LAS CRUCES

F/G 13/1

DESIGN CALCULATION PROCEDURE FOR PASSIVE SOLAR HOUSES AT NAVY I--ETC(U)

OCT 81 M LUMSDAINE, E LUMSDAINE


N62583-79-WR-585


UNCLASSIFIED

CEL-CR-82.006

NL

Fig 2
SCL
ORDER

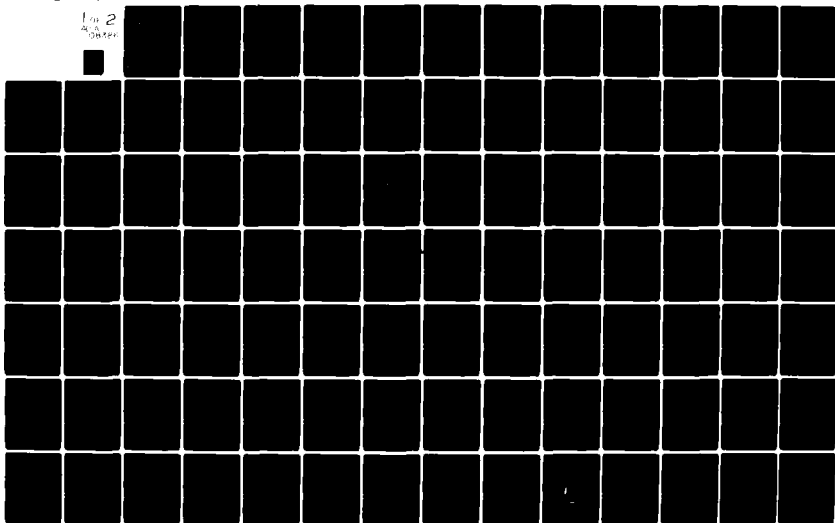

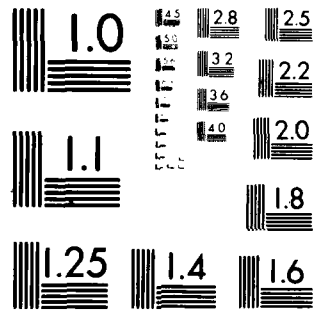

MICROCOPY RESOLUTION TEST CHART
NATIONAL BUREAU OF STANDARDS 1963-A

12 LEVEL III

CR 82.006



NAVAL CIVIL ENGINEERING LABORATORY
Port Hueneme, California

Sponsored by
NAVAL FACILITIES ENGINEERING COMMAND

AD A108386

DESIGN CALCULATION PROCEDURE FOR PASSIVE SOLAR HOUSES AT
NAVY INSTALLATIONS IN WARM CALIFORNIA CLIMATES - VOLUME V

October 1981

An Investigation Conducted by
New Mexico State University
Las Cruces, New Mexico

DTIC
ELECTE
DEC 10 1981
B

N62583-79-MR-585

Approved for public release; distribution unlimited

81 12 10 016

DTIC FILE COPY

Unclassified

SECURITY CLASSIFICATION OF THIS PAGE (When Data Entered)

REPORT DOCUMENTATION PAGE		READ INSTRUCTIONS BEFORE COMPLETING FORM
1. REPORT NUMBER CR 82.006	2. GOVT ACCESSION NO. AD A108	3. RECIPIENT'S CATALOG NUMBER 386
4. TITLE and Subtitle Design Calculation Procedures for Passive Solar Houses at Navy Installations in Warm California Climates, Volume V		5. TYPE OF REPORT & PERIOD COVERED Preliminary Apr 80 - Sep 81
6. AUTHOR Monika Lumsdaine Edward Lumsdaine		7. PERFORMING ORG. REPORT NUMBER
8. CONTRACT OR GRANT NUMBER(s) N62583-79-MR-585		
9. PERFORMING ORGANIZATION NAME AND ADDRESS New Mexico State University Las Cruces, NM 88003		10. PROGRAM ELEMENT PROJECT TASK AREA & WORK UNIT NUMBERS 64710N, Z0350, Z0350-01, Z0350-01-551
11. CONTROLLING OFFICE NAME AND ADDRESS New Mexico State University Las Cruces, NM 88003		12. REPORT DATE October 1981
13. MONITORING AGENCY NAME & ADDRESS (if different from Controlling Office) Naval Civil Engineering Laboratory Port Hueneme, CA 93043		14. NUMBER OF PAGES 116
15. SECURITY CLASS (of this report) Unclassified		16. DECLASSIFICATION DOWNGRADING SCHEDULE
17. DISTRIBUTION STATEMENT (of this Report) Approved for public release; distribution unlimited		
18. DISTRIBUTION STATEMENT (of the abstract entered in Block 20, if different from Report)		
19. SUPPLEMENTARY NOTES		
20. KEY WORDS (Continue on reverse side if necessary and identify by block number) Passive solar designs, Solar heating, Space heating, Solar heat storage, Solar energy		
21. ABSTRACT (Continue on reverse side if necessary and identify by block number) These reports present design calculation procedures for passive solar houses. -A "worksheet" approach is used in that the user may work through an example passive solar design by following the text in the report. Included are tables for heating degree days, solar heat gains, building R factors, orientation factors, roof overhang designs, etc. Performance is		

DD FORM 1 JAN 73 1473 EDITION OF 1 NOV 65 IS OBSOLETE

Unclassified

SECURITY CLASSIFICATION OF THIS PAGE (When Data Entered)

Unclassified

SECURITY CLASSIFICATION OF THIS PAGE (When Data Entered)

calculated on a monthly basis. The reports are presented for five (5) geographical regions with content and text format similar, differing only in the appropriate regional factors. This volume gives appropriate designs for Navy installations in warm California climates.

DD FORM 1473 EDITION OF 1 NOV 65 IS OBSOLETE
1 JAN 73

Unclassified

SECURITY CLASSIFICATION OF THIS PAGE (When Data Entered)

ACKNOWLEDGEMENT

This design calculation procedure was originally developed for the State of New Mexico under a research project funded by the New Mexico Energy and Minerals Department (Grant #78-2228, Monika Lumsdaine, Principal Investigator) and published as Report NMEI 22-SA by the New Mexico Energy Institute at New Mexico State University. It has been tested and used extensively in workshops sponsored by the New Mexico Solar Energy Institute at NMSU. Navy Contract #N62583/79M R585 was awarded to the NMSEI to adapt the procedure with supporting information for use in other geographical locations in the United States, particularly in regions with Navy installations. Marilyn A. Chase, Mechanical Engineering student (NMSEI), has assisted in assembling data and reducing it to graphical form. Ed Durlak, Naval Civil Engineering Laboratory, Port Hueneme, California, has carefully reviewed the draft of this manual and made many suggestions to make the procedure easier to apply by Navy personnel.

M.L.

E.L.

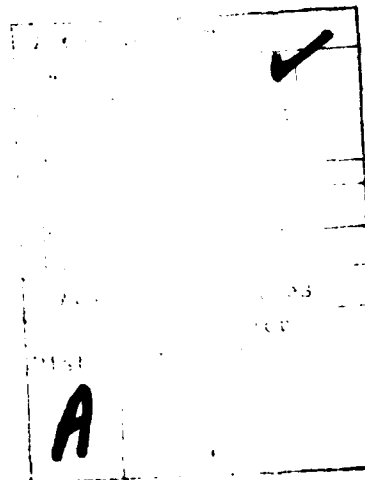


TABLE OF CONTENTS

	<u>Page No.</u>
Acknowledgement	
List of Figures	ii
List of Tables.	iii
List of Worksheets.	iv
1. Introduction and Objectives.	1
2. Review of Definitions.	3
3. Climate and Preliminary Considerations	18
4. Calculation of Building Net Heating Load	30
5. Calculation of Solar Heat Gain and Auxiliary Load.	48
6. Glazing and Storage Calculations	65
7. Energy Savings Calculations.	71
References.	79
Appendix: Design and Calculation Example for California Climate. . .	83
Attachment: Set of Loose-Leaf Worksheets	

List of Figures

<u>Figure</u>		<u>Page No.</u>
2.1	Schematic of the Basic Direct Gain Passive Solar Heating System (Winter Operation).	6
2.2	Examples of Direct-Gain Window and Storage Locations	7
2.3	Heat Transfer Mechanisms of Thermal Storage Walls.	11
2.4	Heating of Living Space with Solar Greenhouse.	12
2.5	Schematic of North-Side Greenhouse Retrofit.	12
2.6	The Roof Pond in Warm Climate.	14
2.7	Thermal Roof Options in Colder Climates with Combined Reflector/Night Insulation	14
2.8	Schematic of Solar Roof System	15
2.9	Schematic of Natural Convective Loop Systems	15
3.1	Influence of Wall Temperature on Human Comfort	19
3.2	Examples of Space Relationship Diagrams.	25
4.1	Heat Loss Coefficients for Basement and Crawlspace Heat Loss Calculations	33
5.1	Mean Percent Sunshine Possible in Warm California Climatic Regions	49
5.2	Monthly Average Solar Heat Gain Through Vertical South-Facing Single Glazing (California)	53
5.3	Monthly Average Solar Heat Gain Through South-Facing Single Glazing at 45° Tilt (California).	54
5.4	Monthly Average Solar Radiation on a Horizontal Surface (Warm California Locations).	55
5.5	Percent of Maximum Solar Radiation Received on Vertical Walls Deviating from True South at 32° and 36° N Latitude.	59
5.6	Definition of Symbols Used in Sawtooth Spacing Calculation	60
5.7	Monthly Passive Solar Heating Estimator.	64

List of tables

<u>Table</u>		<u>Page No.</u>
2.1	Definition of Heat Transfer Terms.	4
2.2	Absorptivity of Building Materials and Paints.	8
2.3	Water Containers for Passive Solar Heat Storage.	9
4.1	Heat Loss Factors for Concrete Floor Slabs	34
4.2	U-Values for Typical Building Construction	35
4.3	R-Factors of Building Materials.	37
4.4	R-Values of Air Films and Air Spaces	39
4.5	Average Window U-Values and Corresponding R-Factor of Night Insulation for Single, Double and Triple Glazing . . .	40
4.6	Recommended Ranges for Surface Heat Losses in Direct Gain Passive Solar Houses	41
4.7	Recommended Design Heat Loss Range for Passive Solar Houses.	44
4.8	Heating Degree Days for Warm California Navy Locations . . .	45
4.9	Contribution of Internal Heat Sources.	46
5.1	Effectiveness Factors.	50
5.2	Summer Shading with Roof Overhang.	57
5.3	Winter Shading with Roof Overhang Solar (Noon)	57
5.4	Sun Altitude Angles on 21 December for California Latitudes and Different Times of Day	61
6.1	Mass Required to Store Solar Heat Gain Through Windows . . .	69
6.2	Heat Transfer Characteristics of Masonry Storage Materials Compared to Water, Wood and Steel.	70

List of Worksheets

<u>Worksheet</u>	<u>Page No.</u>
1A Design Information	22
1B Space Relationship Diagram	24
1C Additional Information and Checklist for Energy Conservation	26
1D Building Dimensions.	28
2 Calculation of Building Skin Conductance	32
3 Calculation of Infiltration Load and Modified Building Heat Loss Coefficient C_B	43
4 Calculation of Building Thermal Load Profile	47
5 Calculation of Solar Heating Contribution.	51
5A Adjusted Net Solar Greenhouse Heat Gain.	52
5B Calculation of Shading with South Roof Overhang.	58
6 Calculation of Building Auxiliary Load Profile	63
7 Glazing and Storage Calculations	68
8A Calculations for Reference Building.	73
8B Heat Savings Calculations for Passive Design	74

1. INTRODUCTION

The simple design method presented here has been developed in response to the following needs and objectives:

- (a) This calculation procedure can be used by designers, contractors, and owner/builders working on plans for passive solar houses. The method is simple enough for people to apply who do not have an extensive background in science, engineering or mathematics. All necessary supporting data is provided.
- (b) The procedure can be used to evaluate the performance of various retrofit design options.
- (c) Design calculations for DOE and HUD solar projects are quite complicated. The procedure provides a "primer" to familiarize interested people without previous experience with the basic steps involved in heat load calculations for solar applications.
- (d) Building inspectors, FHA, and other financial institutions may require heat load calculations, especially if the planned building does not include a full-size backup heating system.
- (e) The design calculation procedure also provides a uniform format for reporting and evaluating the performance of existing passive solar homes in comparison studies.

Since different climates call for somewhat different approaches to passive solar design, five different variations of the original manual have been prepared:

Vol. I - COLD CLIMATE (includes Aleutian Islands, Alaska, the New England Coast from New Haven, Connecticut to Brunswick, Maine, and the southern Great Lakes region around Chicago, Detroit and Cleveland).

Vol. II - TEMPERATE EAST COAST CLIMATE (includes the northern Philadelphia - Washington region and the Atlantic Coast from Norfolk to Charleston).

Vol. III - WARM, HUMID CLIMATE (includes Florida, Hawaii, and the Gulf Coast).

Vol. IV - PACIFIC NORTHWEST CLIMATE (includes only areas west of the Cascades from Seattle, Washington, to Portland, Oregon).

Vol. V - WARM CALIFORNIA CLIMATE (includes the coast from Oakland to San Diego as well as high and low desert areas).

It is assumed that the designer has a basic knowledge of passive solar mechanisms and their operational characteristics. A brief summary is given in the following chapter, and a number of useful reference books are listed at the end of this manual.

The calculation procedure is divided into several steps with corresponding worksheets and supporting data. An additional blank set of worksheets easily removable for xeroxing is attached.

This simple procedure should be especially helpful during the early design phase to evaluate the effect of various design options and combinations and again in checking out the final design, and to determine the approximate auxiliary heat load. The procedure is best applied to direct gain, Trombe walls (mass or water), solar roofs and combinations of these. Sunspaces that are an integral part of the house fall under direct gain; attached solar greenhouses with a large amount of exposed surfaces require an additional set of calculations for the greenhouse alone, with the net heat gain then added to the house calculations. Using a simple hand calculator or slide rule will save time.

Although a brief discussion of passive cooling methods is given in Section 2.5, the calculation method does not include a procedure for determining actual energy savings due to passive cooling.

2. REVIEW OF DEFINITIONS

Solar systems for heating (and cooling) can be divided into two basic categories: active (mechanical) systems and passive (natural) systems. Active systems need some energy input outside of solar to operate. This so-called "parasitic" power requirement can, in some applications, be so large that none or very little net savings will result by using the active solar system. This is true, for instance, in smaller installations of lithium-bromide absorption solar cooling. Active systems resemble in their application conventional HVAC systems in that they consist of a number of components that can be installed after the structure has already been erected. Passive (natural) systems operate without mechanical components or parasitic power input by making use of the natural laws of heat transfer and the properties of building materials to store or transmit solar energy to such an extent that the entire building becomes a live-in solar collector. Thus, passive systems are built right into the structure. The completed building and passive solar system(s) are quite easy to operate since many controls are daily or seasonally automatic. The passive system(s) must be designed and calculated carefully for satisfactory performance, because mistakes will be very difficult to correct once they are built into the house. On the other hand, many options exist that make the design quite flexible, and some features do not have to be fixed until the house has been lived in for a year or so---the building has to be fine-tuned, so to speak. The performance of a passive system can be augmented with the addition of blowers or fans to obtain better heat distribution. Technically speaking, passive systems that use mechanical energy to transport heat around are known as hybrid systems.

Table 2.1 lists definitions for common heat transfer terms used in this manual. The primary passive solar heating methods are direct gain, thermal storage wall (Trombe or water wall), and sunspace (greenhouse); roof ponds, thermosyphon systems and hybrid solar roofs involve more hardware and are thus somewhat more complicated. The heat transfer mechanisms involved between the sun, the living space and the storage mass are very subtle and closely interrelated; thus the building must be designed carefully, and the interaction between the passive solar system(s) and the people living there must also be considered.

TABLE 2.1


Definition of Heat Transfer Terms

HEAT is the sum of the kinetic energy of all molecules in a mass of material due to the random molecular jostling motion.


TEMPERATURE is the intensity of heat (or molecular velocity) and does not depend on the amount of mass present.

CONDUCTION is heat moving from a warmer to a colder region in the same substance; this type of heat transfer takes a definite amount of time and depends on the conductivity of the material. \Rightarrow

CONDUCTIVITY is a measure of the rate at which heat is conducted through a slab of material whose two sides are kept at a constant temperature differential.

CONVECTION is the circulatory motion of a fluid (liquid or gas) caused by temperature differences without the use of mechanical devices. Heat transfer by convection also takes a certain amount of time. It is sometimes called natural convection to distinguish it from forced convection. 

FORCED CONVECTION occurs when air or liquids are made to circulate with the aid of fans/blowers or pumps.

RADIATION is the transfer of heat by electromagnetic waves from an emitter at higher temperature to an absorber at lower temperature. Conversion from radiation to heat occurs when the radiation is absorbed by a substance. This heat transfer occurs practically instantaneously. The radiation properties (emissivity and absorptivity) and temperatures of the emitting and absorbing surfaces will determine the rate of heat exchange between them. 

SENSIBLE HEAT is the heat involved when the temperature of a storage material is raised or lowered.

LATENT HEAT OF FUSION is the heat involved in changing a substance between the solid and liquid states.

SPECIFIC HEAT is the quantity of Btu's which can be stored in a material per pound and per degree Fahrenheit.

HEAT CAPACITY is the quantity of heat that can be stored in a cubic foot of material; it is the specific heat of the substance multiplied by its density.

CONTINUED

Table 2.1 Continued

RADIANT INTENSITY depends on the size and temperature of the emitting surface and the proximity of the absorber.

REFLECTIVITY is a property of materials to "bounce-off" radiant energy instead of absorbing it.

ABSORPTION is the phenomenon of conversion of electromagnetic waves of radiated energy to heat by the surface of a material. From the surface, the heat is then transferred into the material by conduction.

TRANSMISSIVITY is the property of certain materials to let radiant energy pass through without absorbing all of it.

THERMOSYPHONING is a term traditionally applied to mechanical systems that use the natural rise of heated gases or liquids for heat transport.

AUXILIARY SYSTEM is the backup system or conventional space heating or water heating system used to supply energy during periods of completely cloudy weather when the solar systems cannot supply all the energy demanded.

INSULATORS are materials with a low conductivity. These materials are said to have a high resistance to heat flow by conduction and are identified by a high R-value.

1 Btu (BRITISH THERMAL UNIT) is the heat necessary to raise one pound of water by one degree Fahrenheit.

LIVING SPACE as defined and used in this manual denotes any space in the house occupied by people for a variety of activities such as cooking, heating, sleeping, bathing, play and recreation, etc.

U-VALUE (or the coefficient of heat transmission of a material or combination of materials) is defined as the rate of heat flow per square foot per degree Fahrenheit temperature between air on the inside and air on the outside of a wall, roof or floor. It is the reciprocal of R, the thermal resistance of a material. Note that R-factors can be added, whereas U cannot. To calculate the U-value of a combination of substances, first find the total R-value by adding the individual R factors, or $R_1 + R_2 + R_3 + \dots = R_{Total}$ then $U = \frac{1}{R_{Total}}$.

The main heat transfer mechanisms involved during the day and night for the different types of passive solar heating systems are indicated in Figures 2.1, 2.3, 2.4 and 2.6.

2.1 Direct Gain

The simplest and most widely used passive solar heating system is direct gain. It consists of large, south-facing windows combined with a heat storage mass in the room. If the system incorporates operable windows and movable shading and window insulation, a variety of ways to control the level of comfort, both during summer and winter, are provided. The daily temperature fluctuations in the living space are somewhat higher than for a Trombe wall system, and glare may be a problem under certain circumstances. The solar greenhouse is also an application of the direct-gain method; here the daily temperature fluctuations are quite large because glazing is increased and storage mass is relatively small in order to yield excess heat for transfer into the living space adjacent to the greenhouse. Maximum room depth for effective direct gain is $2\frac{1}{2}$ times window height (from floor level) [1]. This will also give good daylighting. The basic schematic is shown in Figure 2.1.

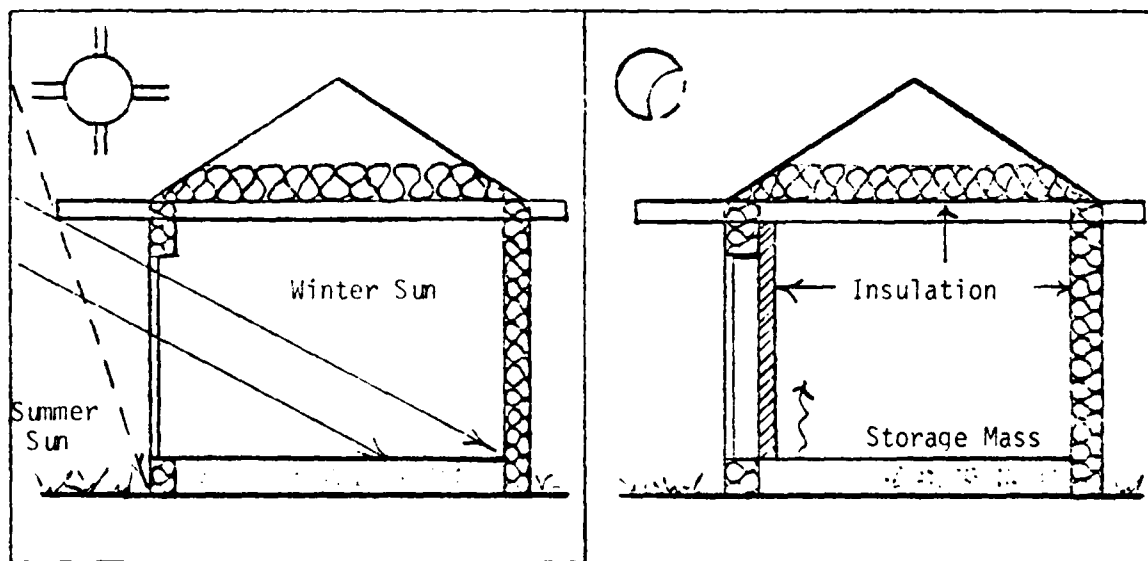


Figure 2.1 Schematic of the Basic Direct Gain Passive Solar Heating System (Winter Operation)

A great degree of freedom exists in the placement of the storage mass in direct-gain systems, as shown in Figure 2.2. The storage mass can be heated either by sunlight striking it directly (preferably a considerable portion of a winter day), or by solar-heated air passing over it, or by reflected radiation from other surfaces in the room. If the storage surface is struck directly by

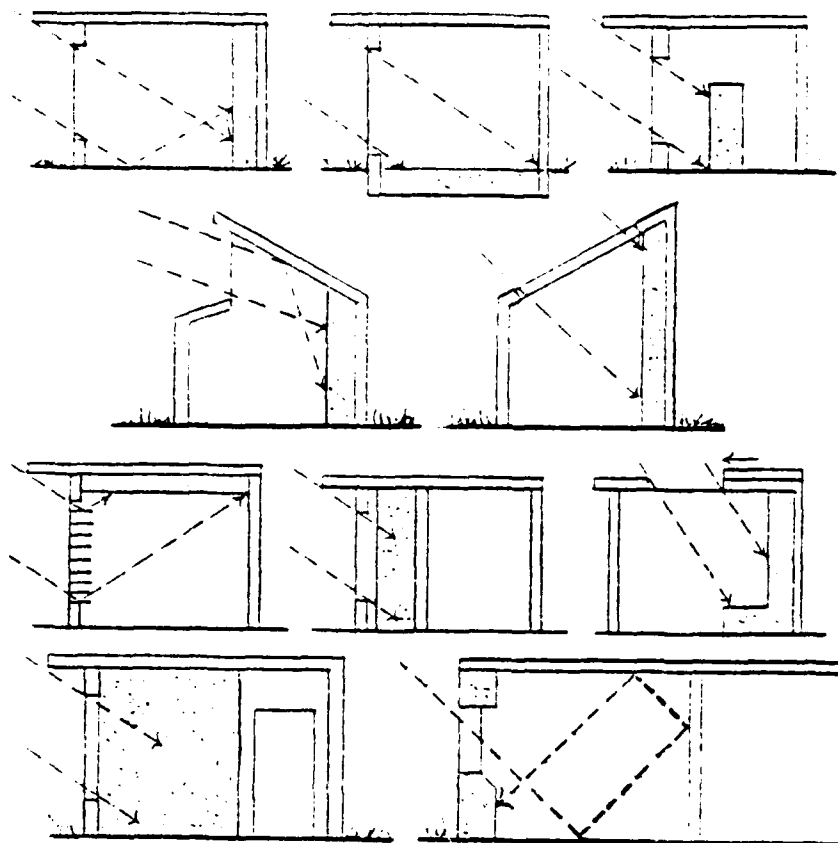


Figure 2.2 Examples of Direct-Gain Window and Storage Locations

sunlight, its performance is increased if its color is dark (see Table 2.2). If the mass only absorbs radiation bounced off from other surfaces, the color does not matter, but the volume required is about 4 times larger than if it received sun all day long in order to achieve similar comfort conditions.* When room temperature falls below that of the storage mass, the storage will begin to reradiate this energy. Some heat transfer also takes place through barely noticeable convective air currents. Attention must be paid to provide sufficient surface area for efficient storage. The amount of storage also

*For example, if storage mass in the sun increases by 20° F from morning to mid-afternoon, air temperature in the room will rise by about 10° F. For a 10° F air temperature rise, storage mass not receiving direct solar radiation will increase by only 5° F; thus the volume to store an equivalent quantity of heat must be 4 times larger.

depends on the climate. In areas with much winter sun, sufficient mass to store heat over 2-3 days is a good idea. This is also true for places that experience large night-day temperature fluctuations in the summer. Places with cloudy winters and/or humid summers should have storage sufficient only to heat the home through one night.

TABLE 2.2
Absorptivity of Building Materials and Paints

Material/Color	Absorptivity
Slate Composition Roofing	0.9
Graphite	0.84
Red-Brown Linoleum	0.84
Asbestos Slate	0.81
Dark Colors	0.8
Gray Soft Rubber	0.65
Concrete	0.59
Red Brick	0.55
Medium Colors	0.5
Cork	0.45
Light Colors	0.2
Aluminum Paint	0.18
White Tile	0.18
Anodized Aluminum	0.15
Wood, Paper, Cloth, Gypsum	0.1 - 0.45

The principal storage materials are water or different kinds of masonry: adobe, brick, sand or cement-filled concrete block (slump block or cinder block), poured concrete, rammed earth, stone, rock, or tile. The heat transfer and storage characteristics of masonry materials do not vary by much; therefore, the choice can be based on local availability, cost, structural considerations and local building code requirements. For storage over several days, masonry is more effective than water. Because of internal convection, water storage containers release heat more quickly than do 2 ft thick masonry walls, for example. From a construction standpoint, it is also easier to incorporate larger amounts of masonry storage than oversize water containers. But because water requires only about 1/3 the volume of masonry to store an equal quantity of heat, water may be preferable in retrofit applications (if existing construction is able to support this load). Table 2.3 lists a number of possible water containers for passive solar heat storage.

TABLE 2.3
Water Containers for Passive Solar Heat Storage
(From D. A. Bainbridge, "How to Build a Water Wall," SOLAR AGE, Vol. 4, No. 8, Aug. 1979, pp. 38-41).

TYPE	SOURCE	SIZE	VOLUME	COST/GAL.	INSTALLED COST	NOTES
Tanks*	Local welder	Any (1-1/2x3x6 3x6 ft recom.)	Any	30¢ to \$1.50	50¢ to \$1.50	Aesthetically appealing, easy to install, effective.
Drums*	Drum manufacturer, chemical supply, etc.		30 or 50 gal.	10 to 45¢	20¢ to \$1.50	Cheap, readily available, hard to clean, must be stacked carefully.
Culverts*	Pipe supply, scrap yards	12 in. + diam.	Depends on length	30 to 50¢	50¢ to \$1.50	Tough, attractive to some, help where floor space is tight. Make sure installation is seismically safe.
Kalwall Cylinders	Kalwall	12 in. & 18 in.	Depends on length	40¢ to \$1.45	50¢ to \$1.75	Translucent, easy to install and move, easy to damage. Best where traffic is light.
PVC Pipes	Agricultural supply	6 in. & 12 in.	Varies	10 to 20¢	30¢ to \$1.20	Light, durable, heat transfer not as good. Must rack or brace to mount.
Glass Bottles	Various	Varies	Up to 10 gal.			Cheap, readily available, must seal carefully, moving difficult.
Steel or Aluminum Pipes*	Scrap yard or supply	6 to 12 in.	Varies	10 to 40¢	30¢ to \$1.50	Readily available, time-consuming to build racks, hard to clean.
Modules	One Design	Steel or fiber-glass		\$1.00/gal. est.	\$1.50/gal.	Easy to install and ship. Good potential for cooling.
Tanks* or Modules	Tabline	46 in. x 4 ft x 16 in.	90 gal.	\$1.00+/gal. est.	\$1.50/gal.	Easy to retrofit, good interior face with stud construction.

* May require corrosion inhibitor. Also cap and container should be of the same material to prevent leaks.


2.2 Thermal Storage Walls

The thermal storage wall, since it is located between the sun and the living space, is an indirect passive solar heating system. The three main types of thermal storage walls (vented and unvented Trombe wall and water wall) are combined collector/storage passive heating methods and have somewhat different performance characteristics since the heat transfer mechanisms for each type vary, as indicated on Figure 2.3. Additionally, performance is also influenced by wall thickness, the conductivity of the material, and insulation. It is highly recommended that double glazing (two sheets of glass or plastic) be used to reduce heat losses from the storage wall to the outside unless night insulation is provided. The wall surface facing the sun is painted dark (though not necessarily black) to increase absorption.


Rooms heated with thermal storage walls should not be more than 20 feet deep [1]. Masonry has the advantage of providing a structural function (load-bearing wall); water, on the other hand, requires less volume. The Passive Solar Energy Book by Edward Mazria, Rodale Press, Emmaus, Pennsylvania, 1979, and the Thermal Storage Wall Design Manual by Alex Wilson, New Mexico Solar Energy Association, P. O. Box 2004, Santa Fe, NM 87501 (\$4.75) give much information on the thermal storage wall, including sizing and construction details.

2.3 Sunspace (Solar Greenhouse)


The sunspace (solarium or greenhouse) system is a combination of direct gain and Trombe wall, as shown in Figure 2.4. The storage mass in a greenhouse is sized to keep the plants from freezing during cold winter nights. The daily air temperature swing in the greenhouse can be as much as 40°F, with the excessive heat available for heating the living spaces adjacent to the greenhouse. In warmer climates, sufficient and correctly placed vents must be provided to prevent overheating in the summer. Figure 2.5 shows the schematic of a northside greenhouse retrofit possible for warmer climates. A south greenhouse retrofit is suitable even in cooler climates (if night insulation for the glazing is provided).

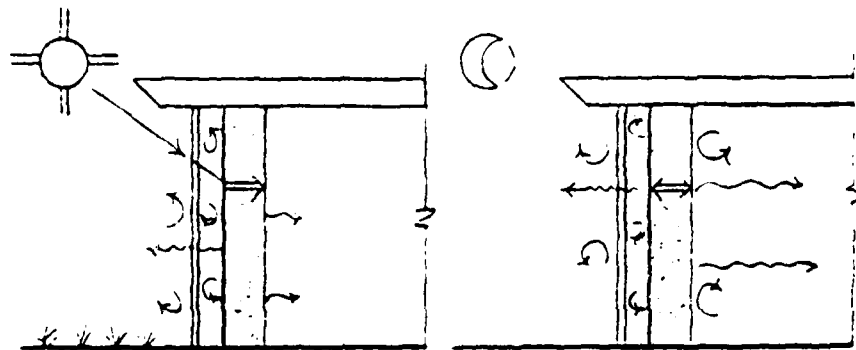

(a) UNVENTED TROMBE WALL with roof overhang for warm climate (ideal for retrofit to masonry buildings).

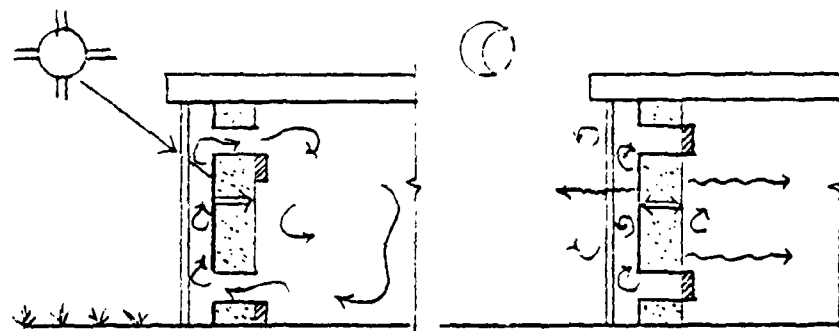

(b) VENTED (THERMOCIRCULATION) TROMBE WALL for colder climate and increased efficiency.

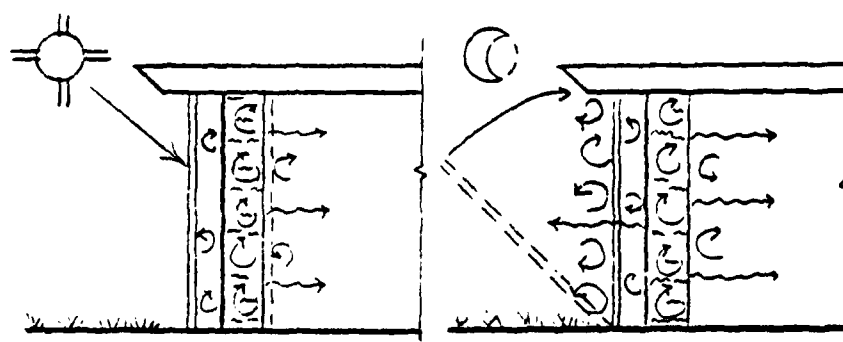

(c) WATER WALL with movable interior and exterior insulation for heat transfer control and increased efficiency. (Efficiency also depends on container surface material.)

Figure 2.3 Heat Transfer Mechanisms of Thermal Storage Walls

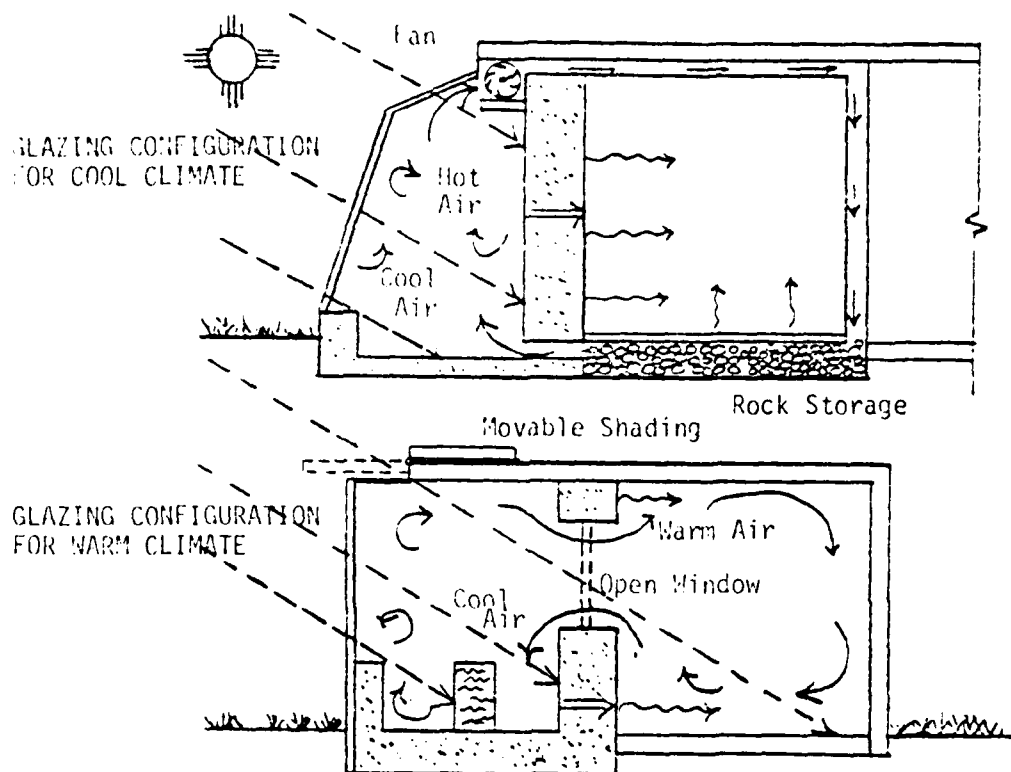


Figure 2.4 Heating of Living Space with Solar Greenhouse

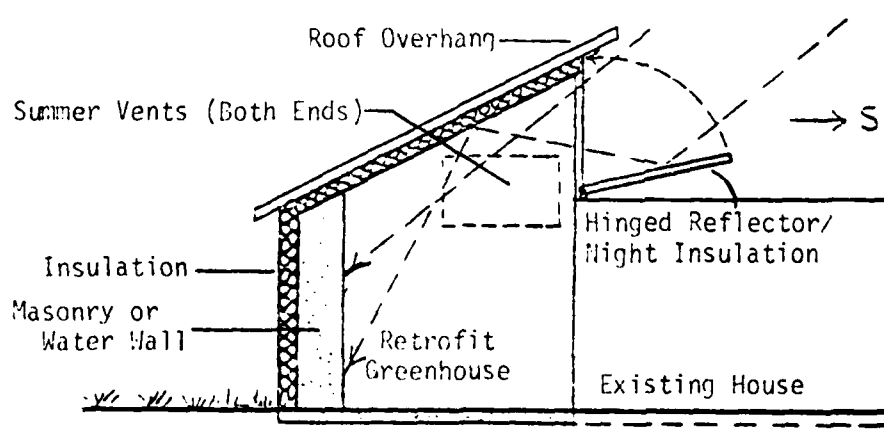


Figure 2.5 Schematic of North-Side Greenhouse Retrofit

2.4 Other Passive/Hybrid Systems

A number of other passive/hybrid systems have been developed for residential applications. These are somewhat more complicated to design and build by contractors without previous experience, or they are applicable to limited climatic regions for best performance. Among these systems are the roof pond developed by Harold Hay for Southern California, the hybrid solar roof (Southern New Mexico) and the natural convective loop system (thermosyphon) which more closely resembles an active solar system since it employs a bank of solar collectors. Schematics of these systems are shown in Figures 2.6, 2.7, 2.8 and 2.9.

Much research and development work is currently underway with new heat storage materials. In the passive methods described above, the usual heat storage medium is either masonry or water (or sometimes a combination of both); these media store sensible heat by undergoing an increase in temperature. Phase-change materials, on the other hand, make use of latent heat of fusion to store large quantities of heat without much temperature fluctuation. Experimental units of phase-change materials have been able to store and yield up to twenty-five times more heat than rock beds of equal mass under the same operating conditions [2]. A suitable phase-change material must have the following characteristics: the melting/freezing point must be at a convenient temperature, it must be nontoxic, nonflammable, noncorrosive and otherwise acceptable to building codes, it must perform reliably and without loss in efficiency over a long life cycle, and it should be inexpensive, widely available and of nonfossil fuel origin. So far, only a group of salt hydrates developed by Dr. Maria Telkes come close to meeting a number of these requirements. Sodium sulphate decahydrate (Glauber's salt) and sodium thiosulfate pentahydrate have been used in experimental solar houses. The major problems found have been supercooling, segregation of the components of the mixture after a few cycles, and failure of the containers. Certain plastics are being investigated for containers; another approach using foamed concrete block impregnated with eutectic salts and sealed with a membrane also shows promise [2].

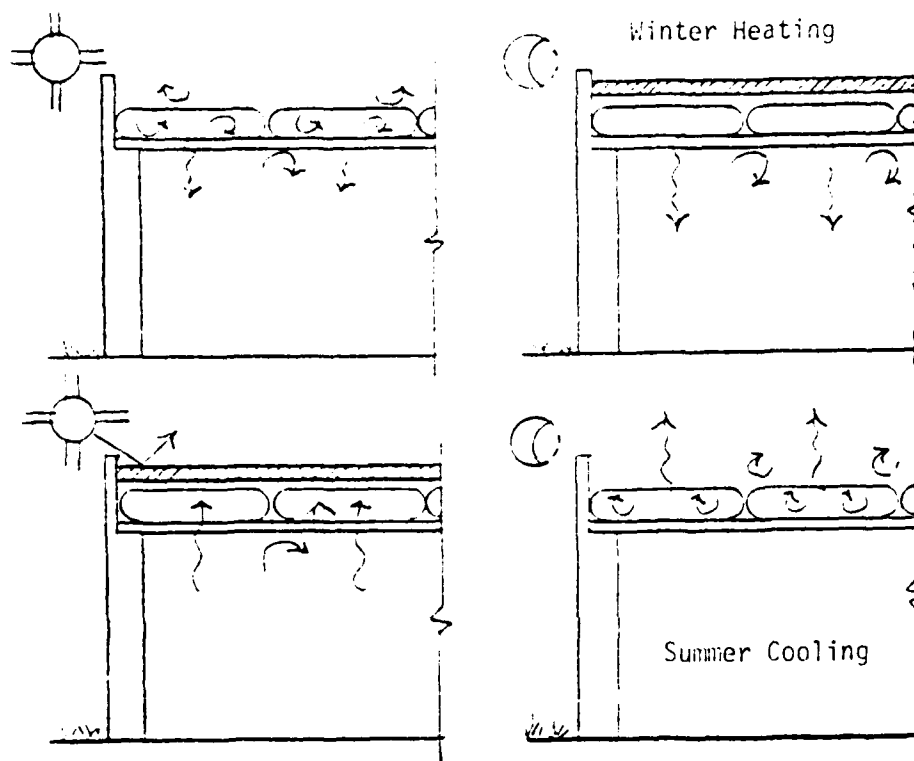


Figure 2.6 The Roof Pond in Warm Climate



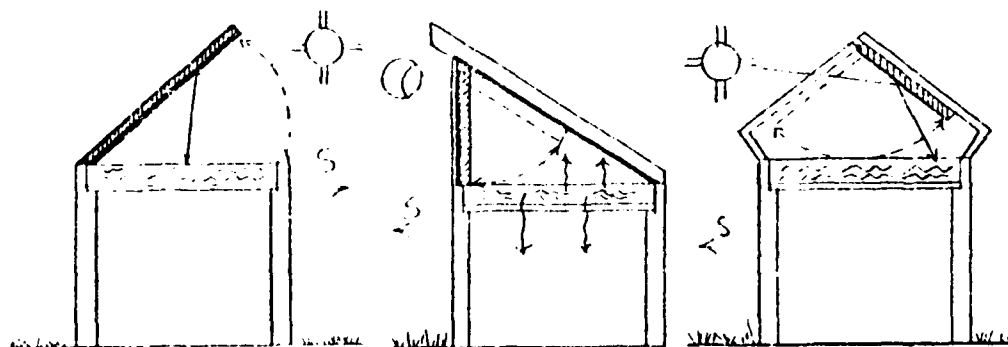


Figure 2.7 Thermal Roof Options in Colder Climates with Combined Reflector/Night Insulation

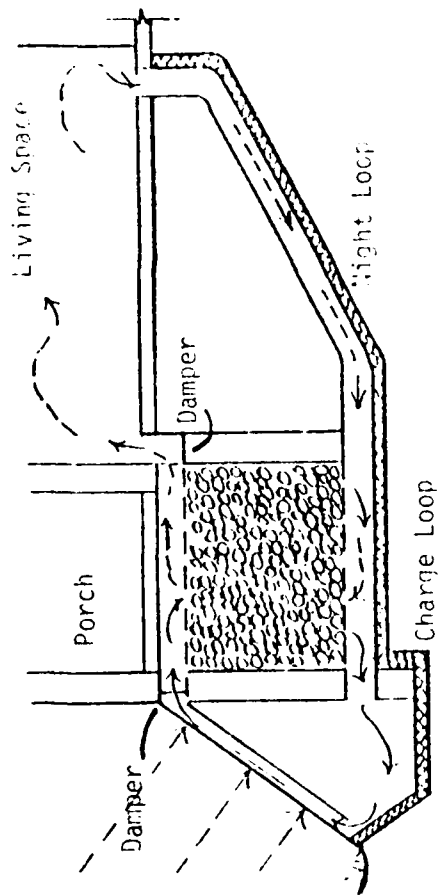

(a) Double Natural Convection Loop System

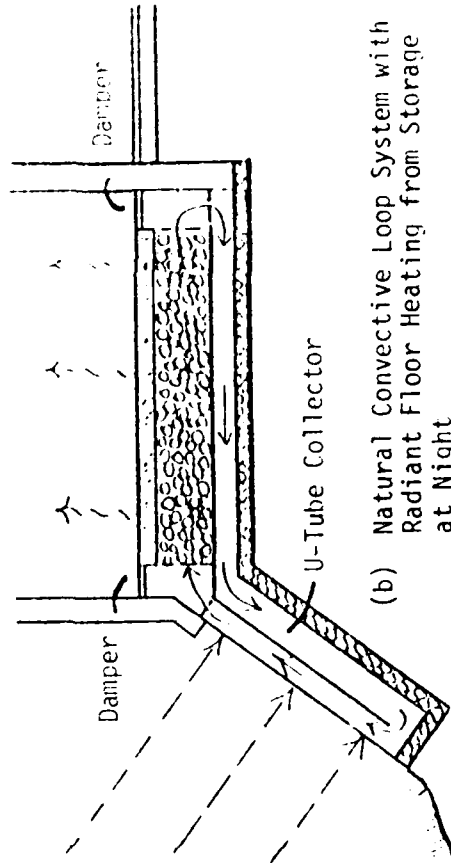

(b) Natural Convective Loop System with Radiant Floor Heating from Storage at Night

Figure 2.9 Schematics of Natural Convective Loop Systems with Alternate Storage Location and Function.

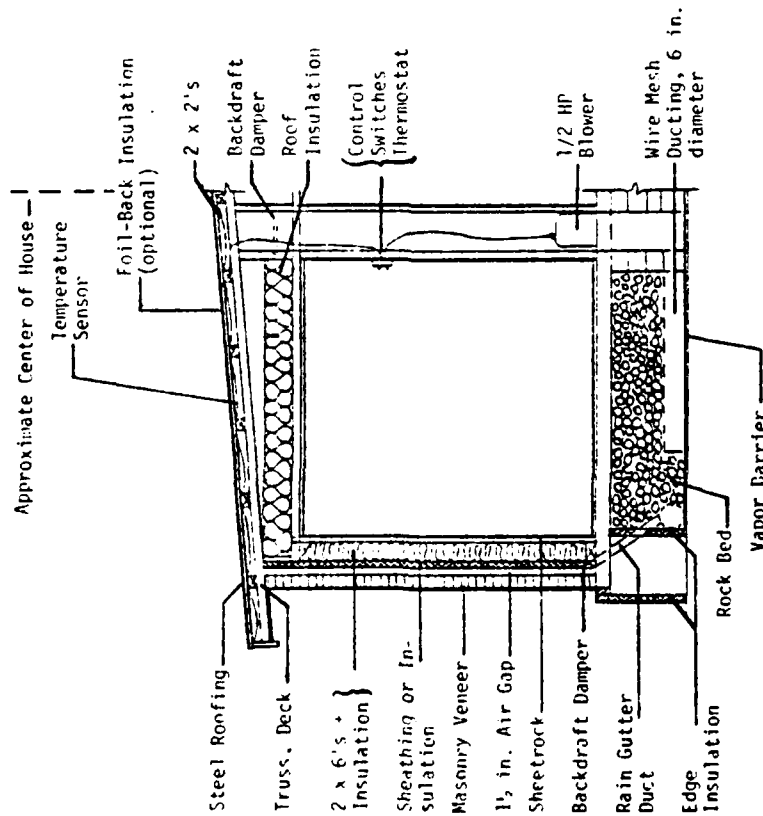


Figure 2.8 Schematic of Solar Roof System (Steel Roof, Masonry Veneer Version). The system can also be used with shingled gable roofs and stucco or siding.

2.5 Passive (Natural) Cooling

A number of techniques are possible for space cooling. Some are very energy-intensive such as refrigerated air conditioning or the lithium-bromide active solar cooling system. Others employ only a fan or blower (forced ventilation, evaporative cooling). Shading, natural ventilation and earth cooling by induced convection are methods which require no parasitic power input. In hot, dry climates, shading, natural and induced ventilation, evaporative cooling, night-sky radiation (i.e. roof ponds), time-lag cooling and earth cooling can be used. Hot-humid climates pose a more difficult problem for natural cooling, since only shading, ventilation and earth cooling will work here. Dehumidification will decrease relative humidity to more comfortable levels but will increase air temperature [34].

Shading: One of the easiest ways to reduce summer heat gain is by shading windows (and walls as well as roofs where little insulation is used). However, sufficient indirect light should be allowed into the building to avoid turning on electric lights during the day. Overhangs, shades or louvers outside the building work better than interior shutters because they block the heat before it enters the house. Deciduous trees and vines are ideal for shading roofs, east and west walls as well as the grounds next to the entire building. Paved areas especially should receive shading after 10 a.m. in the summer.

Natural Ventilation: This method can be used in locations that have sufficient and fairly dependable summer breezes. It must not be used during times when outdoor temperatures are much higher than indoor temperatures, especially in buildings with interior heat storage mass. During such times, ceiling fans or other types of portable fans can be used to locally increase comfort inside the house.

If winds are not sufficient, ventilation can be induced with the chimney effect. This method makes use of the natural property of heated air to rise. If a solar greenhouse is vented at its highest point while being coupled to the house with low intake vents, hot air can be drawn out of the house. Special monitors can be built on the roof to accomplish the same purpose.

Attic fans or turbulators can be used to reduce heat build-up in the attic space and for drawing fresh outside air into the house.

Time-Lag Cooling: In areas which have large day/night temperature differences, natural ventilation can be combined with a large amount of interior and exterior mass. During the day, such buildings are tightly shut. Many passive solar-heated homes in suitable climates can make effective use of this method for cooling.

Evaporative Cooling: In areas with low humidity, this method is effective but requires a constant supply of water. Various systems and degrees of complexity are available, from the simple "swamp" cooler common in the Southwest to two-stage indirect or regenerative systems employing rockbeds. The open roof pond, indoor fountains and pools are other means of evaporative cooling.

Night-Sky Radiation: In open areas with low humidity, the roof of a building can loose a large amount of heat to the cool night sky through radiation. This principle is employed in roof ponds and with somewhat less efficiency (depending on type) also with the summer mode of the solar roof system.

Earth Cooling: Underground buildings and earth-to-air heat exchangers make use of the cool, constant temperatures that prevail a relatively short distance into the ground. Insulation must be used to prevent too cool temperatures. In humid locations, earth cooling must be combined with an earth-to-air heat exchanger, and the water vapor must be condensed out at the air intake tube before the air is supplied to the house. This method of course can only be used on sites which have a low water table.

3. CLIMATE AND PRELIMINARY CONSIDERATIONS

3.1 Climate

Passive solar houses must be designed specifically for the climatic conditions at the site. Besides the amount of sunshine available on any day (or the monthly average total), wind direction and velocity, precipitation and the average temperature are also important considerations. Heating degree days are the number of degrees the daily average temperature is below 65°F. A day with an average temperature of 30° has 35 heating degree days, while one with an average of 65°F or higher has none. This data is usually given in monthly and yearly totals and is used to calculate the heating load of the building, since fuel consumption for heating a building is linearly proportional to heating degree days. The data is usually available from the local Chamber of Commerce, or the values given on Table 4.8 may be used if more accurate information is not available locally. However, it must be remembered that "climate is never an average" [3], even though average monthly figures are used in the heat load calculations for convenience.

Local microclimates can also vary considerably from the official data published by the weather stations. Therefore, the data used in the calculation procedure must be adjusted as much as possible for the expected conditions at the building site; on the other hand, because of the large variations that can occur from day to day, month to month and year to year, average values can give a good overall idea of the expected performance of the design under fairly normal conditions. Also, temperature and comfort are not the same, since humidity levels and air movement as well as room surface temperatures (due to radiant heat transfer) have a large influence on human comfort and response to surrounding temperatures, as illustrated in Figure 3.1.

Besides heating degree day data, accurate solar insolation data is important in the performance calculations for passive solar houses. Here again a number of difficulties are present. Solar data is usually in the form of average daily totals of solar radiation on a horizontal surface. However, for most

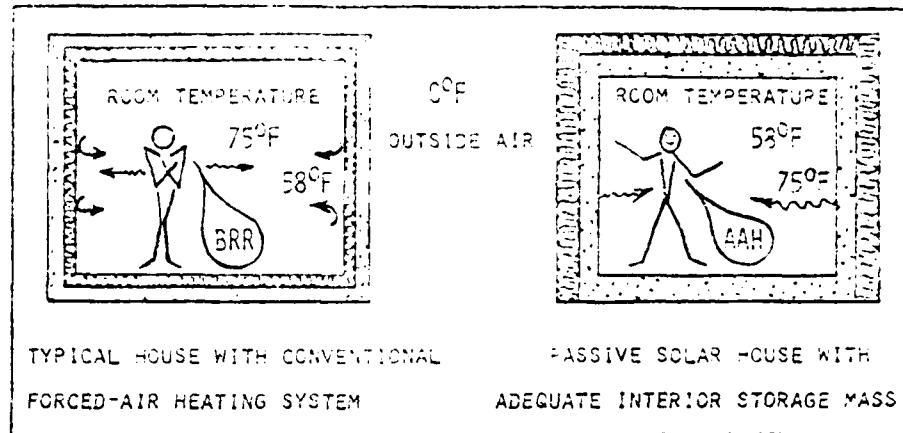


Figure 3.1 Influence of Wall Temperature on Human Comfort

passive systems, the collector (window) orientation is usually vertical or sloped, and the amount of radiation reaching the interior of the house depends on the type and number of glazings, the ground reflectance, atmospheric conditions (sky clearness, air pollution), cloud cover, and the sun's position in the sky (determined seasonally by latitude and time of day). Even less information is available on the sequence of clear and cloudy days and the percent sunshine actually received by the collector. But even where average data is available, conditions on any one day (or even monthly averages) can vary by ± 30 percent or more.

Because of all these uncertainties, using averaged values in the design calculations will most likely not be a handicap in obtaining a good passive design which will perform adequately during all but very extreme years, if care is taken to get good heat distribution in the house, if climate-appropriate passive solar heat gain methods are applied (combinations of systems have an advantage here since they usually have different characteristics and peak performance during different times of the year) and especially if subsequently the house is built with top-quality construction. This last point cannot be overemphasized. The graphs and tabulated values for solar heat gain or radiation are given later in the report where the data is needed to complete the worksheets of the design procedure. In general, until more accurate information becomes available, the designer is advised to make reasonable adjustments for local conditions (i.e. increased cloudiness near mountains, air pollution near factories, reflective surfaces in front of collector, etc.) when using the area-averaged data given in this manual. Estimates of these adjustments can be made through comparison with data from locations with similar conditions; after the designer has had some experience with passive systems design and operation, these adjustments may be made "intuitively".

3.2 Design Objectives for Warm California Climates

A well-designed and well-built passive solar building performs the following functions:

1. It is a solar collector (by using south-facing windows, walls, and skylights, and sometimes also the roof).
2. It is a heat storehouse (by incorporating mass inside the building).
3. It is a heat trap (through good construction and insulation, including window night insulation).

These three have to be in a correctly-balanced relationship for the particular climatic conditions at the site. For California locations in the 1500 - 4200 heating degree day range, the important design objectives are, in this order:

1. Adequate insulation, winter windbreaks
2. Sufficient winter solar heat gain
3. Sufficient heat storage mass
4. Summer shading and natural ventilation
5. Additional appropriate passive cooling methods
6. Building aspect ratio* = 1.1 - 1.4

These objectives can be achieved by incorporating into the design these features:

1. Zoned floor plan with buffer spaces
2. Berming in extreme (cold or hot) locations
3. Air locks, interior chimneys
4. Trombe walls, direct gain
5. Summer shading of heavy mass south walls.

In addition, certain areas have some special requirements.

*This means the E-W axis is longer than the N-S axis of the building, with the N-S axis assigned a base value of 1.

High Desert: In locations with cold winters, triple glazing for the N, E, W windows is recommended and SE and SW windows may give additional solar heat gain. Sunspaces may also be used for solar heat gain.

Low Desert: E-W window area should be minimized. Avoid using any horizontal skylights. Louvers and relatively small windows should be used. Direct gain with sufficient storage mass is most appropriate. If adobe construction is used, the N, E, W exterior walls must be insulated (on the outside). Patios should receive sun in the winter, shade in the summer. Deciduous trees may be planted on the S side. Interior heat sources (i.e. water heaters) should be isolated from the living space.

Southern California: One-story light-colored houses with shaded carports, shaded patios and pools and vegetative ground covers are appropriate here. If windows are not sufficient for adequate ventilation, vents should be used.

3.3 Preliminary Design Data

Before definite sketches and calculations can be made, the designer will need to assemble a variety of information on the planned building's site and use. Worksheets 1A, 1B and 1C have been provided for this purpose. The overall objective of the designer should be to produce a house that is both energy-efficient and livable (that is, it will be comfortable and meet the needs of the people living in it). Therefore, a family that is rarely home during working hours but does a lot of entertaining at night will need a different room layout than a family with preschool children who will benefit from sunny living spaces. In passive design, it is possible to build/design into the home a large degree of automatic/natural temperature control by careful placement and sizing of rooms (with proper zoning and buffer spaces), storage mass, heat-gaining and ventilating windows and shading devices, and in the selection of the most appropriate passive solar mechanisms. Such a building will be able to maintain reasonable comfort even during power failures or periods of fuel shortages.

Worksheet 1A asks for basic design information. This information defines the limits and restrictions on the building that will have to be carefully

WORKSHEET 1A
DESIGN INFORMATION

1. Location of building: _____ Altitude: _____
2. Building type (one or two story, split-level, etc.): _____
3. Roof shape: _____
4. Lot size: _____ Special features: _____
5. Lot orientation (in which direction will the house face the street?): _____
6. Building setbacks (check with local codes): _____
7. Zoning restrictions and covenants: _____
8. Lot access: _____
9. Utility access: _____
10. Lot slope, water runoff (erosion?), berming: _____
11. Predominant direction of winter wind: _____ Velocity: _____ mph average
12. Predominant direction of summer breeze: _____ Velocity: _____ mph average
13. Direction of best view: _____
14. Direction of worst view: _____
15. Shading from neighboring houses, trees, etc.: _____
16. Approximate floor area: _____ Heated basement? _____
17. Number of occupants: _____
18. Number of bedrooms, baths: _____
19. Other living spaces wanted: _____
20. Life style of occupants and special needs (i.e. play area for children, space for entertaining, hobbies; space used during day, evening; special storage requirements; handicaps): _____

21. Preferred patio location, other outdoor recreation areas: _____

22. Occupants like the following features: _____

23. Occupants dislike the following features: _____

incorporated into the design. For example, if both access and best view are to the west or north, the entry will have to be provided with shelter, and the larger window size (for the view) will need to be compensated for with increased insulation and careful summer shading. Space is also provided for listing the special needs and wishes of the people who will live in the house; it is important to consider these in the design as much as possible within the building's construction budget. People will not be happy in a solar house if annoyed daily by a poor circulation pattern, insufficient storage areas, etc., even if passive heating (and cooling) are functioning well. If the house is to be built for sale, the focus can be on a specific group in the housing market, i.e. young families, professional people or older couples, and the design is made with their special needs in mind. These special features can then be used to make the solar home attractive to this group of buyers even outside its solar features.

Worksheet 1B is used for sketching a space relationship diagram for the planned dwelling. Figure 3.2 illustrates different possibilities, depending on the requirements of the people and the lot constraints (access, size, shading, view, etc.). Even though the three designs shown in the example can be used in similar climatic zones (2500 to 3500 heating degree days), different design conditions resulted in very different space relationships.

A study of the space relationship diagram will give some indication of the passive solar mechanisms that can be employed. If living areas are to the north, a steeply sloped skylight or clerestory windows for direct gain can best be used; if no view is present, if privacy is desired or a bad view must be concealed, Trombe walls can be chosen for the south wall (or a solar greenhouse with translucent glazing). The choice depends on the people's life style -- if they have no time or inclination for gardening, the Trombe walls would be a better solution. If not much sunny south wall is available, a steeply sloping solar roof, sloped skylights or clearstory windows to the south may be the answer. If heat is not needed until early evening, unvented (to the interior) Trombe walls would serve well; for heat early in the day, direct gain should be selected instead. If there are no restrictions or preferences, it is best to begin the preliminary design with direct gain to the important living spaces only and make modifications after some preliminary calculation results have been obtained. Direct gain is the most efficient solar heat gain mechanism for very cold climates.

WORKSHEET 1B
SPACE RELATIONSHIP DIAGRAM

Floor area: _____ sq. ft.

Sketch the location of the main entry and the living, cooking, eating and sleeping areas; then mark the major wind directions and use baths, utility, storage areas and garage as buffer zones against winter winds and summer heat. Indicate the zoning barrier (■ ■ ■) and tentatively mark the location of auxiliary heat sources (★). Areas thus marked will need to be designed so that they can be completely closed off from the remaining sections of the house during periods when auxiliary heating is necessary. Finally, show the direction(s) of the best view (and, optionally, undesirable views which will need to be screened).

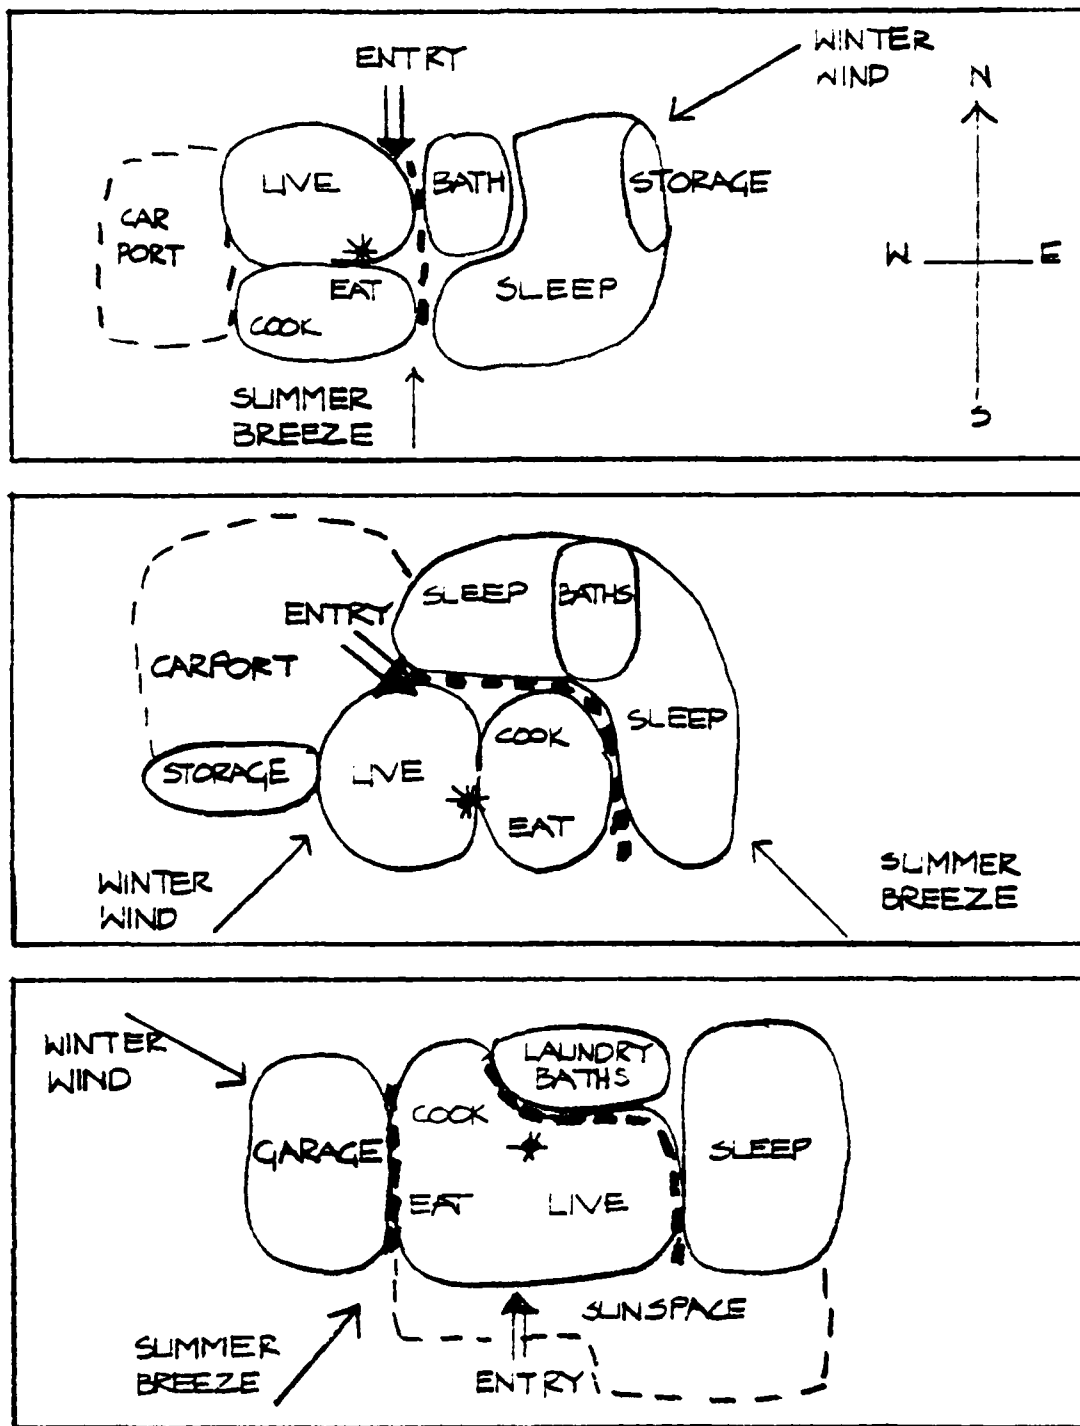


Figure 3.2 Examples of Space Relationship Diagrams

Worksheet 1C will provide additional information and a checklist for energy-conservation measures that can/should be incorporated into the design and building specifications.

WORKSHEET 1C

ADDITIONAL INFORMATION AND CHECKLIST FOR ENERGY CONSERVATION

Building orientation is within 5° E or W of South.

Major axis runs east-west.

Windbreaks are provided against winter and spring storms.

Windows are of double or triple-glazed wood-frame (or equivalent) casement, single- or double-hung type? _____

Window areas to the north, east and west are minimized.

Windows allow sufficient natural summer ventilation.

Windows are insulated at night by (insulated drapes, shades, interior or exterior shutters): _____

Passive solar mechanisms included in the design are: _____

Storage mass is located at: _____

Are fans used for heat distribution: _____ Where? _____

Is there a solar greenhouse? _____

Are there well-lighted spaces in the house for plants? _____

Other sources of winter humidity in the house are (interior venting of clothes dryer, interior clothesline, etc): _____

Is the main entry an air lock? _____ Do other entries have air locks or storm doors? _____

Can heated living areas be closed-off from sleeping areas? _____

What type backup heater is planned? _____

Will a solar water heater be used? _____ What type? _____

Solar tank location, size: _____

Collector location: _____ Type: _____ Area needed: _____

Heat exchanger(s): _____

Collector slope (approximately equal to latitude +10° is best): _____

Backup water heater, type, size, fuel: _____

Energy-efficient appliances to be used are: _____

Fluorescent lights are to be used in: _____

Fireplace has chimney on interior wall and is equipped with fresh-air duct and damper and glass screen.

Wood burner or stove: _____ Output: _____ Btu/hr

At this point, the first sketches of the design (including the passive solar heating method(s)) should be made because dimensions are needed for the design calculations that follow. A convenient scale to use is 1" = 10'. A floor plan may be sufficient for a simple design if window sizes are listed separately; otherwise, a sketch of the elevations should be included. From this sketch, Worksheet 10 (Building Dimensions) can then be completed.

A word of caution must be added at this point; do not expect to be able to design the perfect passive solar house -- this is impossible for at least three reasons: daily and yearly variations in the weather/climate, the living habits of people, and cost-effectiveness. It is, however, not too difficult to achieve a good design if the design is kept somewhat flexible, and if compromises are made reasonably and carefully between climatic conditions, people requirements and cost. As people live in the house, it may be necessary to "fine-tune" the design during or after the first year of operation. This should not be considered to be a flaw in the design but rather a sign of flexibility. For instance, roof overhangs in moderate and warmer climates only may be either too long for cool springs and just right for the fall, or right in the spring and insufficient during the fall. The inhabitants will be most comfortable if they are left with some control over or method of adjustment in the amount of shading or, conversely, in the amount of solar heat getting into the house. Windows with different angles (vertical or sloped) receive the maximum monthly solar radiation at different times of the year; if a combination of such windows is used (some of them operable) paired with good insulating shutters, this would allow for greater flexibility in comfort control and thus would be a desirable feature. In general, different combinations of passive solar heat gain mechanisms where warranted by the climate should be considered not only from the architectural standpoint (and cost), but also for the added measure of control possibilities that would be provided to the overall design. Another point to consider is that daily owner involvement in operating the movable window night insulation in winter and shading controls in the summer must be kept within reasonable bounds.

WORKSHEET 1D BUILDING DIMENSIONS (for Worksheet 2)					
Orientation/ Type	Gross Wall Area, ft ²	Window Area, ft ²	Door Area, ft ²	Net Wall Area, ft ²	Perimeter ft
	() - [() + ()] = ().			()	
Total NW					
Total N					
Total NE					
Total E					
Total SE					
Total W					
Total SW					
Total S					
Total Trombe					
Total Air Lock					
Total	() - [() + ()] = ().			()	
Roof	Gross Roof Area ()	Skylights ()	Net Roof Area ()		

Thus, if the budget allows, some automatic or semi-automatic controls are preferable, such as the "Skylid" window shutter, the insulated, motorized "Thermal Gate" quilted curtain, or in very cold climates the "Bead Wall" window insulation. Climate control of course also includes the proper choice and location of backup heater(s).

A more detailed discussion of backup heating (and of other design factors, such as solar water heating, lot selection, storage alternates) is given in Reference [4].

4. CALCULATION OF BUILDING HEAT LOSS

How well will the planned building perform as a heat trap? Building heat loss occurs in two ways: by conduction through the building envelope (or skin) and by infiltration of cold air. The total building heat loss is the sum of these two losses. Reducing heat loss (or in other words, the heating load) is the first objective in passive solar design, because insulation is more cost-effective than using large amounts of glazing and storage mass. An adequate amount of insulation will also reduce summer heat gain.

4.1 Calculation of Building Skin Conductance

The primary design goal in the different California climates is prevention of winter heat loss and summer heat gain by large amounts of insulation. In hot desert areas, R-40 in the roof is not excessive. Reference [5] gives a discussion of the cost-effectiveness of insulation. Exterior wall insulation (as a rule of thumb) would be about $\frac{1}{2}$ that of the roof, basement below grade insulation $\frac{1}{2}$ that of the wall above grade, and basement floor insulation $\frac{1}{2}$ that of below-grade basement walls.

For these calculations, two sets of input information are needed to complete Worksheet 2: the area of the exterior surfaces and their U-value. Table 4.2 lists U-Values for typical construction, or ASHRAE values and methods may be used [6]. Table 4.3 lists R-factors for a number of building and insulation materials, Table 4.4 the R-factors for air layers and air spaces.

For each surface except the floor or basement, multiply the area with its U-value. Where there are large unheated airlock spaces, such as entry or garage, consider the wall between the airlock and the heated rooms as the building's skin. But because the temperature difference between the two sides of the wall is not as large as for an exterior wall, multiply the product of its U-value and surface area by two-thirds (if the doors will be kept shut except when needed for entry or exit).

The heat loss through the floor depends on the type of foundation used.

(a) Slab-on-Grade Construction

Calculate the product of $F \times P$, where the value of F is obtained from Table 4.1 and P is the length of the slab edge (building perimeter).

(b) Crawlspace Under Joist Floors (No Vents)

Calculate the product of Ah_c , where

$h = 0.12$ (no insulation)

$h = 0.05$ (R-11 insulation)

$h = 0.03$ (R-19 insulation)

and A is the heated gross floor area.* Figure 4.1 can be used to find interpolated values.

(c) Vented Crawlspace

Calculate the product of UA , where A is the gross floor area and U is the reciprocal of the total R-value of the floor and insulation. It is recommended that the floor be carefully insulated in locations with more than 1000 heating degree days, or that the vents be closed in the winter.

(d) Heated Basement

Walls down to 4 ft below grade are treated like exterior walls, where heat loss equals $U \times A$. Heat loss for walls lower than 4 ft below grade and in contact with firm soil is determined by calculating the product $h_b A$. The value of h_b depends on the R-value of the insulation and can be taken from Figure 4.1. The heat loss through the floor is about half that of the below-grade walls for the same amount of insulation.

(e) Unheated Basement

Assume a similar heat loss pattern as for crawlspace. Good floor insulation is important between the heated living space and the unheated basement.

Table 4.5 gives a list of night insulation R-factors for single, double, and triple-glazed windows to achieve a given (assumed) average U-value for the window over a 24-hour day. If the window insulation will not be used for the full 14 hours (5 p.m. to 7 a.m. for example), then the R-factor of the window insulation must be increased above that given in Table 4.5.

Finally, on Worksheet 2, last column, determine the percentage contribution for the total losses of walls, windows and doors, roof, and floor.

*Gross floor area is measured from the outside of exterior wall studs (for frame walls) or exterior of masonry walls.

WORKSHEET 2

CALCULATION OF BUILDING SKIN CONDUCTANCE

Surface Type	Net Area ft ²	U-value Btu/hr-°F-ft ²	U x Area Btu/hr-°F*	% of Total
North exterior wall	_____ X	_____	= _____	
East exterior wall	_____ X	_____	= _____	
West exterior wall	_____ X	_____	= _____	
South exterior wall	_____ X	_____	= _____	
South Trombe wall	_____ X	_____	= _____	
Air lock walls	_____ X	_____	= _____	
Total Wall Heat Loss			<div style="border: 1px solid black; width: 60px; height: 20px; margin: 0 auto;"></div>	_____
Doors: Entry	_____ X	_____	= _____	
Patio	_____ X	_____	= _____	
Other	_____ X	_____	= _____	
North windows	_____ X	_____	= _____	
East windows	_____ X	_____	= _____	
West windows	_____ X	_____	= _____	
South windows	_____ X	_____	= _____	
Clerestory windows	_____ X	_____	= _____	
Sloped skylights	_____ X	_____	= _____	
Horizontal skylights	_____ X	_____	= _____	
Total Door/Window Heat Loss			<div style="border: 1px solid black; width: 60px; height: 20px; margin: 0 auto;"></div>	_____
Roof	_____ X	_____	= <div style="border: 1px solid black; width: 60px; height: 20px; margin: 0 auto;"></div>	_____
Floor **	_____ X	_____	= <div style="border: 1px solid black; width: 60px; height: 20px; margin: 0 auto;"></div>	_____
Total Building Skin Conductance (add boxed-in values)			_____	<u>100</u>

* The values here may be rounded off to whole numbers, as extreme accuracy is not needed.

** Crawlspace = Ah_c (see Figure 4.1)

Slab = $F \times P$ (see Table 4.1)

Heated basement = $UA_{\text{wall above grade}} + h_b A_{\text{wall below grade}} + h_c A_{\text{floor}}$


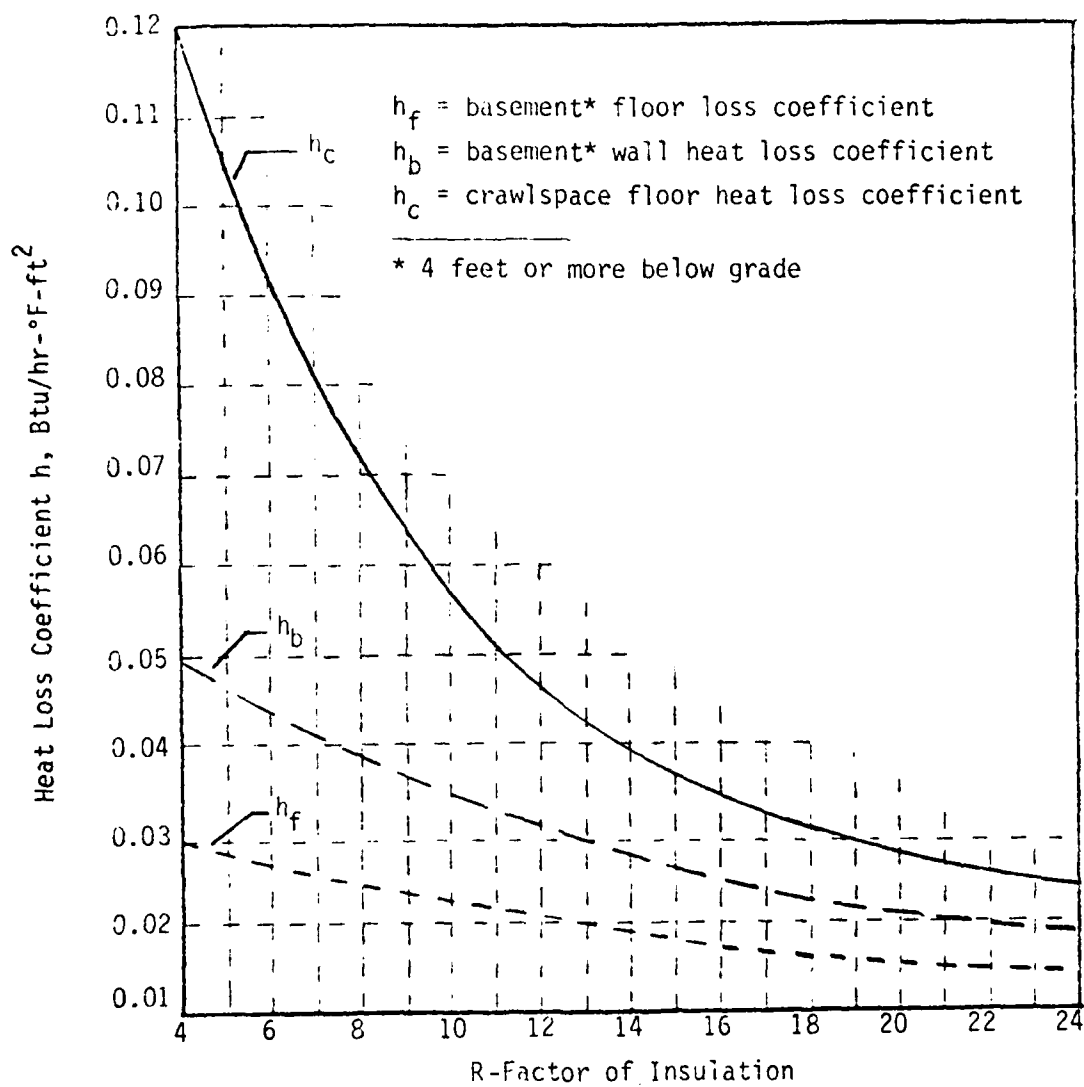


Figure 4.1 Heat Loss Coefficients for Basement and Crawlspace Heat Loss Calculations.

TABLE 4.1
Heat Loss Factors for Concrete Floor Slabs
at Grade Level per Foot of Slab Edge

Degree-Days, Zone	Depth of Insulation	F, Btu/hr-°F per ft Perimeter					
		R-12	R-10	R-8	R-6	R-5	R-2.5
A, 2500	{ 4-6 in.	0.14	0.19	0.26	0.41	0.55	1.04
B, 3500		0.13	0.18	0.25	0.39	0.52	1.00
C, 4500		0.12	0.17	0.24	0.37	0.49	0.96
D { 5500 6500 7500	24 in.	0.10	0.15	0.22	0.34	0.45	0.90

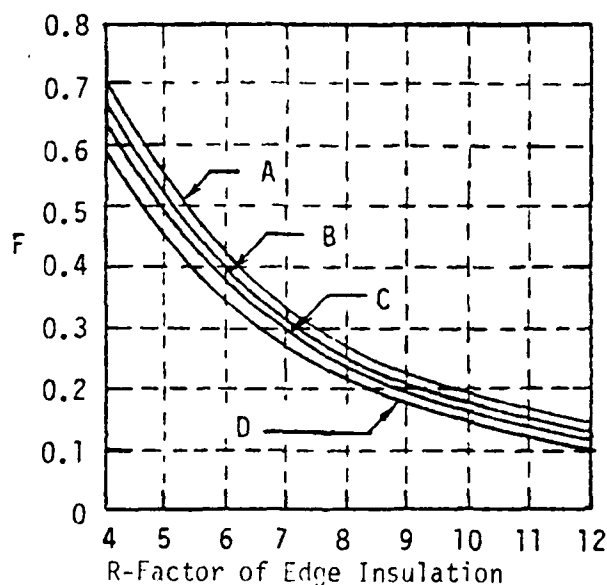

EXAMPLE: The slab heat loss for a home with a 140 ft perimeter in Zone D would be, using 3 inches of rigid polystyrene with an R-value of 3.85 per inch: (3 inches) \times (3.85) = R - 11.5 which would give an F-value of about 0.11; thus the heat loss is $140(0.11) = 15$ Btu/hr-°F. Instead, 24 in. wide and 2 in. thick polyurethane with an R-value of 5.88 per inch could have been used to get about the same heat loss. The values in Table 4.1 can be interpolated for the R-factor of the insulating material used.

TABLE 4.2
U-Values for Typical Building Construction
(for Passive Solar Houses), Btu/hr-ft²-F°

1.2	Single glass, skylights
1.1	Single glass, metal sash
1.0	Single glass (80% of window area), wood sash
0.9	4 in. solid concrete
0.8	20% double glass, 1/4 in. air space, metal sash
0.7	Double-walled plastic bubble 30% double glass, 1/2 in. air space, metal sash
	5 in. solid concrete
	Fixed double glass, 1/4 in. air space
0.6	20% double glass, 1/4 in. air space, wood sash
	Fixed double glass, 1/2 in. air space
	30% double glass, 1/2 in. air space, wood sash
	Double glass, 1 in. air space, aluminum sash with thermal break
0.5	12 in. solid concrete

(Continued)

TABLE 2 (Continued)

0.5	1-1/2 in. solid wood door
	1-1/2 in. steel door with solid polystyrene core
	30" triple glass, metal sash
0.4	1 in. common brick
	Triple glass, fixed
	30" triple glass, wood sash
	1-1/2 in. solid wood door with metal storm door
0.3	12 in. common brick
	1-1/2 in. solid wood door with 50% glass/wood storm door
	10 in. adobe, 3/4 in. stucco wall (light color)
	10 in. adobe, 3/4 in. stucco wall (medium color)
0.2	Double-glazed uninsulated Trombe wall
	Double-glazed water wall with night insulation
0.15	Double glaze with well-setting thermal shutters (depending on R-value and installation)
	20 in. adobe, 3/4 in. stucco wall
	Double glazed Trombe wall with night insulation
0.10	
	Stucco wall, 2 x 4's with R-11 insulation, 1/2 in. gypsum board
	Wood siding, 2 x 4's with R-11 insulation, 1/2 in. gypsum board
	24 in. adobe, 3/4 in. stucco wall, 1 in. foam (R-9) on exterior
	4 in. common brick veneer, R-15 insulation, 1/2 in. gypsum board
0.05	Wood siding, 2 x 6's with R-18 insulation, 1/2 in. gypsum board
	10 in. adobe, 3/4 in. stucco wall, foam (R-18) on exterior
	Wood siding or brick, R-4 board, 2 x 6's with R-19 insulation.
	Roof with R-19 insulation
0.04	Double wall of 2 x 4's (offset, 24 in. J.C.) with air gap, R-22 insulation
	24 in. adobe, 3/4 in. stucco wall, 2 in. foam (R-20) on exterior
0.03	
	Roof with R-33 insulation (depends on deck layers, reflective surfaces, additional air spaces)
0.02	
	R-60 walls
0.01	R-80 roof

TABLE 4.3 R-FACTORS OF BUILDING MATERIALS
(from Ref. [6])

Material and Description	Density (lb/ft ³)	R-Value per inch thickness	R-Value for listed thickness
Building Boards, Panels, Flooring			
Asbestos-cement board	120	0.25	--
Asbestos-cement board	120	--	0.03
Gypsum or plaster board	50	--	0.32
Gypsum or plaster board	50	--	0.45
Plywood (see Siding Materials)	34	1.25	--
Sheathing, wood fiber (impregnated or coated)	20	--	2.06
Wood fiber board	26	2.38	--
(laminated or homogeneous)	65	0.72	--
Wood fiber, hardboard type	65	--	0.18
Wood fiber, hardboard type	--	--	0.98
Wood subfloor	--	--	0.68
Wood, hardwood finish	--	--	--
3/4"	--	--	--
Building Paper			
Vapor-permeable felt	--	--	0.06
Vapor-seal, 2 layers of	--	--	--
woolen 15 lb felt	--	--	0.12
Vapor-seal plastic film	--	--	negl.
Finish Materials			
Carpet and fibrous pad	--	--	2.08
Carpet and rubber pad	--	--	1.23
Cork tile	--	--	0.28
Terrazzo	--	--	0.08
Tile (asphalt, linoleum, vinyl, rubber)	--	--	0.05
Gypsumboard	--	--	0.45
Gypsumboard	--	--	0.56
Hardwood flooring	--	--	0.68
25/32"	--	--	--
Insulating Materials			
Blankets and Battis:			
Mineral wool, fibrous form (from rock, slag or glass)	0.5	3.12	--
Wood fiber	1.5-4.0	3.70	--
Boards and Slabs:	3.2-3.6	4.00	--
Cellular glass	9	2.70	--
Corkboard	6.5-8.0	3.85	--
Glass fiber	12	3.45	--
Expanded rubber (rigid)	4.0-9.0	3.85	--
Expanded polystyrene (4-11 lb/in., 1" thickness or wire)	4.5	4.55	--
Expanded polystyrene, extruded	1.5-2.5	5.56	--
75°F	1.9	3.95	--
30°F	--	4.17	--
Material and Description	Density (lb/ft ³)	R-Value per inch thickness	R-Value for listed thickness
Expanded polystyrene molded beads	1.0	--	--
75°F	--	--	--
30°F	--	--	--
Mineral fiberboard, felted core or roof insulation	16-17	--	--
acoustical tile (are.)	11	--	--
Mineral fiberboard, molded acoustical tile	23	--	--
Wood or cane fiberboard acoustical tile	--	--	--
1/2"	--	--	--
Interior finish	15	--	--
Insulating roof deck	--	--	--
1"	--	--	--
2"	--	--	--
3"	--	--	--
Sheduled wood (cemented, prefinished slabs)	27	--	--
Longe fills:			
Macerated paper or pulp	2.5-3.5	--	--
Mineral wool	2.6-5.6	--	--
90°F	--	--	--
30°F	--	--	--
Perlite (expanded)	5.0-8.0	--	--
90°F	--	--	--
30°F	--	--	--
Vermiculite (expanded)	2.0-3.2	--	--
90°F	--	--	--
30°F	--	--	--
Sawdust or shavings	0.8-1.5	--	--
Masonry Materials, Concretes			
Cement mortar	116	--	--
Gypsum-fiber concrete (8 1/2% gypsum, 12% concrete)	51	--	--
Lightweight aggregates	120	--	--
(expanded shale, clay or slate, expanded slags, or cinders; pumice, perlite or vermiculite; cellular concretes)	100	--	--
60	--	--	--
40	--	--	--
20	--	--	--
Sand and gravel or stone aggregate (oven dried)	140	--	--
Sand and gravel or stone aggregate (not dried)	140	--	--
Stucco	116	--	--
Masonry Units			
Brick, common	120	--	--
face	130	--	--
typical value	--	--	--
Clay tile, hollow	--	--	--
1 cell deep	--	--	--
3"	--	--	--
1 cell deep	--	--	--
4"	--	--	--
2 cells deep	--	--	--
6"	--	--	--
2 cells deep	--	--	--
8"	--	--	--
3 cells deep	--	--	--
10"	--	--	--
3 cells deep	--	--	--
12"	--	--	--

Table 4.3 Continued

Material and Description	Density (lb/ft ³)	R-Value per inch thickness	for listed thickness
Concrete block, 3 oval core			
Sand and gravel aggregate	4"	--	0.71
	8"	--	1.11
	12"	--	1.28
Cinder aggregate	4"	--	0.86
	8"	--	1.11
	12"	--	1.72
Lightweight aggregate (expanded shale, clay or slate or slag, pumice)	4"	--	1.69
	8"	--	1.27
	12"	--	1.50
Concrete blocks, rectangular core	4"	--	2.00
Sand and gravel aggregate	8"	--	2.72
2 core, 36 lb*		--	1.04
Same, filled cores**		--	1.93
Lightweight aggregates	6"	--	1.65
3 core, 19 lb*		--	2.93
Same, filled cores**		--	2.18
2 core, 24 lb*		--	5.03
Same, filled cores**		--	2.43
3 core, 38 lb*		--	5.82
Same, filled cores**		--	0.08
Straw, lime or sand		0.05	--
Gravite, marble		--	2.78
foote		--	3.89
Plastering Materials			
Cement plaster, sand aggregate	116	0.20	--
Gypsum plaster			
Lightweight aggregate	45	--	0.32
Lightweight aggregate	45	--	0.39
Same, on metal lath		--	0.47
Perlite aggregate	45	--	--
Sand aggregate	105	0.67	--
Same, on metal lath		0.18	--
Same, on wood lath		--	0.10
Vermiculite aggregate	45	--	0.40
		0.54	--
Roofing Materials			
Asbestos-cement shingles	120	--	0.21
Asphalt roll roofing	70	--	0.15
Built-up roofing	70	--	0.44
Slate roofing	--	--	0.05
Wood shingles	--	--	0.94
Built-up roofing	--	--	0.33
Material and Description	Density (lb/ft ³)	R-Value per inch thickness	for listed thickness
Siding Materials			
Shingles	120	--	0.21
Asbestos-cement		--	0.19
Wood, 16" with 7 1/2" exposure		--	1.19
Wood, double 16" with 12" exposure		--	1.46
Wood, plus insulating backer board	5/16"		
Siding			
Asbestos-cement lapped	1/4"	--	0.21
Asphalt roll siding		--	0.15
Asphalt insulating siding	1/2"	--	1.16
Wood, drop (1" x 8")		--	0.79
Wood, drop (1/2" x 8" lapped)		--	0.21
Wood, level (3/4" x 10" lapped)		--	1.25
Flywood, lapped	3/8"	--	0.59
Plywood	1/4"	--	0.31
	3/8"	--	0.47
	1/2"	--	0.62
	5/8"	--	0.76
	3/4"	--	0.84
Stucco		0.20	--
Sheathing, insulating board (regular density)	1/2"	--	1.34
	25/32"	--	2.04
Woods			
Hardwoods (maple, oak)	45	0.91	--
Softwoods (fir, pine)	32	1.25	--
	25/32"	--	0.98
	1-5/8"	--	2.03
	2-5/8"	--	3.20
	3-5/8"	--	4.55
Particleboard			
Low density 37 lb/ft ³	1"	--	1.05
Medium density 50 lb/ft ³	1"	--	1.06
High density 62.5 lb/ft ³	1"	--	0.85
Wood floors			
Solid core	1"	--	1.56
	1-1/4"	--	1.82
	1-1/2"	--	2.04
	2"	--	2.33

*Weights of blocks approximately 7-5/8" high by 15 3/8" long.

**Vermiculite, perlite, or mineral wool insulation.

TABLE 4-4
R-VALUES OF AIR FILMS AND AIR SPACES
(from Ref. [6])

Type and Orientation of Air Film	Direction of Heat Flow	R-value for Air Film On:		
		Non-reflective surface	Fairly reflective surface	Highly reflective surface
Still air:				
Horizontal	up	0.61	1.10	1.32
Horizontal	down	0.92	2.70	4.55
45° slope	up	0.62	1.14	1.37
45° slope	down	0.76	1.67	2.22
Vertical	across	0.68	1.35	1.70
Moving Air:				
15 mph wind	any*	0.17	—	—
7½ mph wind	any†	0.25	—	—
Orientation & Thickness of Air Space	Direction of Heat Flow	R-value for Air Space Facing:‡		
		Non-reflective surface	Fairly reflective surface	Highly reflective surface
Horizontal 1/4"	up*	0.87	1.71	2.23
4"		0.94	1.99	2.73
3/4"	up†	0.76	1.63	2.26
4"		0.80	1.87	2.75
3/4"	down*	1.02	2.39	3.55
1-1/2"		1.14	3.21	5.74
4"		1.23	4.02	8.94
3/4"	down†	0.84	2.08	3.25
1-1/2"		0.93	2.76	5.24
4"		0.99	3.38	8.03
45° slope 3/4"	up*	0.94	2.02	2.78
4"		0.96	2.13	3.00
3/4"	up†	0.81	1.90	2.81
4"		0.82	1.98	3.00
3/4"	down*	1.02	2.40	3.57
4"		1.08	2.75	4.41
3/4"	down†	0.84	2.09	3.34
4"		0.90	2.50	4.36
Vertical 3/4"	across*	1.01	2.36	3.48
4"		1.01	2.34	3.45
3/4"	across†	0.84	2.10	3.28
4"		0.91	2.16	3.44

‡One side of the air space is a non-reflective surface.

*Winter conditions.

†Summer conditions.

TABLE 4.5

Average Window U-Values (24 Hours) and
Corresponding R-Factor of Night Insulation (14 Hours)
for Single, Double and Triple Glazing

24-Hour Average U-Value Used in Heat Loss Calculations	R-Factor of Night Insulation Used 14 Hours (incl. Air Space)		
	Single Glazing	Double Glazing	Triple Glazing
0.56	1.4		
0.52	1.6		
0.50	1.7		
0.46	2.0	0.4	
0.45	2.1	0.5	
0.44	2.2	0.6	
0.43	2.3	0.7	
0.42	2.4	0.8	
0.41	2.5	0.9	
0.40	2.6	1.0	
0.395	2.65	1.05	
0.39	2.7	1.1	
0.38	2.85	1.2	
0.37	3.0	1.35	
0.36	3.1	1.5	
0.35	3.2	1.6	
0.34	3.35	1.75	
0.33	3.5	1.9	
0.30	4.0	2.15	
0.29	4.25	2.4	1.0
0.28	4.5	2.8	
0.27	4.75	3.0	
0.26	5.0	3.25	
0.25	5.2	3.5	2.0
0.24	5.4	3.75	
0.23	5.7	4.0	
0.22	6.0	4.5	3.0
0.21	6.4	5.0	
0.20	6.9	5.5	
0.19			4.0
0.17			5.0
0.16			6.0
0.15		8.2	
0.14			7.0
0.13			8.0

TABLE 4.6
Recommended Ranges for Surface Heat Losses in Direct Gain
Passive Solar Houses (in Percent)

Surface	One-Story House	Two-Story House
Exterior Walls	20-25%	25-30%
Windows and Doors	45-50%	50-55%
Roof	10-15%	5-10%
Slab/Floor	15-20%	10-15%

If the distribution of the building skin conductance for a direct-gain building falls quite a bit outside the percentage ranges indicated in Table 4.6, the design and building specifications should be reconsidered. Can window and door openings on the east, north and west sides of the house be reduced without reducing summer ventilation or natural lighting and still comply with local building code requirements? Can the building shape be made more compact (the less wall area, the less heat is lost)? Can wall, roof, slab edge insulation be increased? Can window glass, shutter or curtain U-value be improved?

If the design includes a Trombe wall or greenhouse, the calculated values will not fit exactly into the ranges given in Table 4.6; wall losses for the walls will be higher and for windows lower for Trombe wall designs, with the opposite being true for exposed greenhouse applications. Heat loss calculations following the method here take the loss of the Trombe wall into account in finding the building skin conductance and thermal load; some other methods, such as those developed by Balcomb [7] do not. In retrofit projects, it may not be possible to bring the building's heat losses within the recommended range without a very great expenditure of money, time and trouble. For apartment houses, heat loss depends on the location of each unit, with the ground floor apartments at each end having generally the highest losses, followed by the end apartments on the top floor; interior units have the smallest losses. Heating requirements among these units can be equalized somewhat by choosing much better window night insulation for the more exposed apartments.

4.2 Calculation of Infiltration Load and Modified Building Heat Loss Coefficient C_B

worksheet 3 is used to calculate the infiltration load and the modified building heat loss coefficient. Volume is the gross floor area of the heated space times the average ceiling height. The heat capacity of air depends on altitude and is

C_p (sea level) = 0.018 Btu/ft ³ -°F	C_p (5000 ft) = 0.015 Btu/ft ³ -°F
C_p (1000 ft) = 0.0175 Btu/ft ³ -°F	C_p (6000 ft) = 0.0145 Btu/ft ³ -°F
C_p (2000 ft) = 0.0165 Btu/ft ³ -°F	C_p (7000 ft) = 0.014 Btu/ft ³ -°F
C_p (3000 ft) = 0.016 Btu/ft ³ -°F	C_p (8000 ft) = 0.0135 Btu/ft ³ -°F
C_p (4000 ft) = 0.0155 Btu/ft ³ -°F	C_p (9000 ft) = 0.013 Btu/ft ³ -°F

The infiltration load is the heat needed to warm the cold air seeping into the building through even the tiniest cracks, such as around windows, doors, and where two different building materials meet, as for example between slab and framing.

The air change per hour (ACH) is a very important parameter; unfortunately, it can only be roughly estimated. A well-built solar house with very tight windows, caulking, weatherstripping, storm doors, air lock spaces, enclosed fireplace, few vents, some berming and landscaping with wind breaks, etc., can be assumed to have from 0.3 to 0.6 ACH, depending on the amount of insulation and quality of construction. If construction cannot be closely supervised, if the house is located in a very exposed area, and if air locks have been omitted because of cost-cutting or the occupants are heavy smokers, then it is safer to assume a minimum of 3/4 ACH or more. A well-built conventional house is assumed to have an ACH = 1. An older home with sliding windows could have an ACH of 1-1/2 or more. To reduce infiltration, careful attention must be paid to areas where cold air can enter, i.e. electrical outlets and piping in exterior walls, and skylights and vents through the roof. Fireplaces should be equipped with glass screens and a fresh-air duct with damper, or air-tight stoves should be used instead.

WORKSHEET 3

CALCULATION OF INFILTRATION LOAD AND MODIFIED BUILDING HEAT LOSS COEFFICIENT C_B

$$\begin{aligned} \text{House Volume} &= \text{Gross Floor Area} \times \text{Ceiling Height} = (\quad) (\quad) = \underline{\hspace{2cm}} \\ \text{Infiltration Load} &= \text{Volume} \times C_p \times \text{ACH} \qquad \text{ACH} = \text{Air Change/Hour} \\ &= (\quad) \times (\quad) \times (\quad) \\ &= \underline{\hspace{2cm}} \text{ Btu/hr-}^\circ\text{F} \end{aligned}$$

Modified Building Heat Loss Coefficient, C_B

$$\begin{aligned} &= \left[\begin{array}{c} \text{Building Skin} \\ \text{Conductance}^* \end{array} + \begin{array}{c} \text{Infiltration} \\ \text{Load} \end{array} \right] \\ &= 24 [(\quad) + (\quad)] = 24 (\quad) \\ &= \underline{\hspace{2cm}} \text{ Btu/D.D.} \end{aligned}$$

Gross Heated Floor Area of Building = $\underline{\hspace{2cm}}$ ft²

$$\begin{aligned} C_B/A &= (\quad) / (\quad) \\ &= \underline{\hspace{2cm}} \text{ Btu/ft}^2\text{-D.D.} \qquad \text{D.D.} = \text{Degree Days}^{**} \end{aligned}$$

* From Worksheet 2.

**"Degree Days" is an indication of the "coldness" of the climate for heating calculations; the degree-day value for a particular day is the difference between the average daily outdoor temperature and 65°F; the data is usually given in monthly and yearly totals.

TABLE 4.7
Recommended Design Heat Loss Range for Passive Solar Houses

Heating Degree Day Range	C_B/A (Btu/ft ² -D.D.)
500 - 2000	5.5 - 8.0*
2000 - 4000	4.5 - 6.5
4000 - 6000	3.5 - 5.5
6000 - 8000	2.5 - 4.5
Above 8000	1.5 - 3

*Use lower values if refrigerated air conditioning will be used.

Table 4.7 is given as a checkpoint of the thermal performance of the design, to show how well the house will perform as a thermal storehouse. It has been compiled from published data on a number of passive direct gain solar houses that use only wood stoves as backup heaters. The calculated C_B/A should fall within the indicated range for passive solar homes that expect to gain over 80 percent of their heat load by solar. Values toward the lower limit within a given range of Table 4.7 should be achieved by larger houses and for locations towards the upper degree day limit within the zone. Houses with extensive uninsulated Trombe walls will have values somewhat exceeding these numbers. Note that houses with construction and insulation yielding these values will exceed FHA and TEA (1975) standards [8] by a factor of at least 2. The proposed BEPS standards, for some regions in the U.S., are even less strict than present FHA standards; as written, they do not encourage the use of passive solar. It is of course possible to do even better than these guidelines (Table 4.7); the building in this case would be extremely well-built and insulated for the particular winter climate; one should, however, investigate the cost-effectiveness and the building's summer performance (i.e. are enough openings left for efficient natural ventilation?). If the calculated C_B/A is higher than the indicated range, the building specifications (U-values, dimensions/shape) should be reviewed in terms of the design objectives. If no changes are desired at this point, the designer should proceed with the calculations; later the choice can be made to either increase solar collection if possible or decrease heat loss depending on which is more practical and economical. For massive adobe construction, the "effective U-values" as developed by the University of New Mexico [9] may be used in these calculations for the walls only, not for the windows. Retrofits may have difficulty achieving such small heat loss factors without a large

investment in added insulation. The cost-effectiveness of each case should be evaluated individually. The solution will most likely be a compromise between a somewhat higher heat loss at lower cost. Also, retrofits are usually equipped with a full-size backup, thus a larger heat loss is not as critical here as for a new passive design with just a small backup.

For the purposes of this design procedure (under this Navy contract), Table 4.8 lists heating degree days for some representative locations. More accurate local information may be available from local Chambers of Commerce. Yearly and even monthly totals can vary tremendously from one year to the next, thus using area-averaged values should be adequate to get an overall indication of the performance of the design during all but very extreme conditions. Reference [13] also lists heating degree data for many U.S. locations.

TABLE 4.8
Heating Degree Days for Warm California Navy Locations
(Source: Ref. [10])

Location	Total	J	A	S	O	N	D	J	F	M	A	M	J
Bishop	4200	-	-	-	260	580	810	880	670	540	310	150	-
Pt. Arguello	3600	200	190	160	210	290	400	480	390	400	340	300	240
Oakland	2800	-	-	-	140	310	490	540	410	360	260	180	110
Fresno, Ingokern	2500	-	-	-	80	340	580	600	400	300	150	50	-
Santa Barbara, Oxnard	2300	70	50	60	110	200	310	350	300	310	240	180	120
Bakersfield	2100	-	-	-	-	290	510	550	370	270	110	-	-
Long Beach	1800	-	-	-	-	180	290	370	300	290	220	150	-
San Diego	140	-	-	-	-	140	250	320	250	210	130	100	-

4.3 Calculation of Building Net Heating Load Profile

In this step, the modified building heat loss coefficient C_B (from Worksheet 3) is used with the heating degree day information in Table 4.8 to find the thermal load of the building. In Worksheet 4, the estimated internal heat source contribution must also be listed in order to obtain the net thermal load; approximate values are given in Table 4.9. In conventional houses, the heat from the internal sources is used to raise the temperature from the 65° base (used in the number of heating degree days) to a more comfortable 68 to 70°F and is thus not separately taken into account. In well-insulated passive solar homes internal heat sources are important in reducing the thermal load and must thus be taken into account. Many passive homes with sufficient storage are quite comfortable at 65°F. The monthly heating degree days are multiplied with the value of C_B to get the gross thermal load in million Btu/month (or MBtu/month). The internal heat contribution by people, lights and appliances is then subtracted to get the net thermal load of the building, that is the heat needed to be supplied by other sources such as solar and the backup heater.

Table 4.9
Contribution of Internal Heat Sources

300,000 Btu/month per adult per 24-hour occupancy
1,000,000 Btu/month for kitchen appliances and lights (2000 ft ² house)
200,000 Btu/month for washer/dryer if located in heated area
100,000 Btu/month for water heater if located in heated area

These figures for internal heat contribution are rough estimates; they can be calculated more accurately using ASHRAE methods [6]; however, since other assumptions such as infiltration are not that accurate (and depend on the occupants' living pattern), extreme accuracy is not needed. If an outdoor clothesline will be used frequently in the winter, this will reduce heat gain by 100,000 Btu/month. If the water heater and laundry facilities are isolated from the living space, their useful heat contribution is negligible and must thus not be included. For a very small house (or a small family) the figures for lights, appliances and water heater should be reduced; also use smaller values if the family is a very energy-conscious and careful user of energy. In estimating the internal heat contribution, caution is advised when there is any doubt about the future energy consumption pattern of the occupants.

WORKSHEET 4

CALCULATION OF BUILDING THERMAL LOAD PROFILE

Modified Building Heat Loss Coefficient C_B from Worksheet 3 = _____ Btu/D.D.

Month	Degree Days per Month	$\times C_B$	=	Gross Thermal Load, MBtu/month	-	Internal Heat Sources, MBtu/month	=	Net Thermal Load, MBtu/month
Aug.	_____	$\times C_B$	=	_____	-	_____	=	_____
Sept.	_____	$\times C_B$	=	_____	-	_____	=	_____
Oct.								
Nov.								
Dec.								
Jan.								
Feb.								
Mar.								
Apr.								
May								
Jun.								
Jul.								
MBtu = Million Btu								

5. CALCULATION OF SOLAR HEAT GAIN AND AUXILIARY LOAD

How well will the designed building perform as a solar collector? To calculate the solar heating contribution, data on average monthly solar heat gain through south-facing glazing and solar radiation on a horizontal surface (for roof pond applications) is needed. These are provided in Figures 5.2 to 5.4. Data for these figures have been assembled from a number of sources, i.e. References [10, 11, 12]. A judgment has to be made by the designer on the basis of local conditions in adjusting the average values more accurately up or down. Excellent additional climatic data for six different California climatic zones can be found in Reference [35]. Worksheet 5 must be completed for each solar heating mechanism present in the design.

5.1 Effectiveness Factor and Solar Data

To complete Worksheet 5, the net effective collector area must be determined. This is a combination of frame shading, type and number of glazings and the solar heat gain mechanism efficiency and can be calculated by using the factors listed in Table 5.1. The gross collector area (usually taken from the overall dimensions of the window) is multiplied by a frame shading factor (0.95 for the narrow sashes of fixed windows, 0.8 or less for wider wood sashes and windows with many small panes). It is assumed that window screens are removed and glazing is cleaned in the winter to allow maximum heat gain. The window (or collector) area is then additionally multiplied by the "effectiveness" factor, depending on the glazing and collecting method used, and the resulting number is listed on the top of Worksheet 5. The purpose of the "effectiveness" factor is to provide an adjustment for the efficiencies and operational characteristics of the various passive solar heat gain mechanisms, so that a single solar estimator curve can be used for the combined heat gain. The values for Trombe walls have been checked against Balcomb's work [7], those for direct gain and solar roofs against actual operating experience. The value for sunspace (a feature of more complex designs) and for roof ponds are estimates and need verification. At present, these factors can be used with a good degree of reliability in climates which have over 60 percent or more monthly possible sunshine (Figure 5.1). For climates that have considerably more cloudy days in winter, and are thus designed with less storage capability, it is recommended that the effectiveness

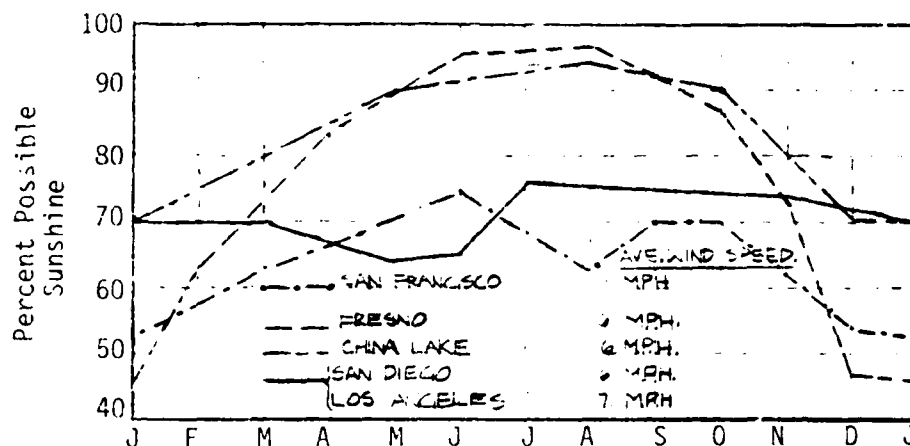


Figure 5.1 Mean Percent Sunshine Possible in Warm California Climatic Regions (averaged from data in Reference [13]).

factor be multiplied by an additional 0.90 to account for the reduced efficiency of the storage. However, using excessive amounts of storage is not advisable, because this would then reduce the efficiency of the auxiliary heating system. Additional studies will need to be made to obtain more accurate estimates of performance.

If the design incorporates an exposed greenhouse, a series of separate calculations for the greenhouse alone should be made, using Worksheets 1 through 5. The monthly heat loss of the greenhouse is subtracted from the monthly solar heat absorbed and multiplied by a factor of 0.8 if the heat distribution is easily made with large openings (windows, vents with fans, etc.). If the heat distribution is more indirect, (i.e. storage wall only) the heat gain must be reduced by a factor of 0.5 for each month. (These factors are only estimates and will need to be checked against operational data; however, they do represent a reasonable adjustment for the reduced efficiency; the resulting overall auxiliary load figures should be within the accuracy of the other input data and operating conditions, considering the large possible yearly and daily variation in the weather.) Worksheet 5A can be used to compute the adjusted net solar greenhouse heat gain.

The effect of a roof overhang can be calculated with the tables given in the following section. If the home will have an off-south (skew) orientation, mid-winter solar heat gain will also be reduced, as indicated in Section 5.3. Warm climates require that SW, SE, S and W facing walls and windows be carefully shaded with vegetation, vertical grilles, wide covered porches, etc., without blocking the summer breeze.

TABLE 5.1
Effectiveness Factors

(to adjust heat gain from different solar mechanism to
the application of a single estimator curve)

Multiply the gross window collector area by a frame shading factor of 0.80 to 0.95 depending on construction (for solar roofs and roof ponds, use the unshaded (projected) horizontal roof area instead) and by one of the following:

- 0.85 for double-glazed direct-gain windows with regular glass
- 0.90 for double-glazed direct-gain windows with low-iron glass
- 1.00 for single-glazed direct-gain windows with regular glass
- 1.05 for single-glazed direct-gain windows with low-iron glass
- 0.70 for double-glazed vented uninsulated Trombe walls*
- 0.65 for double-glazed unvented uninsulated Trombe walls
- 0.80 for double-glazed vented Trombe walls with R-9 night insulation*
- 0.75 for double-glazed unvented Trombe walls with R-9 night insulation
- 1.05 for double-glazed water walls with R-9 night insulation*
- 1.10 for single-glazed water walls with R-9 night insulation*
- 0.50 for well-insulated roof ponds
- 0.075 for dark-colored shingle or metal solar roofs
- 0.04 for medium-colored built-up solar roofs

*With optimum wall thickness of 10 to 16 inches and thermal storage of about 0.45 Btu/°F-ft² [7]

WORKSHEET 5
CALCULATION OF SOLAR HEATING CONTRIBUTION

Mechanism: _____

Net Effective Collector Area: _____ $\text{ft}^2 = A_{\text{eff}}$

$$A_{\text{eff}} = A_{\text{gross}} \times (\text{Frame Shading}) \times (\text{Effectiveness, Table 5.1})$$

Month	Solar Heat Gain from Figs. 5.2 - 5.4 $\text{Btu/Month-ft}^2 \times 10^3$ (1)	Adjustment Factors		Solar Heat Absorbed in MBtu/month $A_{\text{eff}} \times (1) \times (2) \times (3)$
		Roof Overhang from Worksheet 5B (2)	Off South Orientation: % Reduction from Sec. 5.3 (3)	
Aug.				
Sept.				
Oct.				
Nov.				
Dec.				
Jan.				
Feb.				
Mar.				
Apr.				
May				
Jun.				
Jul.				

WORKSHEET 5A

ADJUSTED NET SOLAR GREENHOUSE HEAT GAIN

Month	Solar Heat Gain Absorbed (from Worksheet 5 of Greenhouse Calculations)	Monthly Heat Loss (Net Thermal Load) from Worksheet 4 * MBtu/month	Net Heat Gain MBtu/month x Adjustment Factor ()	=	Adjusted Net Solar Greenhouse Heat Gain
Aug.	_____	- _____	= _____		_____
Sept.					
Oct.					
Nov.					
Dec.					
Jan.					
Feb.					
Mar.					
Apr.					
May					
Jun.					
Jul.					

*For greenhouse heat loss to the outside only.

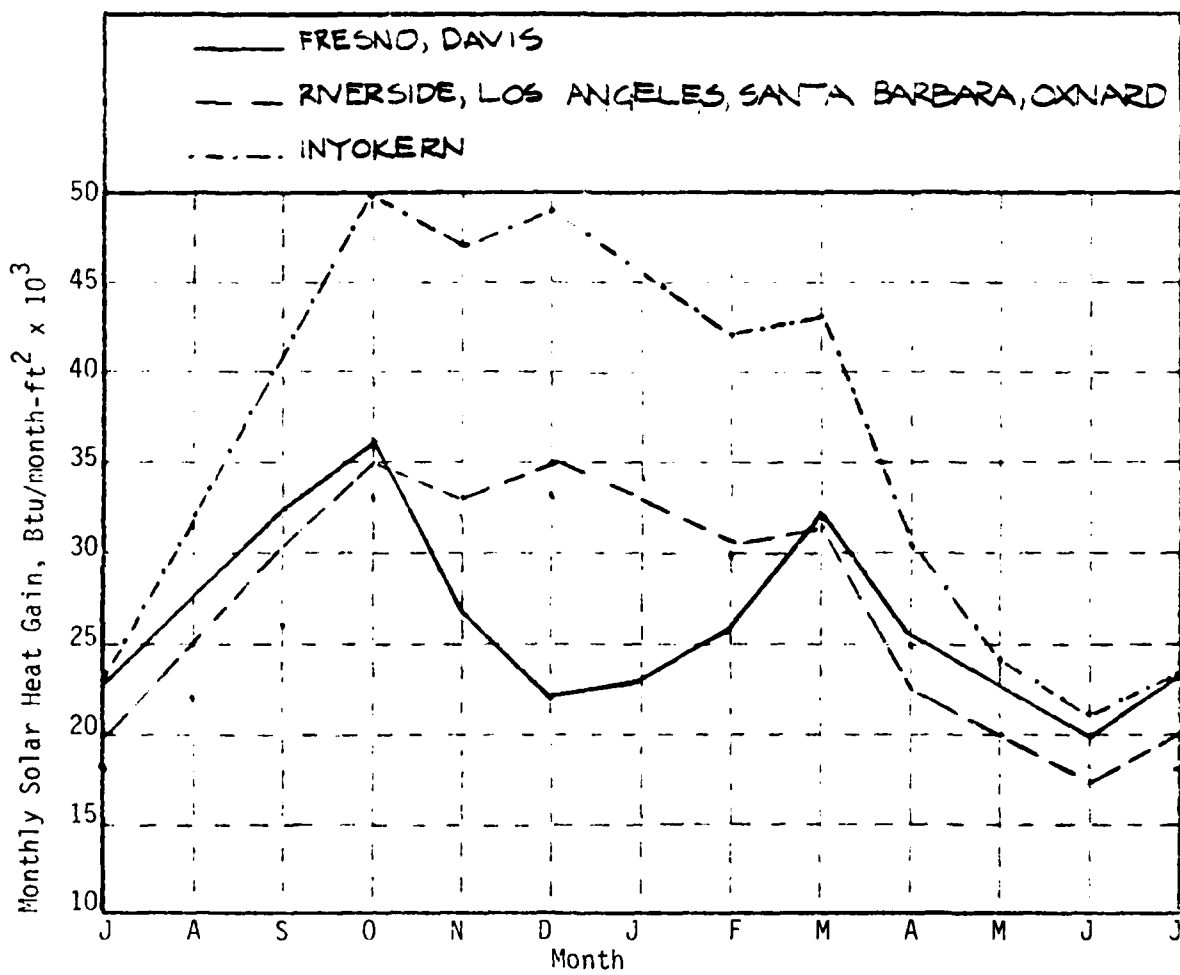


Figure 5.2 Monthly Average Solar Heat Gain Through Vertical South-Facing Single Glazing (California Locations)

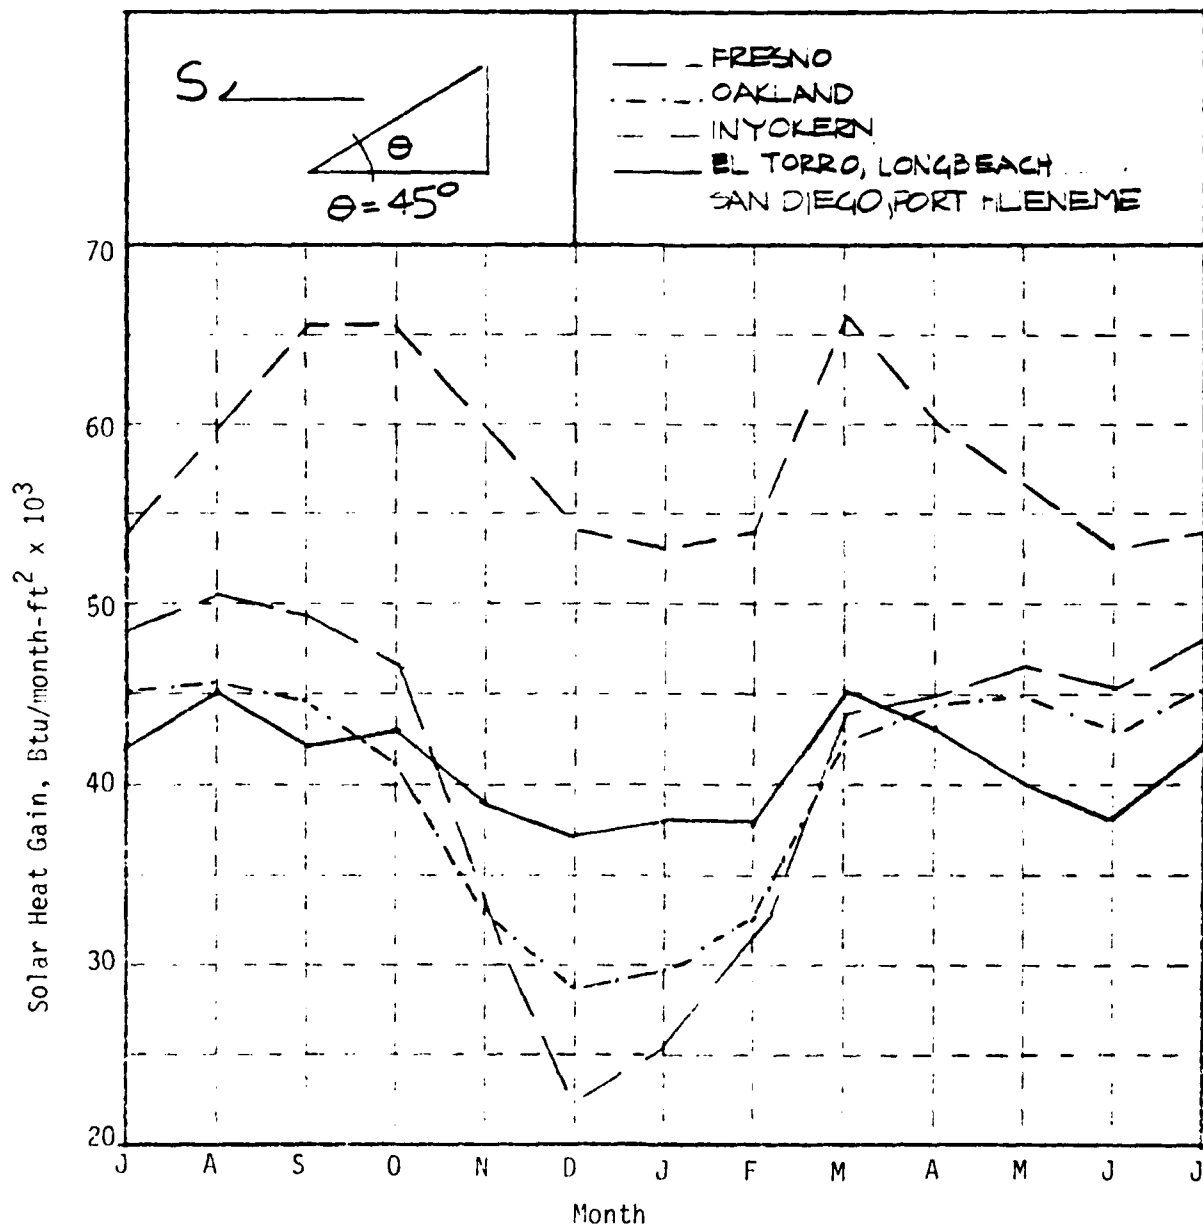


Figure 5.3 Monthly Average Solar Heat Gain Through South-Facing Single Glazing at 45° Tilt (California)

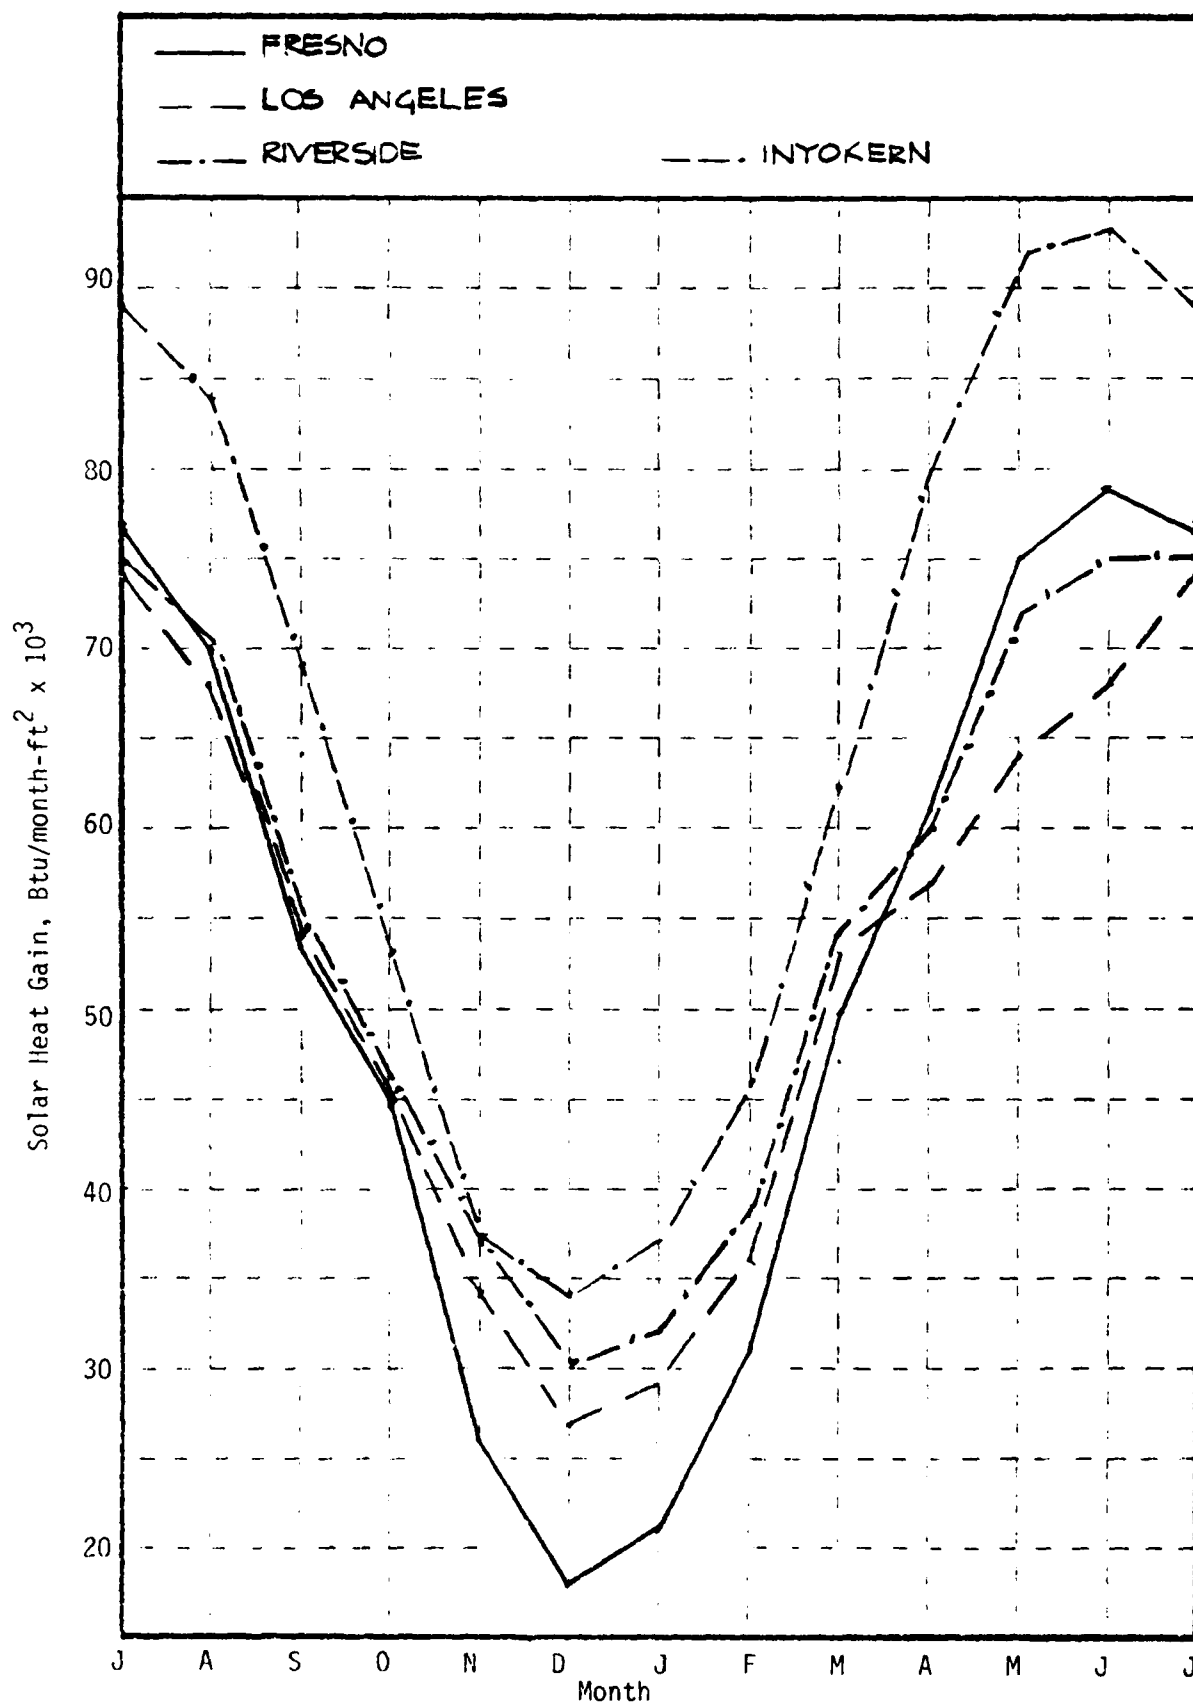


Figure 5.4 Monthly Average Solar Radiation on a Horizontal Surface (Warm California Location)

5.2 Calculations and Adjustments for Roof Overhang

In case a roof overhang is used on the south side to give summer shading, the vertical length of the shadow cast in relation to the length of the horizontal roof projection is given in Table 5.2 for the different California latitudes.

Once the overhang dimension has been tentatively decided on, it will have to be checked for winter shading by using Worksheet 5B. Table 5.3 lists the vertical length of the shadow cast per foot of roof overhang projection for different latitudes. When multiplied by the size of the overhang, the length of the shadow cast at noon is obtained and entered in Column (I). For example, at 32° N latitude, a 3 ft overhang would cast an 8.1 ft shadow in April. This illustrates how important it is to keep overhangs to a minimum in colder climates where solar heating is required into the late spring. Spring shading on south-facing vertical surfaces from a roof overhang can reduce heat gain to such an extent that more auxiliary heat will be required than in mid-winter. However, in warm climates, the overhang must be sized to prevent solar heat gain from mid-March through early November.

Shading of the window should be checked for each heating month by calculating the shadow length. If much shading occurs, the solar heat gain from Figure 5.2 used on Worksheet 5 must be reduced for those months (or the overhang should be of a folding or removable type). Since the shadow is given for the solar noon hour when it is at its maximum, it is not necessary to take its full effect into account; about two-thirds will give a better approximation over the whole day. Note that the values in Tables 5.2 and 5.3 are only valid for south orientation. The shading factor (reduction in solar heat gain) in Column (M) of Worksheet 5B is entered in Column 2 of Worksheet 5.

TABLE 5.2
Summer Shading with Roof Overhang
(Ref. [6])

Latitude (A)	Length (ft) of Horizontal Projection to Cast Shadow on South Wall from 11 April - 1 September			
	(B) 4 ft Shadow	6 ft Shadow	8 ft Shadow	10 ft Shadow
40° N Lat	2.5	3.8	5.0	6.3
36° N Lat	(C) 2.1	3.1	4.2	5.2
32° N Lat	1.7	2.5	3.4	4.2

TABLE 5.3
Winter Shading With Roof Overhang Solar (Noon)

(H) Height of Shadow Cast for Latitude per Foot of Projecting Overhang, ft			
Month	32° N Latitude	36° N Latitude	40° N Latitude
S	1.6	1.4	1.15
O	1.1	0.95	0.80
N	0.8	0.7	0.55
D	0.7	0.6	0.50
J	0.8	0.7	0.55
F	1.1	0.95	0.80
M	1.6	1.4	1.15
A	2.7	2.35	2.00
M	4.5	3.65	2.80
J	6.5		

WORKSHEET 5B
CALCULATION OF SHADING WITH SOUTH ROOF OVERHANG

- (A) Latitude of building site: _____ °N
 (B) Length of summer shadow desired: _____ ft
 (C) Size of roof overhang (projection from south wall)
 from Table 5.2 (directly or interpolated): _____ ft
 (D) Height of lower overhang edge from finished floor: _____ ft
 (E) Distance from finished floor to top of glazing: _____ ft
 (F) Vertical distance from top of glazing to roof overhang:
 (D) - (E) = _____ ft
 (G) Window or glazing height: _____ ft**

Month	Height of Shadow Cast, ft (H) x (C) = (I)	Effective Shadow Length, ft (J) = 2/3 (I)	Window Shading, ft* (K) = (J) - (F)	% Shading, (K)/(G) = (L)	Shading Factor, (M) = 1 - (L)
S					
O					
N					
D					
J					
F					
M					
A					
M					
J					

Enter Column (M) in Column 2, Worksheet 5.

* If (J) - (F) is less than zero, enter zero in Column (K).

** If window (glazing) height varies, a reasonable average can be assumed.

5.3 Influence of Off-South Orientation

In retrofit applications, the heat-gaining surfaces and glazing will not always be facing true south or nearly so. Figure 5.5 gives the percent of solar radiation striking a vertical wall, with the true south exposure receiving the monthly maximum or 100 percent (for 32°N and 36°N latitude). A linear interpolation may be made for other latitudes within this range. Note that deviations of $\pm 30^\circ$ receive about 85 percent of the mid-winter radiation; this percentage drops to 75 for the SE and SW orientation and to about 30 for E, W orientations. The percent reduction (or increase) is read from Figure 5.5 and entered in Column 3, Worksheet 5 in decimal form (i.e. 60% = 0.60). A slightly eastern orientation may be desirable where early morning heat gain is wanted and possible with climatic and topological conditions (i.e. no pattern of early morning fog or mountains to the east) and where the summer breeze is predominantly from an easterly direction. Because of the large heat gains on E and W facing walls in southern latitudes, an off-south orientation can pose a more difficult problem in the summer. Special attention will have to be paid to shading these surfaces in the summer without impeding natural ventilation. Roof overhangs are not useful in orientations more than about 20° off south, because they would have to be extremely large to be effective.

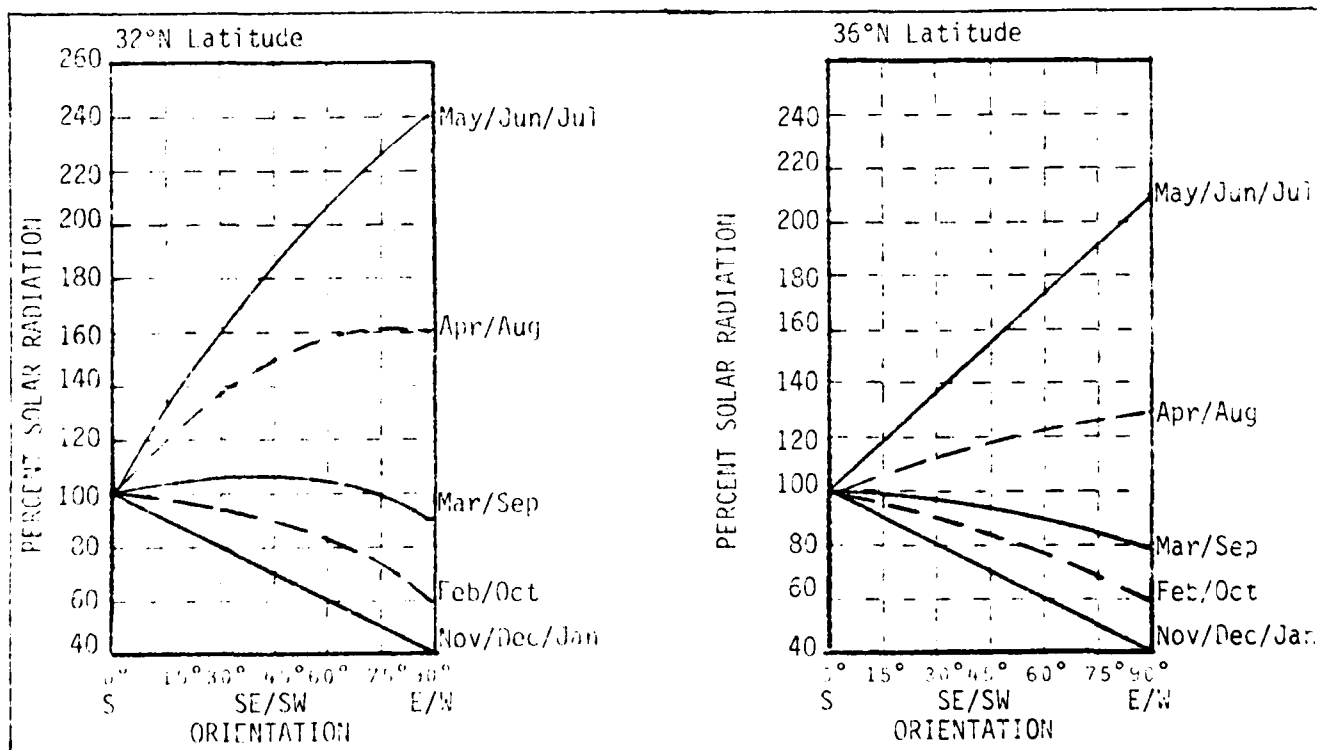


Figure 5.5 Percent of Maximum Solar Radiation Received on Vertical Walls Deviating from true South at 32° and 36° N Latitude (Ref. [6])

5.4 Spacing for Sawtooth Clearstory Window Arrangements

If south-facing clearstory windows and/or solar collectors for water heating are arranged in more than one row, the spacing between these rows must be large enough to avoid shading the second row by the first row. The formula below can be used to calculate the length of the shadow for any obstacle that may be in front of the solar glazing, be it collector or window. For comparatively narrow obstructions, the solar altitude value at noon should be used; for shading by longer rows, a value earlier in the morning should be chosen. The formula for the spacing distance is:

$$d = h / \tan \alpha$$

where d , h and α are defined in Figure 5.6. The obstacle height can be taken off the design drawings. The sun altitude angles α for December (the worst

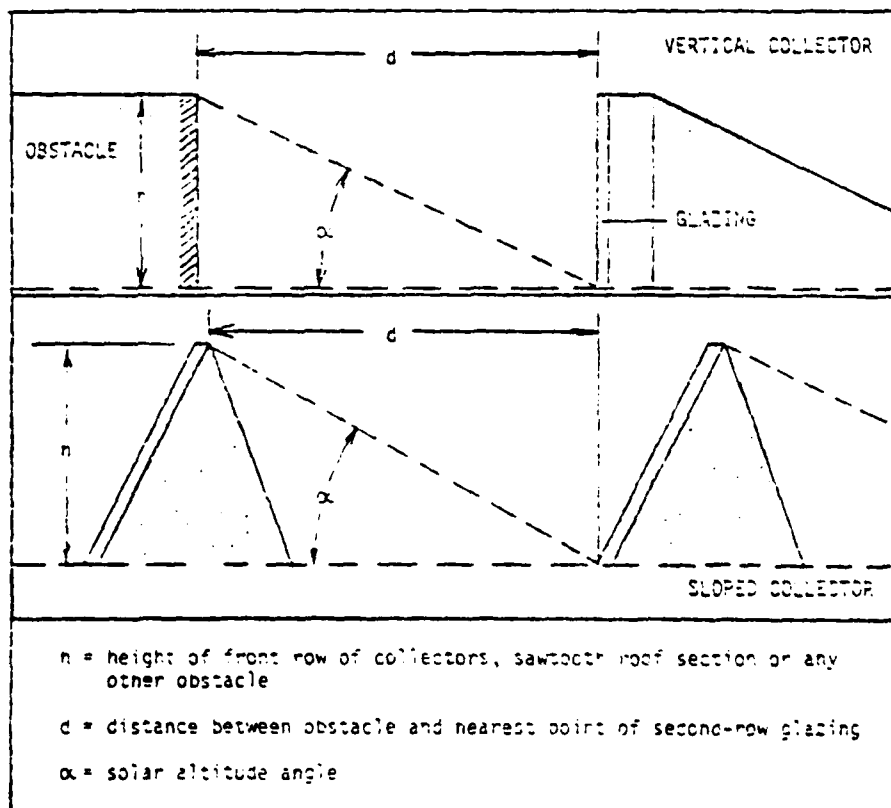


Figure 5.6 Definition of Symbols Used in Sawtooth Spacing Calculation

condition) for California latitudes and different times of day are listed in Table 5.4, together with the corresponding values for $\tan \alpha$.

For example, if the obstacle height of a long row is 6 feet, the spacing to the second-row glazing should be $d = 6/\tan 17^\circ = 6/0.31 = 19.35$ ft for a building in China Lake with no shading after 9 a.m. If this spacing distance is impractical for the design under consideration, a compromise is called for. Some shading after 9 a.m. may have to be tolerated or the clearstory windows or collectors can be raised some in the second row. If no shading after 10 a.m. would be an acceptable compromise, the spacing distance would be reduced to $d = 6/\tan 24.5^\circ = 6/0.46 = 13.0$ ft. Since this calculation was made for the month of December, any other time of the year will have less shading on the second row even very early in the morning.

TABLE 5.4
Sun Altitude Angles on 21 December for California Latitudes and
Different Times of Day, together with the Function $\tan \alpha$

Solar Time	40°N Lat		36°N Lat		32°N Lat	
	α	$\tan \alpha$	α	$\tan \alpha$	α	$\tan \alpha$
8 a.m.	5.5°	0.1	8°	0.14	10°	0.18
9 a.m.	14°	0.25	17°	0.31	20°	0.36
10 a.m.	21°	0.38	24.5°	0.46	28°	0.53
11 a.m.	25°	0.47	29°	0.55	33°	0.65
Noon	26.5°	0.50	30.5°	0.59	34.5°	0.69

5.5 Calculation of Building Auxiliary Load Profile

Worksheet 6 is used to determine the solar load ratio and ultimately the auxiliary load profile. Values for the net thermal load are transferred from Worksheet 4. The total solar heat gain for each month is the sum of all passive/hybrid absorbed solar heat figures from Worksheets 5 and the adjusted net heat gain from Worksheet 5A in the case of a greenhouse. The solar load ratio (SLR) is the total monthly solar heat gain divided by the monthly net thermal load. The solar heating fraction (SHF) is then obtained from the solar heating estimator (Figure 5.7) for the corresponding value of solar load ratio for each month. The monthly solar heating contribution is obtained by multiplying the SHF with the net thermal load. Finally, the auxiliary load profile is calculated by subtracting the solar heating contribution from the net thermal load.

Depending on the size of the house and its location, an auxiliary monthly load of 1 to 2 MBtu can easily be supplied with an efficient wood burner. Economically, it is probably not necessary to supply more than a solar heating fraction around 0.7 in the mid-winter months since the solar heat gain needed to increase the fraction above 70 percent is proportionally much larger than at lower SHF, and the added investment is most likely neither cost-effective nor necessary, since too much heat gain during the coldest months will lead to increased likelihood of overheating, especially in the fall. More importantly even, the calculated auxiliary load will occur only in the coldest years, because it is impossible to accurately take the "comfort factor" into account in these calculations. However, from experience it has been found that passively-heated homes usually feel comfortable at much lower interior air temperatures than do conventionally heated houses; thus less auxiliary heat will be needed in the actual case than is indicated by the calculations, especially for designs that incorporate some type of zoning where bedrooms would remain unheated when the auxiliary is used and for designs that incorporate a good amount of thermal mass.

It is very important in locations with cool winters to choose the auxiliary wood burner (References [14, 15]) or other backup system with great care. If a conventional system is used, it must be sized correctly for the small loads of these well-insulated houses. Reference [4] contains a discussion of auxiliary heating in New Mexico; much of the discussion also applies to conditions elsewhere. The future availability of the auxiliary energy source must be considered. Preference should be given to a renewable but non-polluting fuel.

WORKSHEET 6

CALCULATION OF BUILDING AUXILIARY LOAD PROFILE

Month	Net Thermal Load (from Worksheet 4) (A)	Total Solar Heat Gain (from Worksheet 5) (B)	Solar Load Ratio (SLR) (B) : (A) (C)	Solar Heating Fraction (SHF) (from Fig. 5.7) (D)	Solar Heating Contrib. (D) x (A) (E)	Auxiliary Load Profile (A) - (E) (F)
Aug.						
Sept.						
Oct.						
Nov.						
Dec.						
Jan.						
Feb.						
Mar.						
Apr.						
May						
Jun.						
Jul.						
TOTAL	<u> </u> <u> </u>	<u> </u> <u> </u>			<u> </u> <u> </u>	<u> </u> <u> </u>

MBtu

MBtu

MBtu

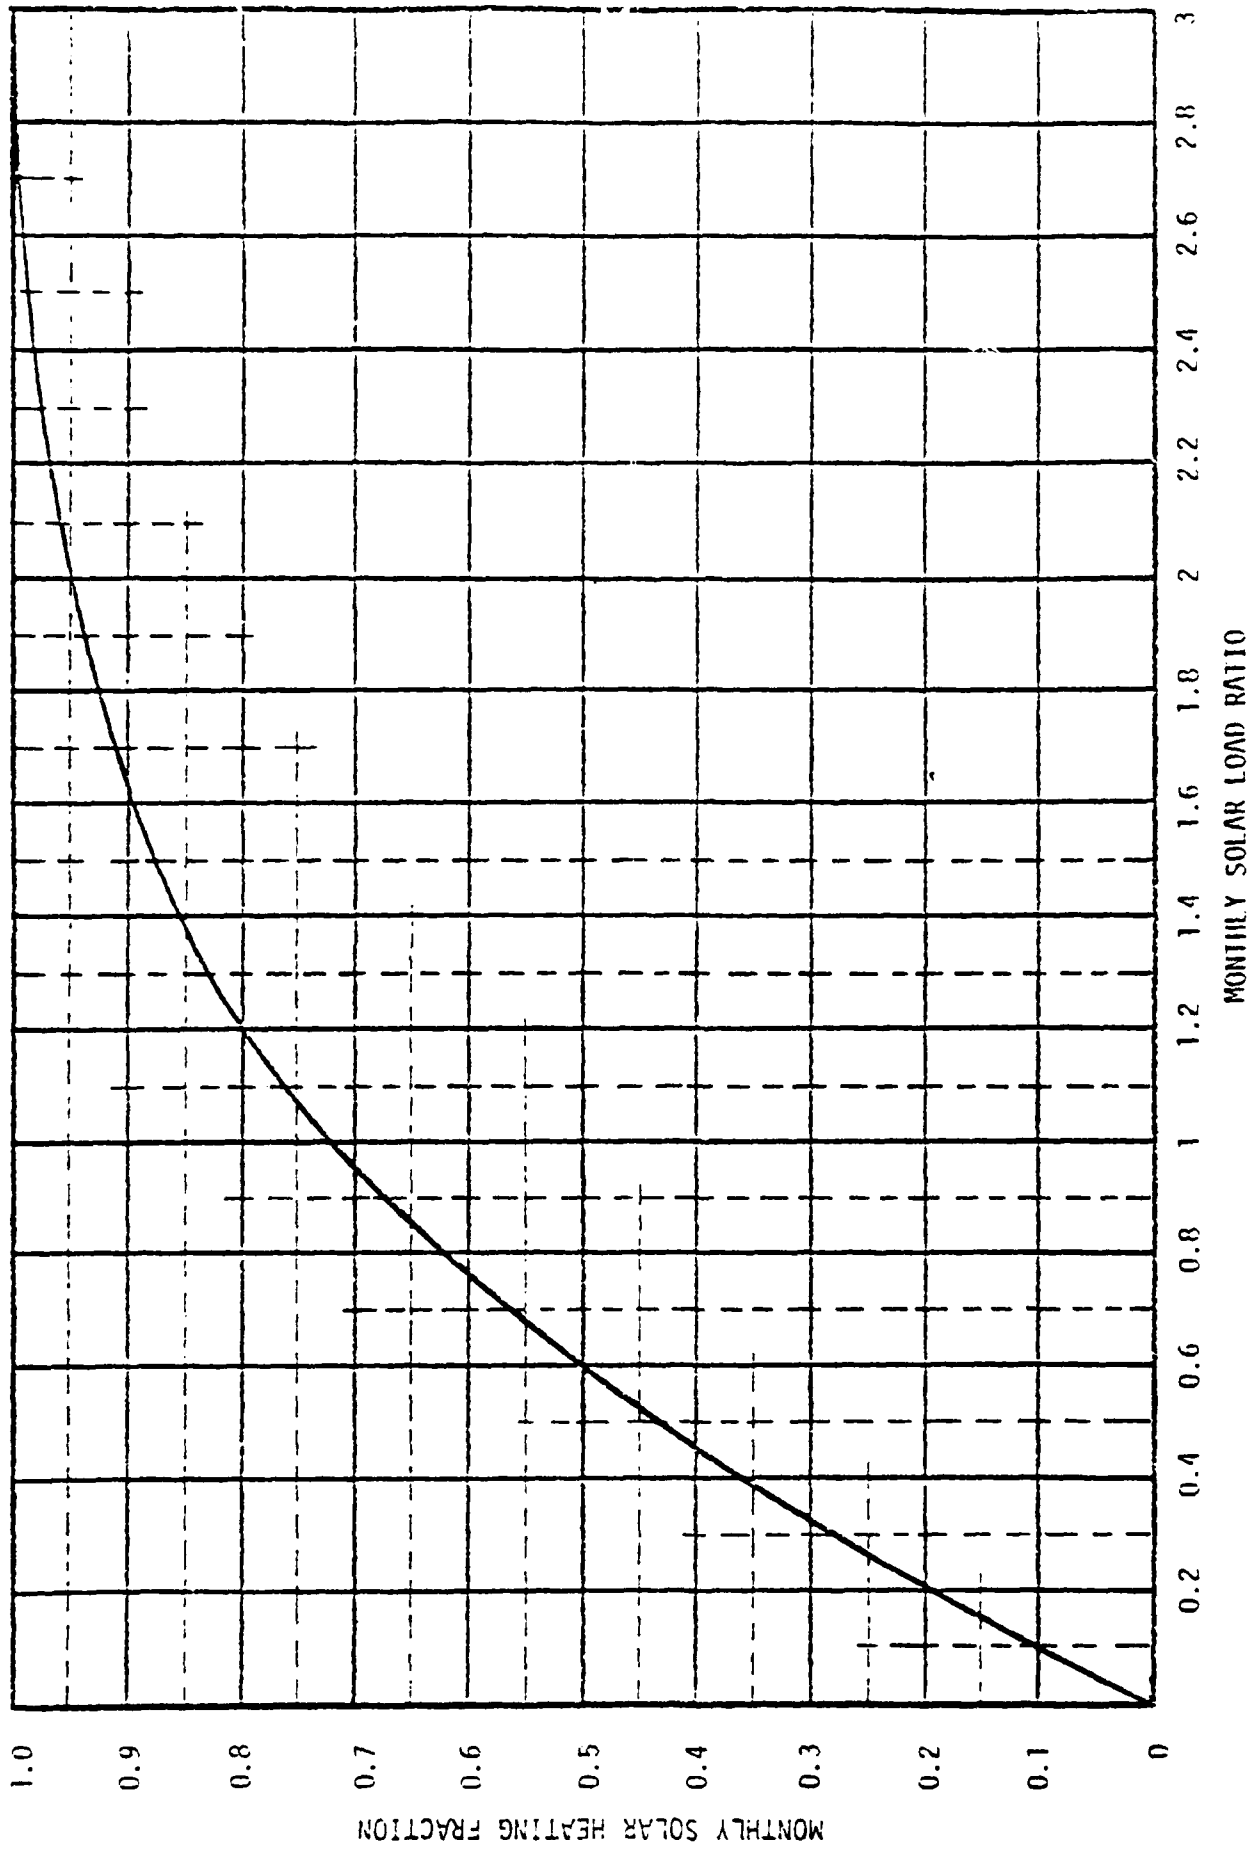


Figure 5.7 Monthly Passive Solar Heating Estimator

6. GLAZING AND STORAGE CALCULATIONS

A very rough estimate of the ratio of south-facing window area to floor area for direct gain houses is given by the following:

For cold climate, glass area/floor area = 0.2 - 0.3

For moderate climate, glass area/floor area = 0.15 - 0.25

For warm climate, glass area/floor area = 0.1 - 0.15

These values are given for houses with maximum insulation, adequate mass, good heat distribution and small auxiliary heaters. Approximately the same relationship should also hold for each solar-heated space or room; however, the location of each room and its use must be taken into consideration. For instance, kitchens with many internal heat sources will need less solar heat than living areas, and sleeping areas used only at night may also remain cooler. Reference [1] gives many additional rules of thumb for glazing and storage sizing.

The importance of good heat distribution together with an adequate amount of mass for the specific climatic conditions cannot be overemphasized. For example, south-facing rooms should not be too small and should have large door openings as well as masonry walls connecting to the north-side rooms, if they are not open areas altogether. The storage mass should have a large surface area (with a thickness from 6 to 18 inches for masonry) well distributed over the rooms. It does not have to be in direct sunlight, although the effectiveness of direct gain is increased (and less mass is required) if at least a portion of the heat storage mass receives direct sun in the mid-winter months during a good part of the day.

The amount of storage mass will determine the comfort in the house, i.e. the daily temperature swing that will be experienced and the heat loss over a completely cloudy day. Table 6.1 gives a tabulation of storage mass required per temperature swing of the storage mass and the maximum solar heat gain per day for 100 square feet of south-facing windows. For masonry walls that are not directly exposed to the sun, a temperature rise of around 5°F would be comfortable; for mass exposed to the sun, a temperature rise of 20°-25°F is not unusual. For a combination, a ΔT of 10°F maximum is a good value to be assumed for the calculations and design.

Worksheet 7 can be used to tabulate these calculations for each room. Note that the storage volume will have to be adjusted for the actual glazing in each room (net area of glass), since it is listed in Table 6.1 on the basis of a 100 square foot window area. To calculate the maximum temperature drop in the house for an average January day without any solar gain or auxiliary heating, the formula in the lower half of Worksheet 7 can be used. Values for heat capacity of storage materials are listed in Table 6.2. A calculated drop of 8°F or less is considered to be adequate for a direct-gain house in a sunny climate. A much larger drop indicates that some auxiliary heating will be required on most cloudy days. Actual performance will be better than the calculations indicate in many cases, since nights during cloudy periods have higher average temperatures than clear nights, and also because some solar radiation is received even during cloudy conditions. For a second, consecutive day, the temperature drop would be somewhat less, because this type of heat loss follows an exponential curve.

For fully exposed south-facing vertical double glazed windows in California, the maximum clear-day daily heat gain in December/January is about 1375 Btu/ft²-day. For sloped single-glazed windows and windows with reflectors, it can range up to 1750 Btu/ft²-day in February. To calculate an adequate amount of storage, determine the daily solar heat gain per square foot for the design, then choose a value for ΔT and read the volume of storage required from Table 6.1. This value must be adjusted for the room by multiplying by the south window area of the room and dividing by 100. More mass than this will give a lower ΔT . If only a small amount of space is available, water exposed to the sun directly behind the glazing will use the least volume; if space is not critical, mass walls can be used; they will supply support, ease of maintenance and soundproofing. Phase-change materials (eutectic salts) may be available commercially in the future for heat storage that will be able to store large amounts of heat in a small volume (Reference [2]).

When the design of the home has been completed, the storage mass in the building should be checked once more. If the mass is scanty (especially in areas with many clear days in the winter), the daily temperature levels in the home will fluctuate wildly; if the mass is too large (especially in areas with many cloudy days in the winter), it will be difficult to warm up the home

again after a long period of cloudy weather, and too much auxiliary heat will be diverted to recharging the storage. It will not be economical to spend money on excessive storage. In houses where solar is not expected to supply nearly the entire daily net heat load (that is, some auxiliary heating is acceptable for most days), storage can be somewhat higher; it will be useful for load management and to avoid rapid cooling in areas where supply interruptions of the auxiliary fuel are likely.

Completing Worksheets 1 through 7 with the data from the preliminary design sketches should give the designer a good idea of the expected performance of the planned passive solar building* and the influence of the different design components and their relationships. The procedure should be repeated each time changes are made and finally with the exact dimensions off the finalized blueprints and building specifications. Window dimensions especially seem to change at the last minute depending on what is available at the local supplier at a good price or in order to comply with codes when getting the building permit. The U-value of the wall and roof materials and insulation finally chosen may also vary from that assumed for the design calculations, depending on market conditions, especially if last-minute substitutions have to be made because of shortages or in a more fortunate case because an unexpected bargain becomes available. Calculations should be redone if the U-values of walls and/or roof are higher than those used in the calculations, to check if additional solar heat should be provided. On the other hand, if the U-values are considerably lower than those used in the calculations, it may be possible to reduce solar window size or relax some other design specifications as compensation. Since the heat loss of the building is very much influenced by the R-factor of window night insulation and since this component will be one of the last to be chosen and installed, adjustments can be made here if heat losses have changed because of substitutions which have arisen during the building phase.

*This will be true only if the assumptions made for the calculations are realistic and will approximate actual operating conditions (i.e. the infiltration rate achieved by construction quality and people's living habits will be close to the value used in the calculations).

WORKSHEET 7
GLAZING AND STORAGE CALCULATIONS

Room	South Glazing ft ²	Floor Area ft ²	Daily Maximum Solar Heat Gain: _____		
			Designed Storage ft ³	Storage Volume per 100 ft ² of Glazing ft ³	Temp. Swing °F
.....					
.....					
.....					
.....					
.....					
.....					
.....					
.....					
.....					
TOTAL	=====	=====	=====	=====	

Check for temperature drop during a completely cloudy day (24-hour period):

Maximum $\Delta T = \frac{\text{Net January Thermal Load}^*/31}{\text{Total Volume} \times (\text{Heat Capacity of Storage Material})^{**}}$

$\Delta T = \frac{31 \left(\frac{(\quad)}{(\quad)(\quad)} \right)}{(\quad)(\quad)} = \quad \text{°F}$

*From Worksheet 4.
**From Table 6.2.

Table 6.1

Mass Required to Store Solar Heat Gain Through Windows

Maximum Daily Solar Heat Gain Btu/ft ² -day	Temperature Swing of Thermal Mass ΔT , °F	Volume of Storage per 100 sq. ft. of Window Area		
		Water ft ³	gal.	Concrete ft ³
500	5	160	1200	415
	10	80	600	210
	15	55	400	140
	20	40	300	105
	25	30	225	85
750	5	240	1800	625
	10	120	900	315
	15	30	600	210
	20	60	450	155
	25	50	375	115
1000	5	320	2400	830
	10	160	1200	420
	15	110	825	280
	20	80	600	210
	25	60	450	170
1250	5	400	3000	1050
	10	200	1500	520
	15	130	1000	350
	20	100	750	260
	25	80	600	210
1375	5	440	3300	1150
	10	220	1650	585
	15	145	1100	385
	20	110	825	285
	25	90	675	230
1500	5	480	3600	1250
	10	240	1800	630
	15	160	1200	420
	20	120	900	310
	25	100	750	250
1750	5	560	4200	1460
	10	280	2100	730
	15	190	1425	490
	20	140	1050	360
	25	110	825	290

TABLE 6.2

Heat Transfer Characteristics of Masonry Storage
Materials Compared to Water, Wood and Steel

Material	Specific Heat Btu/lb-°F	Density lb/ft ³	Heat Capacity Btu/ft ³ -°F	Conductivity Btu-in. hr-°F-ft ²
Adobe	0.22	90-105	20-23	4
Brick	0.21	110-130	23-27	5
Brick with mag- nesium additive	0.2	120	24	26
Concrete (Stone, Sand)	0.16	140	22	12
Concrete (Cinder Block)	--	80	--	2.5
Gravel (30% voids)	0.21	115	24	2.6
Earth	0.21	95	20	6
Pumice	--	49	--	1.3
Sand	0.2	100	20	2
Stone	0.2	165	33	11-12
Steel	0.12	490	59	310
Wood	0.6	30	18	0.8-1.1
Water	1.0	62.4	62.4	4

7. ENERGY SAVINGS CALCULATIONS

Since many people are not only interested in knowing how much auxiliary energy will need to be expended to heat the designed building, but also in how much energy is saved (in order to calculate the cost-effectiveness of the passive method), a brief discussion of the topic is included here. Unfortunately, the problem is rather complex, since results depend on the performance calculation method used [16] and on the design of a "reference" building. Since a passive design is a combination of very good insulation, sufficient storage mass and correct choice and placement of heat-gaining windows, walls, roofs and spaces, it is very difficult to determine what the conditions would have been for a "similar" building but without passive heating. Would such a building still have the same shape, orientation, roof line, volume, size, floor plan, etc., since these were to a very large extent chosen with passive heat gain in mind? Thus, for the sake of simplicity and uniformity, it is proposed here that the minimum U-values for the building's design be used as specified in the local building code. Also assumed are a standard ceiling height of 8 feet unless the reference building would definitely have been designed with a different ceiling height. A square floor plan with windows 10 percent of the floor area and distributed equally in all four directions is assumed also, if the passive solar building has a rectangular shape. If the passive house has a more complicated floor plan, the same shape should be assumed for the reference building but with windows distributed equally in all 4 directions. The main reason for these assumptions is that up to now buildings on the whole have been oriented with complete disregard to solar gains, so that on an average, just as many windows and building orientations are found in each direction.

Worksheet 8A can then be completed in a manner similar to the calculation procedure for passive houses, though the computations are somewhat simplified. The same values for heating degree days and solar heat gain should be used as in the passive computations. Internal heat gain is not subtracted in conventional houses, since it is assumed that this heat will help raise room temperatures from the 65°F design temperature to a more comfortable 70°F or so, in contrast to many passive solar homes which are quite comfortable at 65°F air temperature. Effective window area for south-window solar gain is calculated in the same way as for the passive design and then multiplied by

one half, since some of these windows may be shaded. The auxiliary load of the solar design from Worksheet 6 can then be compared with the heating load of the reference building.

On Worksheet 8B, the heating load of the reference building from Worksheet 8A is listed first. Subtracted from this is the auxiliary load of the passive design, as calculated on Worksheet 6. This will give the heat saved in MBtu by using the passive design. If the passive design uses fans and other motorized equipment, these power requirements will have to be subtracted from the gross heat saved to get a true picture of the real savings between the two buildings. This power usage is usually obtainable in kWh; for conversion to MBtu, it must be multiplied by 0.0034 before it is listed on Worksheet 8B.

The energy savings depend on the fuel that is being replaced by solar. Energy savings can be calculated for the most commonly available energy source in the area or for all of them. The results of course will only reflect savings based on the current price of these fuels. Solar energy is neither subject to price escalation nor inflation once the equipment is installed or the structure is built. With the steep increases in the cost of fossil fuels, the savings due to solar can be expected to increase dramatically if considered over the life of the structure (which can be as much as 50 years or more for a well-built house). In order to express the cost per unit energy in dollars per million Btu, the cost is multiplied with a conversion factor (which also includes a multiplier for efficiency).

For example, if electricity were to heat the reference building, the cost in cents/kWh is multiplied by 2.93 to get the cost in \$/MBtu (since 1 MBtu = 293.1 kWh) and by the net energy saved to get the total monthly savings in dollars.

If gas is assumed to be the fuel for heating the reference building, the net heat saved is multiplied with the cost of gas (\$/MCF) times 1.7 to take burner efficiency into account. Natural gas is sold in units of MCF (a quantity of one thousand cubic feet). One MCF of gas has a heat content of around 1 MBtu. At present, most utilities have a sliding price scale for their energy sales; this means that large users pay less per unit than do small users. Thus it

WORKSHEET 8A
CALCULATIONS FOR REFERENCE BUILDING

Building Location: _____ Zone: _____
 Floor Area: _____ ft² = (_____ ft)²; Perimeter = _____ ft;
 S. Window Area = (0.1)(A)÷4 = _____ ft²;
 Effective Window Area = ½()()() = _____ ft²

Building Skin Conductance (Btu/hr-°F):

Total Walls:	U-Value x Area = ()x() = _____
Total Windows and Doors:	U-Value x Area = ()x() = _____
Roof:	U-Value x Area = ()x() = _____
Floor: (See Section 4.1)	U-Value x Area = ()x() = _____

TOTAL

Infiltration: Volume x C_p x ACH = () x () x 1 =

Modified Building Heat Loss Coefficient C_B

= 24 (Skin Conductance + Infiltration) = 24[(+)] =
 C_B/A = Btu/D.D.-ft²

Heat Load Calculations(MBtu): Gross Heating Load minus Solar Heat Absorbed is equal to Net Heating Load

Month	Degree Days	Gross Heating Load	Solar Gain	Solar heat Absorbed	Net Heating Load
Aug.					
Sept.					
Oct.					
Nov.					
Dec.					
Jan.					
Feb.					
Mar.					
Apr.					
May					
Jun.					
Jul.					

WORKSHEET 8B
HEAT SAVINGS CALCULATIONS FOR PASSIVE DESIGN*

Month	Reference Bldg. Heating Load	Passive Solar Building Aux. Load	Gross Heat Saved	Parasitic Power (See Foot- note), kWh x 0.0034	Net Energy Saved	<u>Cost of Energy Saved:</u> ELECTRICITY: cents/kWh x 2.93 GAS: \$/MCF x 1.7 ** OIL: \$/gal x 14.4 *** WOOD: \$/cord x 0.11 **** = _____ \$/MBtu x Net Savings =			
	MBtu/mo.	MBtu/mo.	MBtu	MBtu	MBtu	\$			
						EL	GAS	OIL	WOOD
Aug.	() -	() =							
Sept.									
Oct.									
Nov.									
Dec.									
Jan.									
Feb.									
Mar.									
Apr.									
May									
Jun.									
Jul.									
TOTAL									

*Does not include savings for solar water heating (or summer cooling).

**60% efficiency.

*** 1 MBtu = 7.2 gal. heating oil, 50% efficiency.

****Average of 20 MBtu per cord of wood depending on type [15] and 45% efficiency.

Add electricity needed to run the conventional furnace; subtract the electricity needed to operate fans in the passive design.

may be somewhat difficult to obtain exact quotes for gas prices per MCF for these calculations. The situation is somewhat similar for electricity costs also. If you have recent utility bills at hand, you may calculate an average price from these. Do not forget to include taxes and any charges for fuel cost adjustments included on the bill. The last column in Worksheet 8B then represents the savings in an average heating season with present energy prices. At present, gas prices in many areas are still relatively low (and the savings correspondingly small); this situation, however, can change rather quickly once natural gas prices become deregulated. Electricity is expensive, because it is a secondary energy source which has been generated from a primary source (gas, oil, hydro, wind, nuclear, coal etc.). This conversion, when using fossil fuels, is only about 30% efficient. Electricity is also a high-temperature, high-quality energy source, and its use for heating is in most cases not appropriate, unless it is generated from a renewable source such as a wind machine and its supply is abundant and reliable.

In California, additional energy savings (and these can be considerable) can be obtained by employing passive cooling methods which reduce the need for refrigerated air conditioning in addition to a solar water heating system.

The following two brochures are an excellent reference for California passive solar designs, since they contain detailed discussion of regional climatic data and design examples.

California Energy Commission, California Passive Solar Design Competition, Governor's Office of Appropriate Technology, 14 March 1979.

California Energy Commission, Solar Gain: Winner of the Passive Solar Design Competition, Governor's Office of Appropriate Technology, February 1980.

Since energy prices are expected to double in another ten years or less, it can be seen that total savings will increase in future years to make the passive design even more worthwhile. To this, add the benefit of a healthier environment (inside and outside the house and in the community), possibly less

maintenance and less noise because of the mass, a longer life for the building because of its quality construction, and federal* and state** solar tax rebates, and it can be seen that even with somewhat higher construction costs the well-designed and well-built passive building will be an excellent investment indeed. The passive house will also be (and feel) so much warmer, especially since people in conventional homes are turning their thermostats down to save energy and money.

If you have difficulties with this calculation procedure, it may be helpful if you could attend a solar workshop which is held periodically in different cities around New Mexico; these workshops are sponsored and taught by the New Mexico Solar Energy Institute in cooperation with the New Mexico Solar Energy Association (NMSEA). It may also be helpful for you to study a complete example design together with completed worksheets. A separate brochure describing the available example designs is available from the New Mexico Energy Institute, Box 3SEI, New Mexico State University, Las Cruces, NM 88003 (Report NMEI 22-2). It would be best to study a design which most nearly corresponds to your own climatic region and features the passive solar methods you are considering for your own design. If your design incorporates a Trombe wall or greenhouse, attending a hands-on workshop conducted by the New Mexico Solar Energy Association in Santa Fe or its affiliated local societies is highly recommended. or similar workshops may be held by solar societies in your area. A completed set of worksheets is attached in the Appendix, giving the calculations for a direct-gain passive solar home in California (2500 H.D.D.).

*Federal legislation now in Congress may soon allow tax rebates for the passive components of a building.

**State solar tax rebates vary from state to state. Some counties and municipalities may also have special benefits for solar construction, i.e., exemptions from sales tax, property tax, etc.

NOTES:

BLANK PAGE

REFERENCES

1. E. Mazria, The Passive Solar Energy Book, Rodale Press, Emmaus, PA, 1979.
2. P. F. Kando, "Eutectic Salts," Solar Age, Vol. 3, No. 4, April 1978, pp. 15-16, 40.
3. Jeffrey Cook, Cool Homes for Desert Suburbs, Arizona Solar Energy Commission, 1700 W. Washington, Phoenix, Arizona 85007, June 1979.
4. Monika Lumsdaine, Passive Solar House Designs for New Mexico Climates, Part I Design Manual, NMEI Rpt. 22-1, New Mexico Solar Energy Institute, New Mexico State University, Las Cruces, NM 88003, 1980.
5. David A. Robinson, "The Art of the Possible in Home Insulation", Solar Age, Vol. 4, No. 10, Oct. 1979, pp. 24-32.
6. ASHRAE (American Society of Heating, Refrigeration and Air Conditioning Engineers), Handbook of Fundamentals, 1972 (or later, revised editions).
7. J. Douglas Balcomb and R. D. McFarland, "A Simple Empirical Method for Estimating the Performance of a Passive Solar Heated Building of the Thermal Storage Type," Proceedings of the 2nd National Passive Solar Conference, American Section of ISES, Philadelphia, PA, 16-18 March 1978, Vol. II, pp. 377-389.
8. Bruce Anderson, Solar Energy Housing Design in Four Climates, Total Environmental Action, Harrisville, NH, 1975.
9. W. J. Van der Meer, "Effective U Values," NMEI Report #76-161A, University of New Mexico, July 1977.
10. SOLARON Application Engineering Manual, Solaron Corporation, 720 S. Colorado Blvd., Denver, CO 80222, October 1978.
11. Douglas Roberts, New Mexico Solar Energy Institute, Computer Program "Gain", 1978.
12. T. Kusuda and K. Ishii, "Hourly Solar Radiation Data for Vertical and Horizontal Surfaces on Average Days in the United States and Canada," NBS Building Science Series 96, U. S. Dept. of Commerce, National Bureau of Standards, April 1977.
13. Climatic Atlas of the United States, U.S. Department of Commerce, June 1968.
14. The Woodburners Encyclopedia, Vermont Crossroads Press, Waitsfield, Vermont 05673, 1976.
15. Mary Twitchell, Wood Energy, Garden Way Publishing, Charlotte, Vermont 05445, 1978.
16. L. Palmiter and B. Hamilton, "A Comparison of Performance Factors for Passive Solar Heating," Southwest Bulletin, New Mexico Solar Energy Association, Vol. 4, No. 1, January/February 1979, pp. 18-22.

ADDITIONAL RECOMMENDED READING

17. Rick Fisher and Bill Yanda, Solar Greenhouse, John Muir Publications, Santa Fe, NM 87501, 1976.
18. D. A. Bainbridge, "Water Wall Passive System - For New and Retrofit Construction," Proceeding of the 3rd National Passive Solar Conference, American Section of ISES, San Jose, CA, 11-13 January 1979, pp. 473-478.
19. Stephen Weinstein, Architectural Concerns in Solar System Installations, Prepared for the Department of Energy under Contract No. E-77-C-01-2522; available from National Technical Information Service, U. S. Department of Commerce, 5285 Port Royal Rd., Springfield, Virginia 22161 (Solar/0801-79/01, Distribution Category UC-59).
20. James L. Easterly, Engineering Concerns in Solar System Design and Operation, prepared for the Department of Energy under Contract No. EG-77-C-01-2522; available from National Technical Information Service, U. S. Department of Commerce, 5285 Port Royal Rd., Springfield, VA 22161 (Solar 0511-79/01, Distribution Category UC-59).
21. Franklin Research Center, Installation Guidelines for Solar DHW Systems in One- and Two-Family Dwellings, Contract H-2377, Report HUD-DR-407, Superintendent of Documents, U. S. Government Printing Office, Washington, DC 20402, April 1979.
22. Sunset Books, Homeowner's Guide to Solar Heating, Lane Publishers, Menlo Park, California, 1978.
23. Bruce Anderson and Michael Riordan, The Solar House Book, Chesire Books, Harrisville, New Hampshire, 1976.
24. Bruce Anderson, Solar Energy: Fundamentals in Building Design, McGraw-Hill, New York, 1977.
25. D. Wright, Natural Solar Architecture, Van Nostrand Reinhold Co., New York, 1978.
26. A Survey of Passive Solar Buildings, AIA Research Corporation, Stock No. 023-000-00437-2, Superintendent of Documents, Government Printing Office, Washington, DC, 20402, \$3.75, February 1978.
27. In The Bank--or Up the Chimney, Abt Associates, Inc.; Stock No. 023-000-00411-9, Superintendent of Documents, U. S. Government Printing Office, Washington, DC, 20402, 1977, \$1.70. (Information on insulation.)
28. William A. Shurcliff, New Inventions in Low-Cost Solar Heating (100 Daring Schemes Tried and Untried), Brick House Publishing Company, Harrisville, NH, 03450, 1979.
29. Dan Scully, Don Prowler, Bruce Anderson, The Fuel Savers, A Kit of Solar Ideas for Existing Homes, Brick House Publishing Company, Harrisville, NH 03450, 1978.

30. Norah D. Davis and Linda Lindsey, At Home in the Sun, Garden Way Publishing, Charlotte, Vermont, 05445 (paperback), 1979. (This book is about solar home living experience, including performance and cost.)
31. William A. Shurcliff, Thermal Shutters and Shades: Over 100 Schemes for Reducing Heat Loss through Windows, Brick House Publishing Co., Inc, Andover, Mass., 1980.
32. Passive Solar Design Handbook, Vol. 1 (Bruce Anderson): Passive Solar Design Concepts; Vol. 2 (Doug Balcomb et al.): Passive Solar Design Analysis, DOE-0127 US 59, 1980. Available from National Technical Information Service, U. S. Dept. of Commerce, 5285 Port Royal Road, Springfield, Virginia 22161. Cost: \$13.25 for Vol. I, \$14.00 for Vol. II.
33. William A. Shurcliff, Superinsulated and Double Envelope Homes: A Preliminary Survey of Principles and Practice, 1980. Available from the author, 19 Appleton Street, Cambridge, Mass., 02138, \$10 (payment enclosed), \$12 (billed).
34. Randy Sweat, "Natural Cooling Techniques - an Overview," Southwest Bulletin, (Sun Paper), New Mexico Solar Energy Association, Vol. 5, No. 3, March 1980, pp. 6-8.
35. California Energy Commission, California Passive Solar Design Competition, Governor's Office of Appropriate Technology, 14 March 1979.

ADDITIONAL SOURCES OF INFORMATION

National Solar Heating and Cooling Information Center toll free
P. O. Box 1607, Rockville, MD 20850 1-800-523-2929

(U.S.) Solar Energy Research Institute (SERI) (303) 231-1000
1536 Cole Boulevard
Golden, CO 80401
(D.O.E. - funded research)


Solar Lobby (202) 466-6350
1001 Connecticut Avenue, NW, 5th floor
Washington, DC 20036
(political action group concerned with solar
legislation at the federal level)

Solar Age Magazine, Solar Products Specifications Guide, Solar Vision Inc.,
Harrisville, NH 03450, (6 updates per year, \$100).


BLANK PAGE

APPENDIX


DESIGN AND CALCULATION EXAMPLE FOR CALIFORNIA CLIMATE

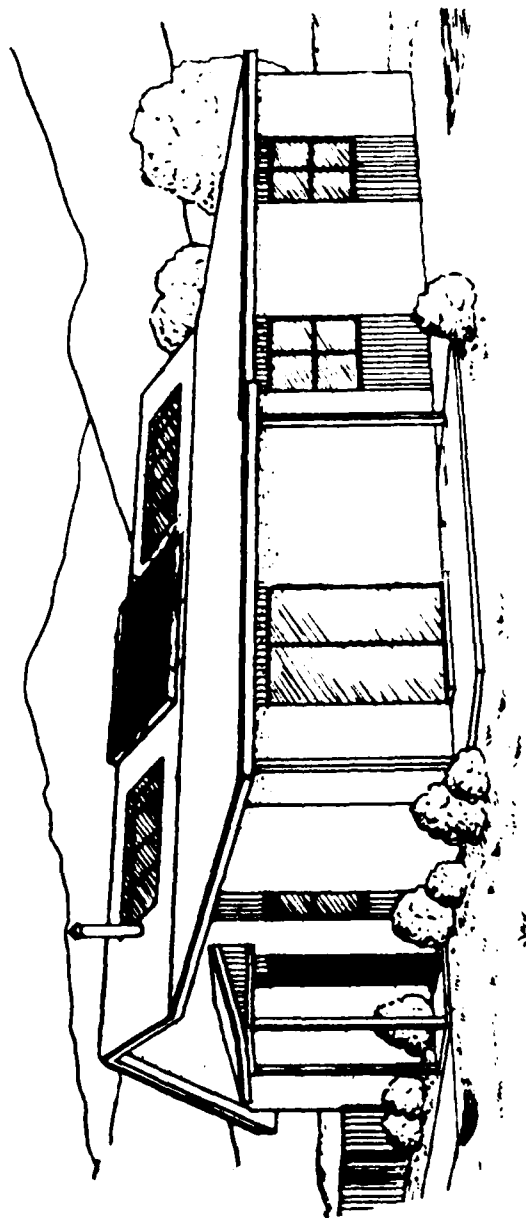

CASA AMANDA II

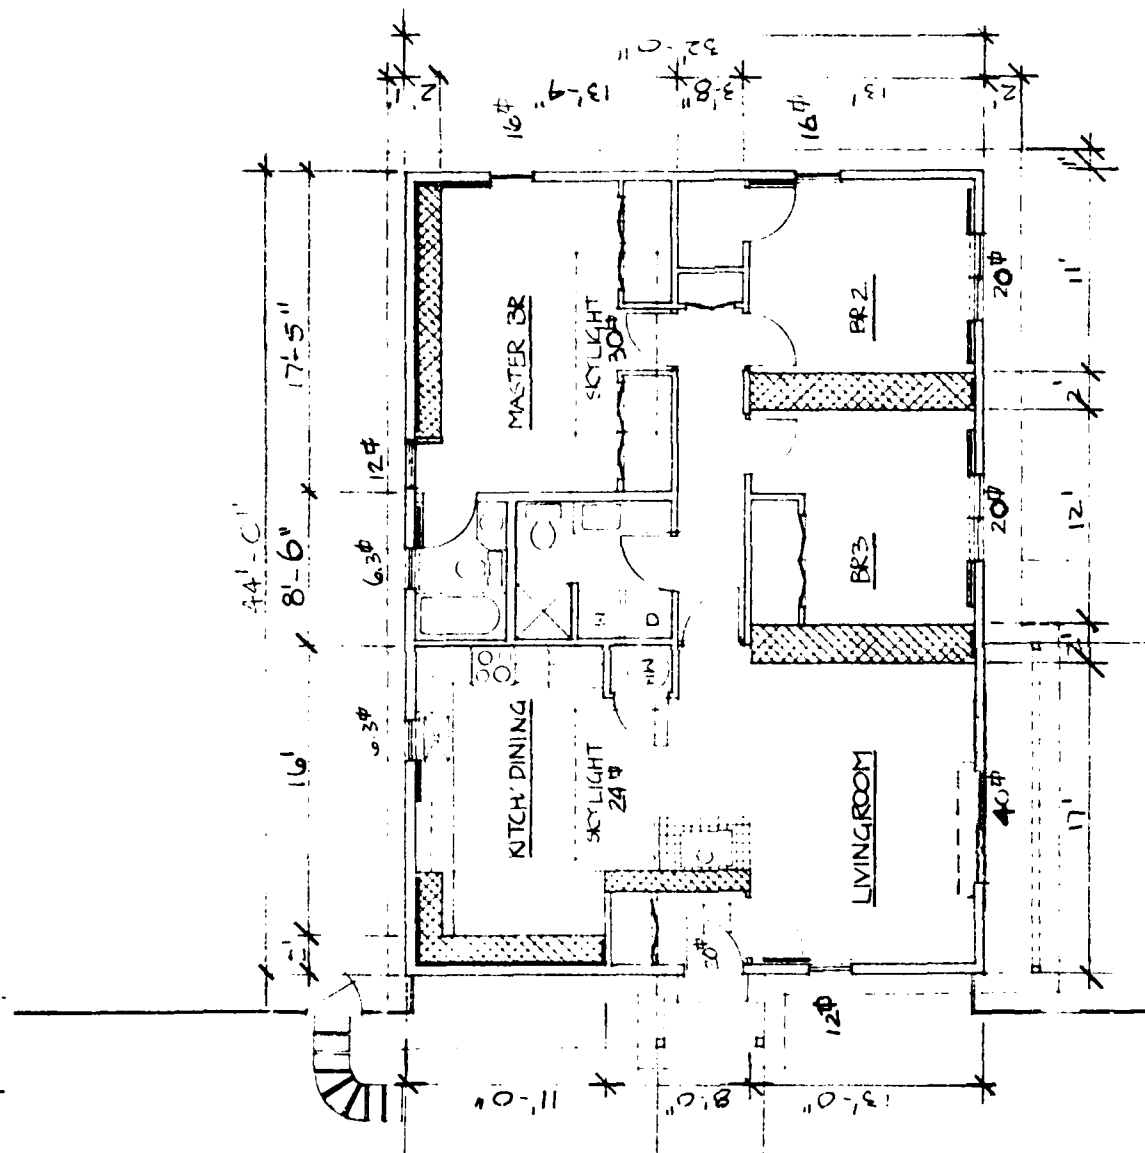

CASA AMANDA II

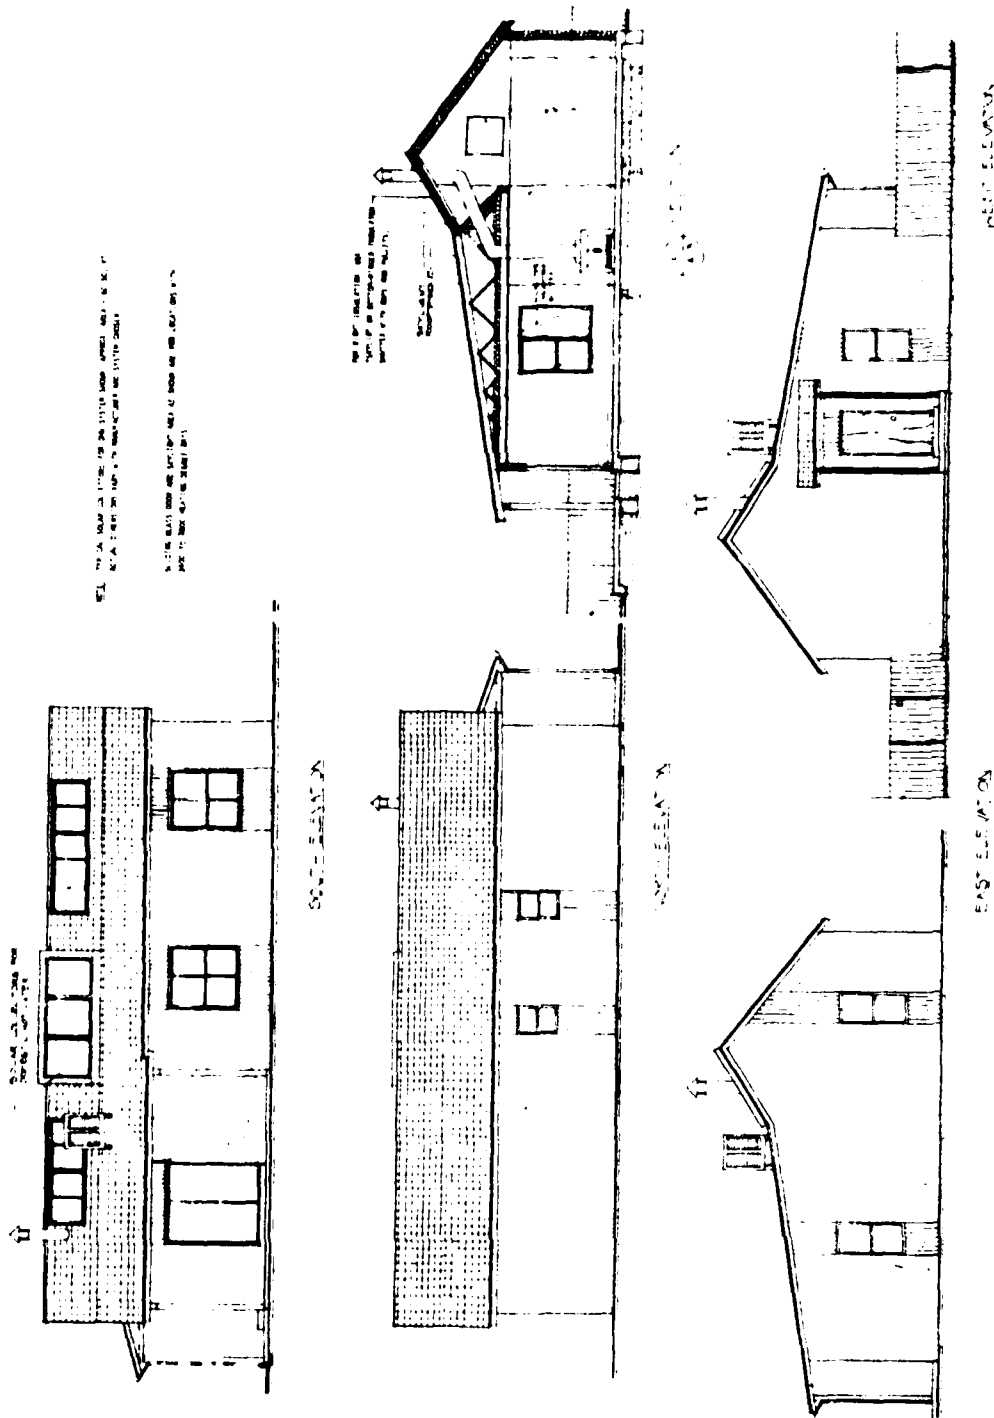

CASA AMANDA II

WORKSHEET 1A
DESIGN INFORMATION

CASA AMANDA II

1. Location of building: PORT HUENEME Altitude: SEA LEVEL
2. Building type (one or two story, split-level, etc.): ONE STORY
3. Roof shape: SLOPED GABLE
4. Lot size: 100' E-W, 60' 0" N-S Special features: SHADING FROM NEIGHBORING TREES IN SUMMER DESIRABLE
5. Lot orientation (in which direction will the house face the street?): W
6. Building setbacks (check with local codes): _____
7. Zoning restrictions and covenants: _____
8. Lot access: FROM WEST (OR EAST FOR MIRROR-REVERSED PLAN)
9. Utility access: _____
10. Lot slope, water runoff (erosion?), berming: BERMING ON NORTH SIDE POSSIBLE
11. Predominant direction of winter wind: EN Velocity: 5 mph average
12. Predominant direction of summer breeze: WSW Velocity: 4 mph average
13. Direction of best view: _____
14. Direction of worst view: _____
15. Shading from neighboring houses, trees, etc.: _____
16. Approximate floor area: 1408 Heated basement? NO
17. Number of occupants: _____
18. Number of bedrooms, baths: 3 BR, 1 3/4 BATHS
19. Other living spaces wanted: _____
20. Life style of occupants and special needs (i.e. play area for children, space for entertaining, hobbies; space used during day, evening; special storage requirements; handicaps): STORAGE IN ATTIC ABOVE KITCHEN AND BATHROOM. OPEN LIVING ROOM AREA. LAUNDRY FACILITY IN CENTRAL BATHROOM, WOOD STOVE FOR BACKUP HEATING.
21. Preferred patio location, other outdoor recreation areas: SOUTH PATIO; GARDEN WALL ON STREET SIDE OFF HOUSE CORNERS; CLOTHES LINE NEAR PATIO.
22. Occupants like the following features: _____


23. Occupants dislike the following features: _____

WORKSHEET 1B
SPACE RELATIONSHIP DIAGRAM

Floor area: 1408 sq. ft.

Sketch the location of the main entry and the living, cooking, eating and sleeping areas; then mark the major wind directions and use baths, utility, storage areas and garage as buffer zones against winter winds and summer heat. Indicate the zoning barrier (■ ■ ■) and tentatively mark the location of auxiliary heat sources (*). Areas thus marked will need to be designed so that they can be completely closed off from the remaining sections of the house during periods when auxiliary heating is necessary. Finally, show the direction(s) of the best view (and, optionally, undesirable views which will need to be screened).

CASA AMANDA
II

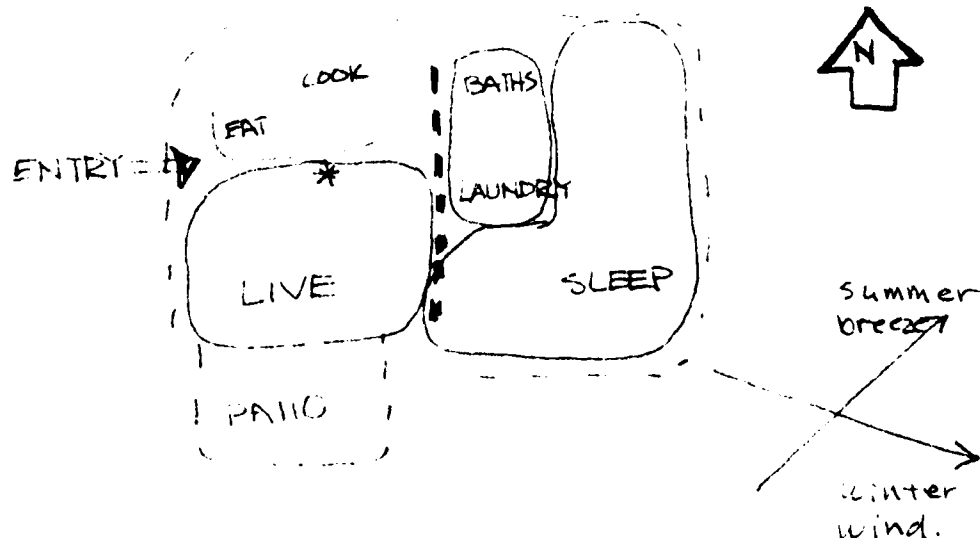

AD-A108 386

NEW MEXICO STATE UNIV LAS CRUCES

F/G 13/1

DESIGN CALCULATION PROCEDURE FOR PASSIVE SOLAR HOUSES AT NAVY I--ETC(U)

OCT 81 M LUMSDAINE, E LUMSDAINE

N62563-79-MR-585


NL

UNCLASSIFIED

CEL-CR-82.006

2 of 2
FORM

END
DATE
FILMED
4-82
DTIC

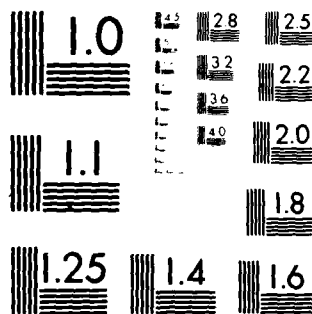

MICROCOPY RESOLUTION TEST CHART
NATIONAL BUREAU OF STANDARDS-1963-A

WORKSHEET 1C

ADDITIONAL INFORMATION AND CHECKLIST FOR ENERGY CONSERVATION

	Building orientation is within 5° E or W of South.
✓	Major axis runs east-west.
	Windbreaks are provided against winter and spring storms.
✓	Windows are of double or triple-glazed wood-frame (or equivalent) casement, single- or double-hung type? <u>DOUBLE-HUNG</u>
✓	Window areas to the north, east and west are minimized.
✓	Windows allow sufficient natural summer ventilation.
✓	Windows are insulated at night by (insulated drapes, shades, interior or exterior shutters): <u>INSULATED DRAPES, SHUTTERS</u>
✓	Passive solar mechanisms included in the design are: <u>DIRECT GAIN (S. GLASS + SKYLIGHTS)</u>
✓	Storage mass is located at: <u>MBR. NORTH WALL + FLOOR; BR. 3 W. WALL; BR. 2 E-W. WALL, L.R. E. WALL, FLOORS, K/D W-N WALLS, FLOORS.</u>
✓	Are fans used for heat distribution: <u>YES</u> Where? <u>KITCHEN (LIVING ROOM OPT.)</u>
✓	Is there a solar greenhouse? <u>NO</u>
✓	Are there well-lighted spaces in the house for plants? _____
	Other sources of winter humidity in the house are (interior venting of clothes dryer, interior clothesline, etc): _____
✓	Is the main entry an air lock? <u>YES</u> Do other entries have air locks or storm doors? _____
✓	Can heated living areas be closed-off from sleeping areas? <u>YES</u>
✓	What type backup heater is planned? <u>WOOD STOVE, GAS HEATER OR FIREPLACE</u>
✓	Will a solar water heater be used? <u>YES</u> What type? _____
✓	Solar tank location, size: <u>CLOSET IN KITCHEN</u>
	Collector location: <u>OVER BATHS</u> Type: _____ Area needed: <u>600² MIN.</u>
	Heat exchanger(s): _____
✓	Collector slope (approximately equal to latitude +10° is best): <u>45°</u>
	Backup water heater, type, size, fuel: _____
✓	Energy-efficient appliances to be used are: <u>KITCHEN APPLIANCES, STOVE, FRIG, ETC.</u>
✓	Fluorescent lights are to be used in: <u>KITCHEN, BATHROOMS.</u>
✓	Fireplace has chimney on interior wall and is equipped with fresh-air duct and damper and glass screen.
	Wood burner or stove: _____ Output: _____ Btu/hr

WORKSHEET 1D
BUILDING DIMENSIONS
(for Worksheet 2)

Orientation/ Type	Gross Wall Area, ft ²	Window Area, ft ²	Door Area, ft ²	Net Wall Area, ft ²	Perimeter ft
	() - [() + ()] = ().				()
Total NW					
Total N	352 - (25 +) = 327				44
Total NE					
Total E	304 - (32 +) = 272				32
Total SE					
Total W	304 - (12 + 20) = 272				32
Total SW					
Total S	352 - (80 +) = 272				44
Total Trombe					
Total Air Lock					
Total	(1312) - [(149) + (20)] = (1143).				(152)
Roof	Gross Roof Area Skylights Net Roof Area (1415) - (55±) = (1360)				

WORKSHEET 2

CALCULATION OF BUILDING SKIN CONDUCTANCE

Surface Type	Net Area ft ²	U-value Btu/hr-°F-ft ²	U x Area Btu/hr-°F*	% of Total
North exterior wall	<u>327</u> X	_____	= _____	
East exterior wall	<u>272</u> X	_____	= _____	
West exterior wall	<u>272</u> X	<u>0.05</u>	= <u>57</u>	
South exterior wall	<u>272</u> X	_____	= _____	
South Trombe wall	_____ X	_____	= _____	
Air lock walls	_____ X	_____	= _____	
Total Wall Heat Loss			<u>57</u>	<u>25%</u>
Doors: Entry	<u>20</u> X	<u>0.3</u>	= <u>6</u>	
Patio	_____ X	_____	= _____	
Other	_____ X	_____	= _____	
North windows	<u>25</u> X	_____	= _____	
East windows	<u>32</u> X	<u>0.42</u> ***	= <u>63</u>	
West windows	<u>12</u> X	_____	= _____	
South windows	<u>80</u> X	_____	= _____	
Clerestory windows	_____ X	_____	= _____	
Sloped skylights	<u>55</u> X	<u>0.5</u>	= <u>27.5</u>	
Horizontal skylights	_____ X	_____	= _____	
Total Door/Window Heat Loss			<u>97</u>	<u>42%</u>
Roof	<u>1360</u> X	<u>0.03</u>	= <u>41</u>	<u>18%</u>
Floor ** R-8.6	<u>152</u> X	<u>0.23</u>	= <u>35</u>	<u>15%</u>
Total Building Skin Conductance (add boxed-in values)			<u>230</u>	<u>100</u>

* The values here may be rounded off to whole numbers, as extreme accuracy is not needed.

** Crawlspace = Ah_c (see Figure 4.1)

Slab = $F \times P$ (see Table 4.1)

Heated basement = $UA_{\text{wall above grade}} + h_b A_{\text{wall below grade}} + h_c A_{\text{floor}}$

*** DOUBLE-GLAZED, W R-1 NIGHT INSULATION FOR 12 HRS..

WORKSHEET 3

CALCULATION OF INFILTRATION LOAD AND MODIFIED BUILDING HEAT LOSS COEFFICIENT C_b

$$\text{House Volume} = \text{Gross Floor Area} \times \text{Ceiling Height} = (1408)(10) = \underline{14,100}$$

$$\text{Infiltration Load} = \text{Volume} \times C_p \times \text{ACH}$$

$$= (14,100) \times (0.018) \times (0.75)$$

$$= \underline{190} \text{ Btu/hr-}^\circ\text{F}$$

ACH = Air Change/Hour
(FOR SMOKERS)

Modified Building Heat Loss Coefficient, C_b

$$= \left[\frac{\text{Building Skin}}{\text{Conductance}^*} - \frac{\text{Infiltration}}{\text{Load}} \right]$$

$$= 24 [(230) + (190)] = 24 (420)$$

$$= \underline{10080} \text{ Btu/D.D.}$$

$$\text{Gross Heated Floor Area of Building} = \underline{1408} \text{ ft}^2$$

$$C_b/A = (10,080) / (1408)$$

$$= \underline{7.2} \text{ Btu/ft}^2\text{-D.D.}$$

D.D. = Degree Days**

* From Worksheet 2.

**"Degree Days" is an indication of the "coldness" of the climate for heating calculations; the degree-day value for a particular day is the difference between the average daily outdoor temperature and 65°F; the data is usually given in monthly and yearly totals.

WORKSHEET 4

CALCULATION OF BUILDING THERMAL LOAD PROFILE

Modified Building Heat Loss Coefficient C_b from Worksheet 3 = 10,100 Btu/D.D.

Month	Degree Days per Month	$\times C_b =$	Gross Thermal Load, MBtu/month	-	Internal Heat Sources, MBtu/month	=	Net Thermal Load, MBtu/month
Aug.	<u>50</u>	$\times C_b =$	<u>0.5</u>	-	_____	=	_____
Sept.	<u>60</u>	$\times C_b =$	<u>0.6</u>	-	_____	=	_____
Oct.	110		1.1		1.2		—
Nov.	200		2.0		1.2		0.8
Dec.	310		3.1		1.2		1.9
Jan.	350		3.5		1.2		2.3
Feb.	300		3.0		1.2		1.8
Mar.	310		3.1		1.2		1.9
Apr.	240		2.4		1.2		1.2
May	180		1.8		1.2		0.6
Jun.	120		1.2		1.2		—
Jul.	70		0.7		1.2		—
MBtu = Million Btu							10.5

2300 H.P.D. TOTAL

WORKSHEET 5
CALCULATION OF SOLAR HEATING CONTRIBUTION

Mechanism: DIRECT GAIN THRU SKYLIGHT 55 (0.85) (SINGLE-GLAZED)

Net Effective Collector Area: 47 ft² = A_{eff}

$$A_{\text{eff}} = A_{\text{gross}} \times (\text{Frame Shading}) \times (\text{Effectiveness, Table 5.1})$$

Month	Solar Heat Gain from Tables 5.2 - 5.4 Btu/Month-ft ² x 10 ³ (1)	Adjustment Factors		Solar Heat Absorbed in MBtu/month A _{eff} x (1) x (2) x (3)
		Roof Overhang from Worksheet 5B (2)	Off South Orientation: % Reduction from Sec. 5.3 (3)	
Aug.				<div style="display: flex; align-items: center;"> <div style="margin-right: 10px;"> <div style="border-left: 1px solid black; height: 40px; margin-bottom: 5px;"></div> <div style="border-left: 1px solid black; height: 40px; margin-bottom: 5px;"></div> <div style="border-left: 1px solid black; height: 40px; margin-bottom: 5px;"></div> <div style="border-left: 1px solid black; height: 40px;"></div> </div> <div> SKYLIGHT INSULATION SHUT DURING THE DAY </div> </div>
Sept.				
Oct.				
Nov.	39			
Dec.	37			1.8
Jan.	38			1.7
Feb.	38			1.8
Mar.	45			1.8
Apr.	43			2.1
May	40			2.0
Jun.				1.9
Jul.				<div style="display: flex; align-items: center;"> <div style="margin-right: 10px;"> <div style="border-left: 1px solid black; height: 40px; margin-bottom: 5px;"></div> <div style="border-left: 1px solid black; height: 40px;"></div> </div> <div> INSULATION SHUT. </div> </div>

WORKSHEET 5
CALCULATION OF SOLAR HEATING CONTRIBUTION

Mechanism: DIRECT GAIN THRU SOUTH GLASS $80(0.85)(0.85)$

Net Effective Collector Area: 58 $\text{ft}^2 = A_{\text{eff}}$

$$A_{\text{eff}} = A_{\text{gross}} \times (\text{Frame Shading}) \times (\text{Effectiveness, Table 5.1})$$

Month	Solar Heat Gain from Tables 5.2 - 5.4 $\text{Btu/Month-ft}^2 \times 10^3$ (1)	Adjustment Factors		Solar Heat Absorbed in MBtu/month $A_{\text{eff}} \times (1) \times (2) \times (3)$
		Roof Overhang from Worksheet 5B (2)	Off South Orientation: % Reduction from Sec. 5.3 (3)	
Aug.	25	0.46		0.67
Sept	30	0.83		1.4
Oct.	35	1		2.0
Nov.	33	1		1.9
Dec.	35	1		2.0
Jan.	33	1		1.9
Feb.	31	1		1.8
Mar.	32	0.83		1.5
Apr.	22	0.46		0.5
May	20			
Jun.	17			
Jul.	20			

WORKSHEET 5B
CALCULATION OF SHADING WITH SOUTH ROOF OVERHANG

- (A) Latitude of building site: 34 °N
 (B) Length of summer shadow desired: 6 ft
 (C) Size of roof overhang (projection from south wall)
 from Table 5.2 (directly or interpolated): 2'0" ft
 (D) Height of lower overhang edge from finished floor: 8'0" ft
 (E) Distance from finished floor to top of glazing: 6'8" ft
 (F) Vertical distance from top of glazing to roof overhang:
 (D) - (E) = 1'4" ft
 (G) Window or glazing height: 4' ft**

Month	Height of Shadow Cast, ft (H) x (C) = (I)	Effective Shadow Length, ft (J) = 2/3 (I)	Window Shading, ft* (K) = (J) - (F)	% Shading, (K)/(G) = (L)	Shading Factor, (M) = 1 - (L)
S	1.5 x 2 = 3	2	0.66	0.165	0.83
O	1.0 x 2 = 2	1.33	0	0	1
N	0.75 x 2 = 1.5	-	-	-	1
D	0.65 x 2 = 1.3	-	-	-	1
J	0.75 x 2 = 1.5	-	-	-	1
F	1.0 x 2 = 2	1.33	0	0	1
M	1.5 x 2 = 3	2	0.66	1.65	0.83
A	2.6 x 2 = 5.2	3.4	2.1	0.54	0.46
M					
J					

Enter Column (M) in Column 2, Worksheet 5.

* If (J) - (F) is less than zero, enter zero in Column (K).

** If window (glazing) height varies, a reasonable average can be assumed.

WORKSHEET 6

CALCULATION OF BUILDING AUXILIARY LOAD PROFILE

Month	Net Thermal Load (from Worksheet 4) (A)	Total Solar Heat Gain (from Worksheet 5) (B)	Solar Load Ratio (SLR) (B) ÷ (A) (C)	Solar Heating Fraction (SHF) (from Fig. 5.7) (D)	Solar Heating Contrib. (D) × (A) (E)	Auxiliary Load Profile (A) - (E) (F)
Aug.						
Sept.						
Oct.						
Nov.	0.8	3.7	73	1.0	0.8	0
Dec.	1.9	3.7	1.95	0.95	1.8	0.1
Jan.	2.3	3.7	1.61	0.9	2.1	0.2
Feb.	1.8	3.6	2.0	0.95	1.7	0.1
Mar.	1.9	3.6	1.89	0.93	1.8	0.1
Apr.	1.2	2.5	2.08	0.96	1.1	0.1
May	0.6	1.9	73	1.0	0.6	0
Jun.						
Jul.						
TOTAL	<u>10.5</u> MBtu			<u>9.9</u> MBtu	<u>9.6</u> MBtu	

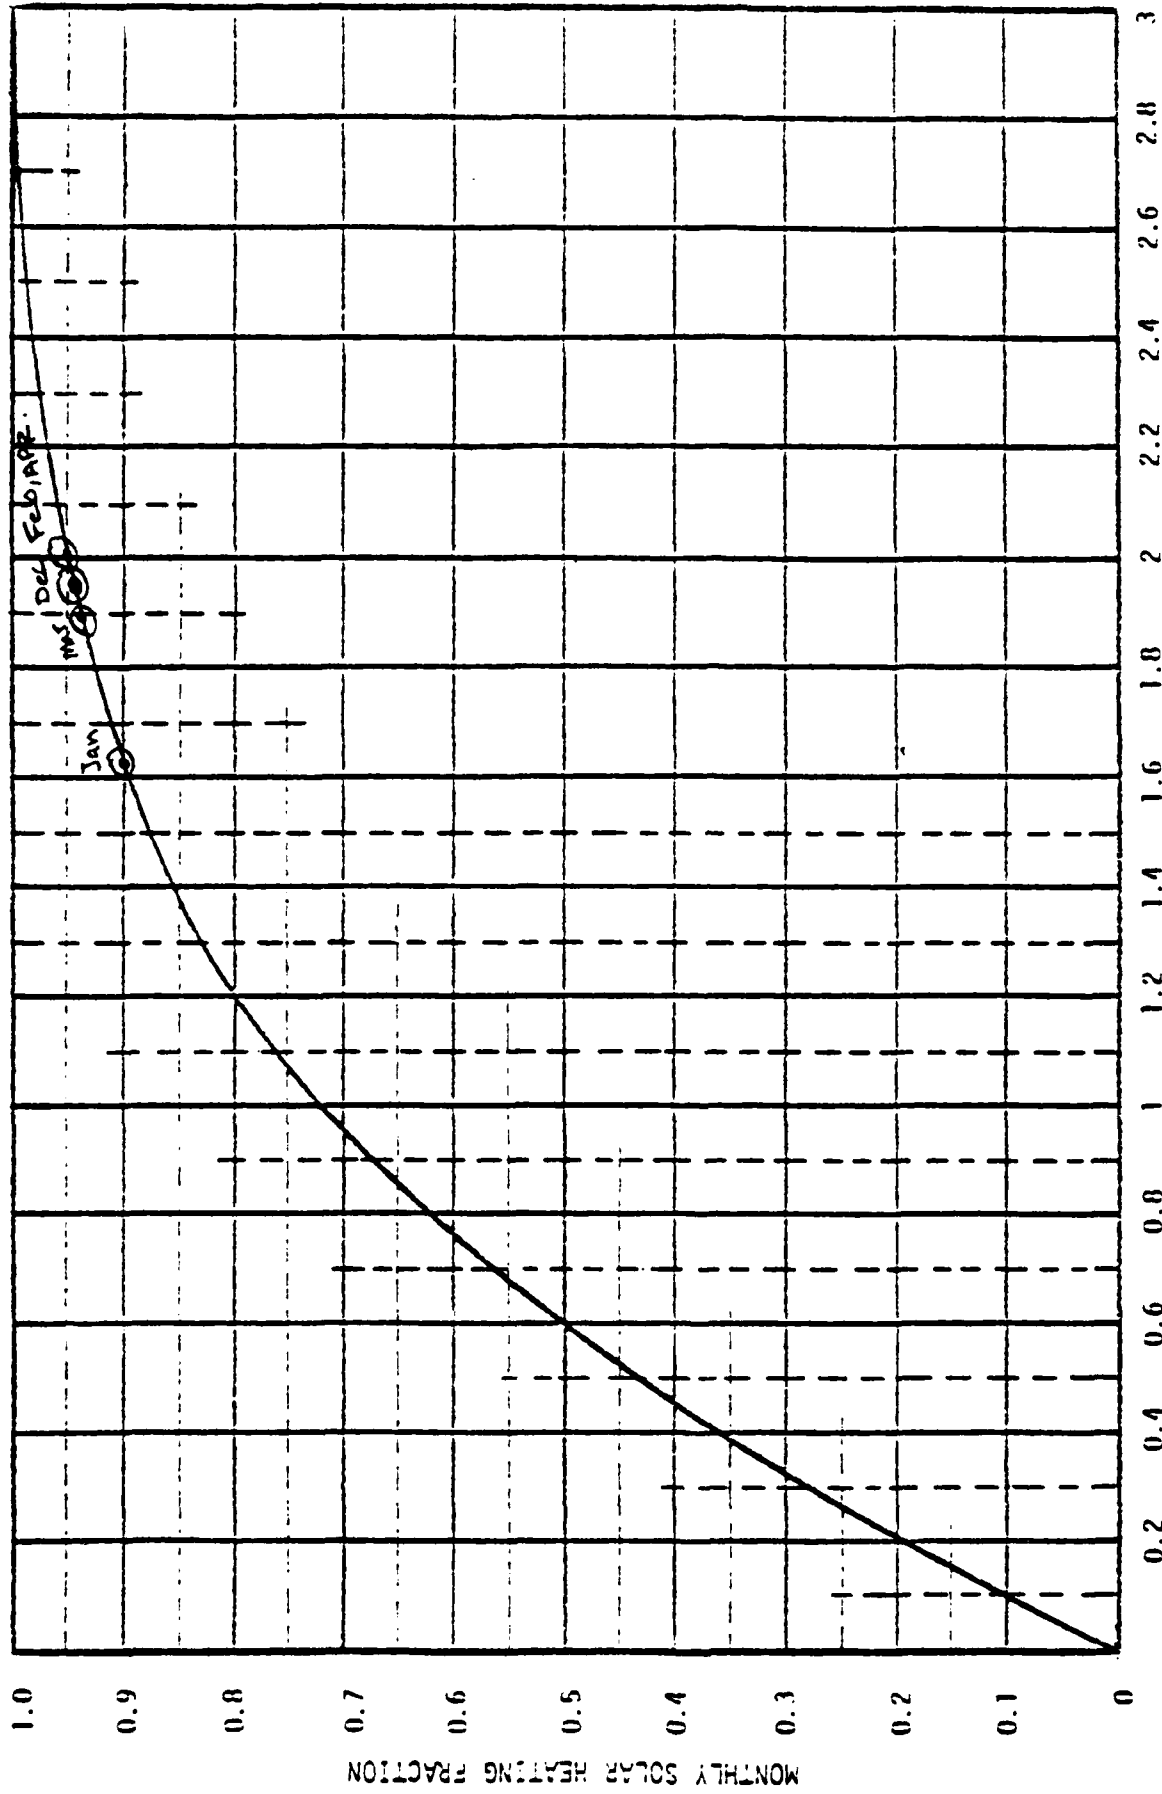


Figure 5.7 Monthly Passive Solar Heating Estimator

WORKSHEET 7
GLAZING AND STORAGE CALCULATIONS

Daily Maximum Solar Heat Gain: <u>1500 ave.</u>					
Room	South Glazing ft ²	Floor Area ft ²	Designed Storage ft ³	Storage Volume per 100 ft ² of Glazing ft ³	Temp. Swing °F
BR. 2	20	145	135	675	9°
BR. 3	20	155	135	675	9°
MR. BR.	30	165	$\left\{ \begin{array}{l} 170 \text{ WALLS} \\ 53 \text{ FLOORS} \\ \hline 225 \end{array} \right.$	750/570	9°/11°
K/D.	24	255	$\left\{ \begin{array}{l} 175 \text{ WALLS} \\ 48 \text{ FLOORS} \\ \hline 245 \end{array} \right.$	900/730	8°/9°
L.R.	40	255	$\left\{ \begin{array}{l} 160 \text{ WALLS} \\ 85 \text{ FLOORS} \\ \hline 245 \end{array} \right.$	610/400	10°/15°
.....					
.....					
.....					
	—	—	—	—	
TOTAL	==	==	<u>860</u>	==	

OPTIONS: REDUCE THICKNESS OF ALL
MASONRY WALLS BY APPROX. 15%
OR DO NOT USE FLOOR AS STORAGE
EXCEPT IN LIVING ROOM

Check for temperature drop during a completely cloudy day (24-hour period):

$$\text{Maximum } \Delta T = \frac{\text{Net January Thermal Load}^*/31}{\text{Total Volume} \times (\text{Heat Capacity of Storage Material})^{**}}$$

$$\Delta T = \frac{(2.3 \times 10^6)}{31 (22) (860)} = 4^\circ \text{ } ^\circ\text{F}$$

*From Worksheet 4.

**From Table 6.2.

Discussion of Results

The Southern California coastal climate is characterized by a mild year-round climate; even though heating degree days occur every month of the year, the January high is not extreme, and for about one-half of the year, the internal heat gain is sufficient to cover the heating requirements. Thus solar heating is only needed from about mid-November to early May. In this example, a fairly high infiltration rate has been assumed (for smoking occupants). The combination of vertical and sloped heat-gaining windows provides an evened-out monthly solar gain profile which is well-matched to the load profile. The sloped skylights must be shut during the summer to prevent overheating. The auxiliary load is extremely small and can easily be supplied with a fireplace, small wood stove or a gas wall unit (with heat lamps located in the bathrooms). The storage calculations show that the thermal mass is more than sufficient for comfort and could be reduced somewhat to reduce costs. This thermal mass will also be useful in reducing the need for cooling. The south glazing must be shaded with an adequate overhang. If a 4-ft. overhang over the patio is assumed, heat gain will be less than shown on Worksheet 6, especially later in the spring and in early fall. If this heat gain is not sufficient for comfort, the kitchen skylight shading may be removed as needed to allow additional solar gain into the house. Note that even though the solar heating contribution is above 90 percent, the overall heat and energy savings in this mild climate are relatively small, when compared for instance to a New England design with only a 70 percent solar fraction.

Additional rounds of calculations could be made based on cost considerations for glazing, masonry and insulation, since the example set shows that the home with the assumed specification is overdesigned for the particular site and average climatic conditions. On the other hand, if pollution and backup energy problems are severe in the community, a design requiring practically no auxiliary energy would have advantages.

ATTACHMENT

SET OF WORKSHEET BLANKS FOR XEROXING

A set of loose-leaf worksheets is provided here for making xerox copies; the design of a passive house from the initial concept to final drawings usually requires at least three sets.

WORKSHEET 1A
DESIGN INFORMATION

1. Location of building: _____ Altitude: _____
2. Building type (one or two story, split-level, etc.): _____
3. Roof shape: _____
4. Lot size: _____ Special features: _____
5. Lot orientation (in which direction will the house face the street?): _____
6. Building setbacks (check with local codes): _____
7. Zoning restrictions and covenants: _____
8. Lot access: _____
9. Utility access: _____
10. Lot slope, water runoff (erosion?), berming: _____
11. Predominant direction of winter wind: _____ Velocity: _____ mph average
12. Predominant direction of summer breeze: _____ Velocity: _____ mph average
13. Direction of best view: _____
14. Direction of worst view: _____
15. Shading from neighboring houses, trees, etc.: _____
16. Approximate floor area: _____ Heated basement? _____
17. Number of occupants: _____
18. Number of bedrooms, baths: _____
19. Other living spaces wanted: _____
20. Life style of occupants and special needs (i.e. play area for children, space for entertaining, hobbies; space used during day, evening; special storage requirements; handicaps): _____

21. Preferred patio location, other outdoor recreation areas: _____

22. Occupants like the following features: _____

23. Occupants dislike the following features: _____

WORKSHEET 1B
SPACE RELATIONSHIP DIAGRAM

Floor area: _____ sq. ft.

Sketch the location of the main entry and the living, cooking, eating and sleeping areas; then mark the major wind directions and use baths, utility, storage areas and garage as buffer zones against winter winds and summer heat. Indicate the zoning barrier (■ ■ ■) and tentatively mark the location of auxiliary heat sources (★). Areas thus marked will need to be designed so that they can be completely closed off from the remaining sections of the house during periods when auxiliary heating is necessary. Finally, show the direction(s) of the best view (and, optionally, undesirable views which will need to be screened).

WORKSHEET 1C

ADDITIONAL INFORMATION AND CHECKLIST FOR ENERGY CONSERVATION

Building orientation is within 5° E or W of South.

Major axis runs east-west.

Windbreaks are provided against winter and spring storms.

Windows are of double or triple-glazed wood-frame (or equivalent) casement, single- or double-hung type? _____

Window areas to the north, east and west are minimized.

Windows allow sufficient natural summer ventilation.

Windows are insulated at night by (insulated drapes, shades, interior or exterior shutters): _____

Passive solar mechanisms included in the design are: _____

Storage mass is located at: _____

Are fans used for heat distribution: _____ Where? _____

Is there a solar greenhouse? _____

Are there well-lighted spaces in the house for plants? _____

Other sources of winter humidity in the house are (interior venting of clothes dryer, interior clothesline, etc): _____

Is the main entry an air lock? _____ Do other entries have air locks or storm doors? _____

Can heated living areas be closed-off from sleeping areas? _____

What type backup heater is planned? _____

Will a solar water heater be used? _____ What type? _____

Solar tank location, size: _____

Collector location: _____ Type: _____ Area needed: _____

Heat exchanger(s): _____

Collector slope (approximately equal to latitude +10° is best): _____

Backup water heater, type, size, fuel: _____

Energy-efficient appliances to be used are: _____

Fluorescent lights are to be used in: _____

Fireplace has chimney on interior wall and is equipped with fresh-air duct and damper and glass screen.

Wood burner or stove: _____ Output: _____ Btu/hr

WORKSHEET 1D
BUILDING DIMENSIONS
(for Worksheet 2)

Orientation/ Type	Gross Wall Area, ft ²	Window Area, ft ²	Door Area, ft ²	Net Wall Area, ft ²	Perimeter ft
	() - [() + ()] = ().				()
Total NW					
Total N					
Total NE					
Total E					
Total SE					
Total W					
Total SW					
Total S					
Total Trombe					
Total Air Lock					
Total	() - [() + ()] = ().				()
Roof	Gross Roof Area ()	Skylights ()	Net Roof Area ()		

WORKSHEET 2

CALCULATION OF BUILDING SKIN CONDUCTANCE

Surface Type	Net Area ft ²	U-value Btu/hr-°F-ft ²	U x Area Btu/hr-°F*	% of Total
North exterior wall	_____ X	_____	= _____	
East exterior wall	_____ X	_____	= _____	
West exterior wall	_____ X	_____	= _____	
South exterior wall	_____ X	_____	= _____	
South Trombe wall	_____ X	_____	= _____	
Air lock walls	_____ X	_____	= _____	
Total Wall Heat Loss			<div style="border: 1px solid black; width: 60px; height: 20px; margin: 0 auto;"></div>	_____
Doors: Entry	_____ X	_____	= _____	
Patio	_____ X	_____	= _____	
Other	_____ X	_____	= _____	
North windows	_____ X	_____	= _____	
East windows	_____ X	_____	= _____	
West windows	_____ X	_____	= _____	
South windows	_____ X	_____	= _____	
Clerestory windows	_____ X	_____	= _____	
Sloped skylights	_____ X	_____	= _____	
Horizontal skylights	_____ X	_____	= _____	
Total Door/Window Heat Loss			<div style="border: 1px solid black; width: 60px; height: 20px; margin: 0 auto;"></div>	_____
Roof	_____ X	_____	= <div style="border: 1px solid black; width: 60px; height: 20px; margin: 0 auto;"></div>	_____
Floor **	_____ X	_____	= <div style="border: 1px solid black; width: 60px; height: 20px; margin: 0 auto;"></div>	_____
Total Building Skin Conductance (add boxed-in values)			_____	<u>100</u>
			=====	=====

* The values here may be rounded off to whole numbers, as extreme accuracy is not needed.

** Crawlspace = Ah_c (see Figure 4.1)

Slab = $F \times P$ (see Table 4.1)

Heated basement = $UA_{\text{wall above grade}} + h_b A_{\text{wall below grade}} + h_c A_{\text{floor}}$

WORKSHEET 3

CALCULATION OF INFILTRATION LOAD AND MODIFIED BUILDING HEAT LOSS COEFFICIENT C_B

$$\begin{aligned} \text{House Volume} &= \text{Gross Floor Area} \times \text{Ceiling Height} = (\quad) (\quad) = \underline{\hspace{2cm}} \\ \text{Infiltration Load} &= \text{Volume} \times C_p \times \text{ACH} \qquad \text{ACH} = \text{Air Change/Hour} \\ &= (\quad) \times (\quad) \times (\quad) \\ &= \underline{\hspace{2cm}} \text{ Btu/hr-}^\circ\text{F} \end{aligned}$$

Modified Building Heat Loss Coefficient, C_B

$$\begin{aligned} &= \left[\frac{\text{Building Skin}}{\text{Conductance}^*} + \frac{\text{Infiltration}}{\text{Load}} \right] \\ &= 24 [(\quad) + (\quad)] = 24 (\quad) \\ &= \underline{\hspace{2cm}} \text{ Btu/D.D.} \end{aligned}$$

Gross Heated Floor Area of Building = $\underline{\hspace{2cm}}$ ft²

$$\begin{aligned} C_B/A &= (\quad) / (\quad) \\ &= \underline{\hspace{2cm}} \text{ Btu/ft}^2\text{-D.D.} \qquad \text{D.D.} = \text{Degree Days}^{**} \end{aligned}$$

* From Worksheet 2.

**"Degree Days" is an indication of the "coldness" of the climate for heating calculations; the degree-day value for a particular day is the difference between the average daily outdoor temperature and 65°F; the data is usually given in monthly and yearly totals.

WORKSHEET 4

CALCULATION OF BUILDING THERMAL LOAD PROFILE

Modified Building Heat Loss Coefficient C_B from Worksheet 3 = _____ Btu/D.D.

Month	Degree Days per Month	$\times C_B =$	Gross Thermal Load, MBtu/month	-	Internal Heat Sources, MBtu/month	=	Net Thermal Load, MBtu/month
Aug.	_____	$\times C_B =$	_____	-	_____	=	_____
Sept.	_____	$\times C_B =$	_____	-	_____	=	_____
Oct.							
Nov.							
Dec.							
Jan.							
Feb.							
Mar.							
Apr.							
May							
Jun.							
Jul.							

MBtu = Million Btu

WORKSHEET 5
CALCULATION OF SOLAR HEATING CONTRIBUTION

Mechanism: _____

Net Effective Collector Area: _____ $\text{ft}^2 = A_{\text{eff}}$

$$A_{\text{eff}} = A_{\text{gross}} \times (\text{Frame Shading}) \times (\text{Effectiveness, Table 5.1})$$

Month	Solar Heat Gain from Figs. 5.2 - 5.4 $\text{Btu/Month-ft}^2 \times 10^3$ (1)	Adjustment Factors		Solar Heat Absorbed in MBtu/month $A_{\text{eff}} \times (1) \times (2) \times (3)$
		Roof Overhang from Worksheet 5B (2)	Off South Orientation: % Reduction from Sec. 5.3 (3)	
Aug.				
Sept.				
Oct.				
Nov.				
Dec.				
Jan.				
Feb.				
Mar.				
Apr.				
May				
Jun.				
Jul.				

WORKSHEET 5A

ADJUSTED NET SOLAR GREENHOUSE HEAT GAIN

Month	Solar Heat Gain Absorbed (from Worksheet 5 of Greenhouse Calculations)	Monthly Heat Loss (Net Thermal Load) from Worksheet 4 *	Net Heat Gain MBtu/month x Adjustment Factor ()	= Adjusted Net Solar Greenhouse Heat Gain
Aug.	_____	- _____	= _____	_____
Sept.				
Oct.				
Nov.				
Dec.				
Jan.				
Feb.				
Mar.				
Apr.				
May				
Jun.				
Jul.				

*For greenhouse heat loss to the outside only.

WORKSHEET 5B
CALCULATION OF SHADING WITH SOUTH ROOF OVERHANG

- (A) Latitude of building site: _____ °N
 (B) Length of summer shadow desired: _____ ft
 (C) Size of roof overhang (projection from south wall)
 from Table 5.2 (directly or interpolated): _____ ft
 (D) Height of lower overhang edge from finished floor: _____ ft
 (E) Distance from finished floor to top of glazing: _____ ft
 (F) Vertical distance from top of glazing to roof overhang:
 (D) - (E) = _____ ft
 (G) Window or glazing height: _____ ft**

Month	Height of Shadow Cast, ft (H) x (C) = (I)	Effective Shadow Length, ft (J) = 2/3 (I)	Window Shading, ft* (K) = (J) - (F)	% Shading, (K)/(G) = (L)	Shading Factor, (M) = 1 - (L)
S					
O					
N					
D					
J					
F					
M					
A					
M					
J					

Enter Column (M) in Column 2, Worksheet 5.


* If (J) - (F) is less than zero, enter zero in Column (K).

** If window (glazing) height varies, a reasonable average can be assumed.

WORKSHEET 6

CALCULATION OF BUILDING AUXILIARY LOAD PROFILE

Month	Net Thermal Load (from Worksheet 4) (A)	Total Solar Heat Gain (from Worksheet 5) (B)	Solar Load Ratio (SLR) (B) : (A) (C)	Solar Heating Fraction (SHF) (from Fig. 5.7) (D)	Solar Heating Contrib. (D) x (A) (E)	Auxiliary Load Profile (A) - (E) (F)
Aug.						
Sept.						
Oct.						
Nov.						
Dec.						
Jan.						
Feb.						
Mar.						
Apr.						
May						
Jun.						
Jul.						
TOTAL	<u> </u> <u> </u> MBtu				<u> </u> <u> </u> MBtu	<u> </u> <u> </u> MBtu

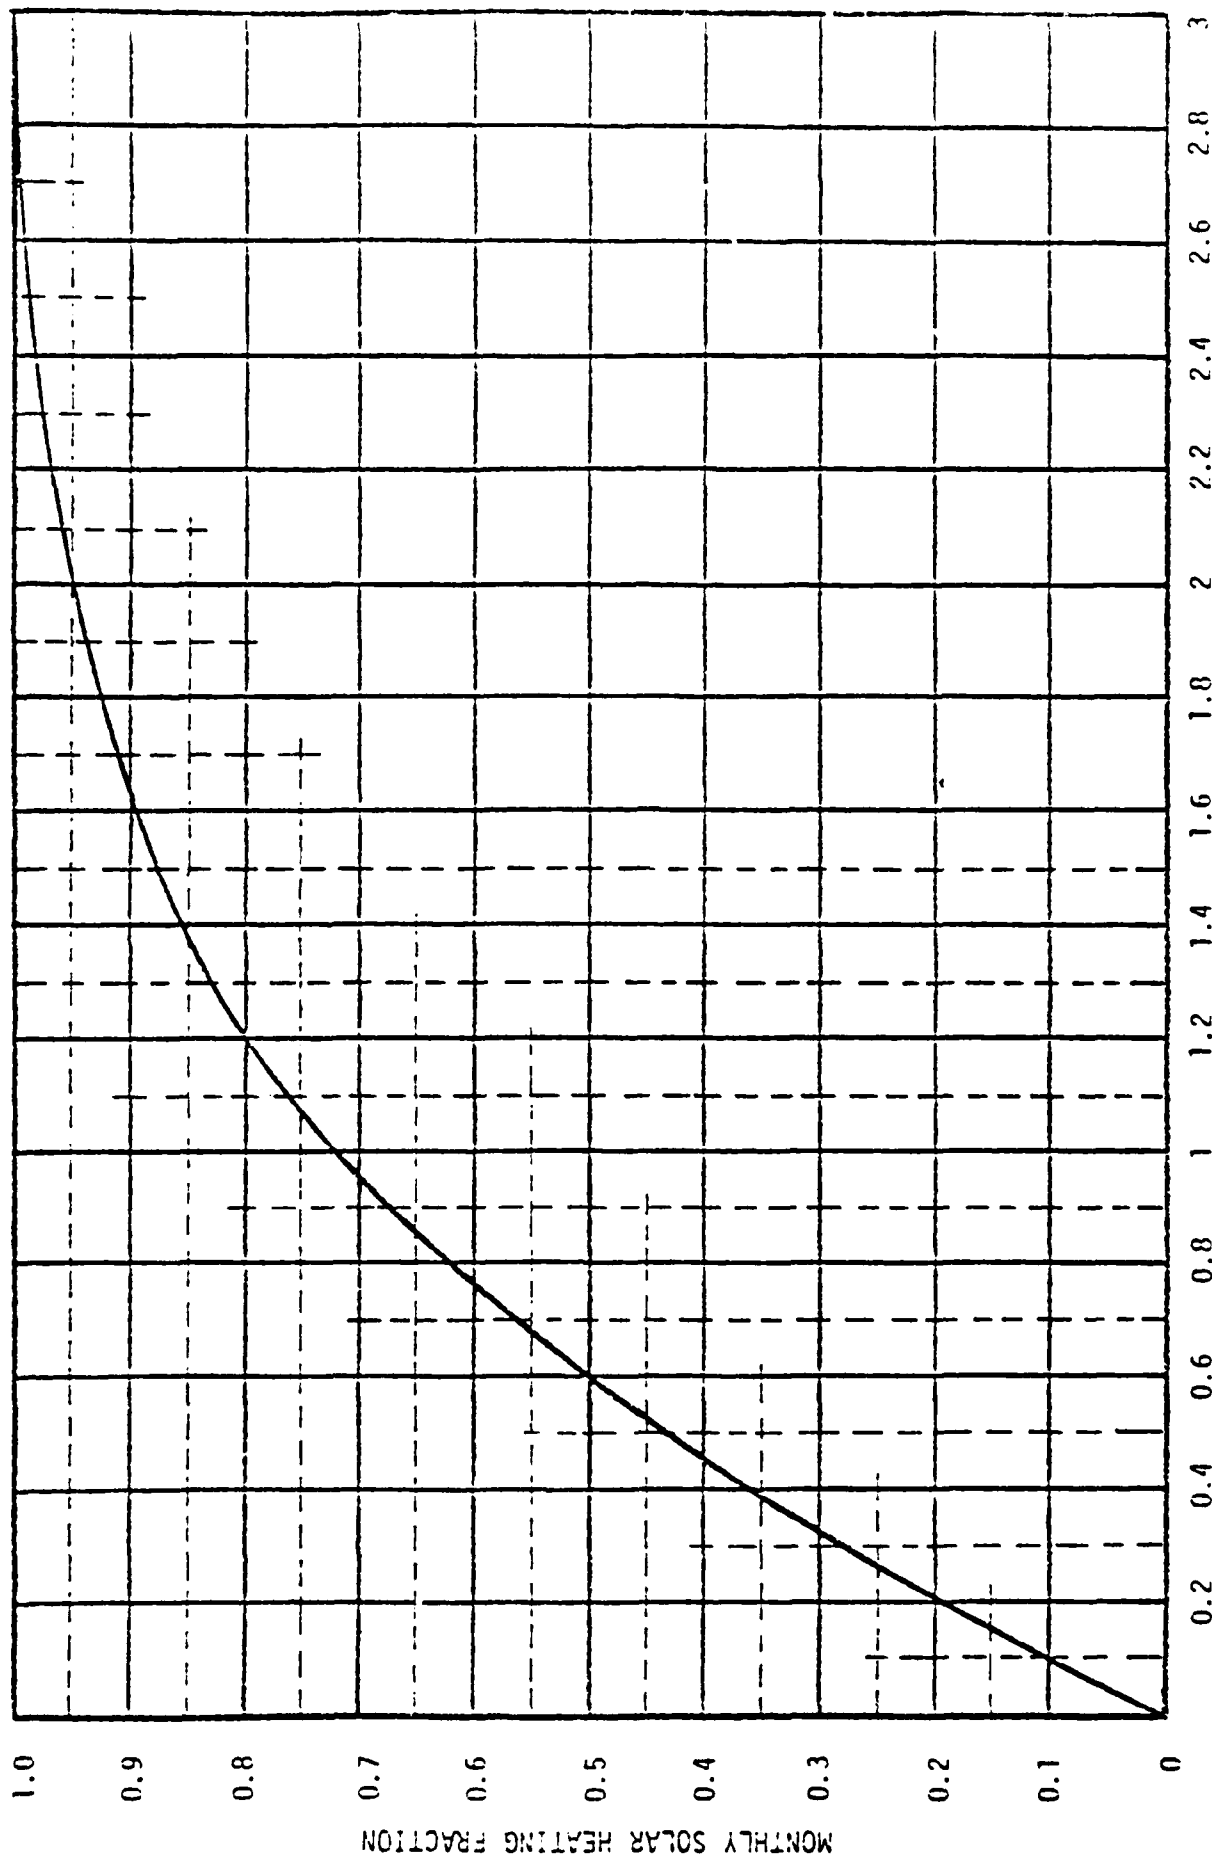

MONTHLY SOLAR LOAD RATIO

Monthly Passive Solar Heating Fraction

WORKSHEET 7
GLAZING AND STORAGE CALCULATIONS

	Daily Maximum Solar Heat Gain: _____				
Room	South Glazing ft ²	Floor Area ft ²	Designed Storage ft ³	Storage Volume per 100 ft ² of Glazing ft ³	Temp. Swing °F
.....					
.....					
.....					
.....					
.....					
.....					
.....					
.....					
.....					
TOTAL	=====	=====	=====	=====	

Check for temperature drop during a completely cloudy day (24-hour period):

$$\text{Maximum } \Delta T = \frac{\text{Net January Thermal Load}^*/31}{\text{Total Volume} \times (\text{Heat Capacity of Storage Material})^{**}}$$

$$\Delta T = \frac{(\quad)}{31 (\quad) (\quad)} = \quad^\circ\text{F}$$

*From Worksheet 4.

**From Table 6.2.

WORKSHEET 8A
CALCULATIONS FOR REFERENCE BUILDING

Building Location: _____ Zone: _____
 Floor Area: _____ ft² = (_____ ft)²; Perimeter = _____ ft;
 S. Window Area = (0.1)(A)÷4 = _____ ft²;
 Effective Window Area = ½()()() = _____ ft²

Building Skin Conductance (Btu/hr-°F):

Total Walls:	U-Value x Area = ()x() = _____
Total Windows and Doors:	U-Value x Area = ()x() = _____
Roof:	U-Value x Area = ()x() = _____
Floor: (See Section 4.1)	U-Value x Area = ()x() = _____
TOTAL	

Infiltration: Volume x C_p x ACH = () x () x 1 = _____

Modified Building Heat Loss Coefficient C_B

= 24 (Skin Conductance + Infiltration) = 24[(+)] = _____
 C_B/A = _____ Btu/D.D.-ft²

Heat Load Calculations(MBtu): Gross Heating Load minus Solar Heat Absorbed is equal to Net Heating Load

Month	Degree Days	Gross Heating Load	Solar Gain	Solar Heat Absorbed	Net Heating Load
Aug.					
Sept.					
Oct.					
Nov.					
Dec.					
Jan.					
Feb.					
Mar.					
Apr.					
May					
Jun.					
Jul.					

WORKSHEET 8B
HEAT SAVINGS CALCULATIONS FOR PASSIVE DESIGN*

Month	Reference Bldg. Heating Load	Passive Solar Building Aux. Load	Gross Heat Saved	Parasitic Power (See Foot- note), kWh x 0.0034	Net Energy Saved	<u>Cost of Energy Saved:</u> ELECTRICITY: cents/kWh x 2.93 GAS: \$/MCF x 1.7 ** OIL: \$/gal x 14.4 *** WOOD: \$/cord x 0.11 **** = _____ \$/MBtu x Net Savings =			
	MBtu/mo.	MBtu/mo.	MBtu	MBtu	MBtu	\$			
						EL	GAS	OIL	WOOD
Aug.	() -	() =							
Sept.									
Oct.									
Nov.									
Dec.									
Jan.									
Feb.									
Mar.									
Apr.									
May									
Jun.									
Jul.									
TOTAL									

*Does not include savings for solar water heating (or summer cooling).

**60% efficiency.

*** 1 MBtu = 7.2 gal. heating oil, 50% efficiency.

****Average of 20 MBtu per cord of wood depending on type [15] and 45% efficiency.

Add electricity needed to run the conventional furnace; subtract the electricity needed to operate fans in the passive design.

